



ETA-Danmark A/S  
Göteborg Plads 1  
DK-2150 Nordhavn  
Tel. +45 72 24 59 00  
Internet [www.etadanmark.dk](http://www.etadanmark.dk)

Authorised and notified  
according to Article 29 of the  
Regulation (EU)  
No 305/2011 of the European  
Parliament and of the Council  
of 9 March 2011

MEMBER OF EOTA

The logo for EOTA (European Technical Assessment). It consists of the word "EOTA" in white, bold, sans-serif letters, with a registered trademark symbol (®) to the top right. Behind the letters are twelve yellow stars arranged in a circular pattern, matching the design of the EU flag.

## European Technical Assessment ETA-21/0112 of 2021/01/01

### I General Part

**Technical Assessment Body issuing the ETA and designated according to Article 29 of the Regulation (EU) No 305/2011: ETA-Danmark A/S**

**Trade name of the construction product:**

MULCOL® MULTIMORTAR

**Product family to which the above construction product belongs:**

Fire Stopping and Sealing Product:

- Penetration Seals

**Manufacturer:**

Mulcol International BV  
Arnesteinweg 18  
4338 PD Middelburg  
The Netherlands

**Manufacturing plant:**

A/003

**This European Technical Assessment contains:**

53 pages including 1 annex which form an integral part of the document

**This European Technical Assessment is issued in accordance with Regulation (EU) No 305/2011, on the basis of:**

EAD 350454-00-1104

**This version replaces:**

-

**Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such.**

**Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may be made, with the written consent of the issuing Technical Assessment Body. Any partial reproduction has to be identified as such.**

**Table of Contents**

<b>I.      SPECIFIC PARTS OF THE EUROPEAN TECHNICAL ASSESSMENT.....</b>	<b>4</b>
1      Technical description of the product .....	4
2      Specification of the intended uses of the product in accordance with the applicable European Assessment Document (Hereinafter EAD): EAD 350454-00-1104 5	
3      Performance of the product and references to the methods used for its assessment .....	6
4      ASSESSMENT AND VERIFICATION OF CONSTANCY OF PERFORMANCE (HEREINAFTER AVCP) SYSTEM APPLIED, WITH REFERENCE TO ITS LEGAL BASE .....	7
5      Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD.....	7
<b>ANNEX A – Resistance to Fire Classification – Mulcol® Multimortar .....</b>	<b>8</b>
<b>A.1     Flexible or rigid wall constructions according to I.2.2 with wall thickness of minimum 100 mm .....</b>	<b>8</b>
A.1.1    Double side penetration seal with cables, trays and conduits .....	8
A.1.2    Double side penetration seal with (stainless) steel pipes (insulated CS) .....	10
A.1.3    Double side penetration seal with (stainless) steel (and composite) pipes (insulated Li or Ci) .....	12
A.1.4    Double side penetration seal with combustible pipes .....	15
A.1.5    Penetration seal with (stainless) steel pipes (insulated CS).....	16
<b>A.2     Rigid wall constructions according to I.2.2 with wall thickness of minimum 150 mm.....</b>	<b>18</b>
A.2.1    Single side penetration seal with cables, trays and conduits .....	18
A.2.2    Single side penetration seal with (stainless) steel pipes (insulated CS).....	20
A.2.3    Single side penetration seal with (stainless) steel pipes (insulated Li or Ci) .....	21
A.2.4    Penetration seal with cables, trays and conduits .....	23
A.2.5    Penetration seal with (stainless) steel pipes (insulated CS).....	25
A.2.6    Penetration seal with combustible pipes .....	29
A.2.7    Penetration seal with (stainless) steel pipes (insulated Li or Ci).....	30
A.2.8    Double side penetration seal with cables and trays .....	32
<b>A.3     Rigid floor constructions according to I.2.2 with floor thickness of minimum 150 mm .....</b>	<b>33</b>
A.3.1    Single side penetration seal with cables, trays and conduits.....	33
A.3.2    Single side penetration seal with (stainless) steel pipes (insulated CS).....	34
A.3.3    Single side penetration seal with (stainless) steel pipes (insulated Li or Ci) .....	37
A.3.4    Penetration seal with cables, trays and conduits .....	40
A.3.5    Penetration seal with composite pipes .....	41
A.3.6    Penetration seal with (stainless) steel pipes (insulated Li or Ci) .....	42
A.3.7    Penetration seal with (stainless) steel pipes (insulated CS).....	44
A.3.8    Single side penetration seal with combustible pipes.....	49
A.3.9    Penetration seal with combustible pipes.....	50
A.3.10    Penetration seal with cables and trays .....	53

I. **SPECIFIC PARTS OF THE EUROPEAN TECHNICAL ASSESSMENT**

1 **Technical description of the product**

- 1) MULCOL® MULTIMORTAR is a gypsum based mortar material, used to reinstate the fire resistance performance of wall and floor constructions where they have been provided with apertures for the penetrations of multiple services.
- 2) MULCOL® MULTIMORTAR is supplied as a dry material, and is mixed with water to the required ratio prior to installation.
- 3) MULCOL® MULTIMORTAR when mixed is self-supporting in a wall and floor orientation, and may be used with or without a permanent mineral fibre backing material depending upon the required application and classification (see Annex A).
- 4) MULCOL® MULTIWRAP are required to be used in conjunction with MULCOL® MULTIMORTAR depending upon the required application and classification (see Annex A).
- 5) The applicant has submitted a written declaration that MULCOL® MULTIMORTAR does not contain substances which have to be classified as dangerous according to Directive 67/548/EEC and Regulation (EC) No 1272/2008 and listed in the "Indicative list on dangerous substances" of the EGDS - taking into account the installation conditions of the construction product and the release scenarios resulting from there.

In addition to the specific clauses relating to dangerous substances contained in this European Technical Assessment, there may be other requirements applicable to the products falling within its scope (e.g. transposed European legislation and national laws, regulations and administrative provisions). In order to meet the provisions of the Construction Products Regulation, these requirements need also to be complied with, when and where they apply.

- 6) The use category of MULCOL® MULTIMORTAR in relation to BWR 3 (Hygiene, health and environment) is IA1, S/W3

**2 Specification of the intended uses of the product in accordance with the applicable European Assessment Document (Hereinafter EAD): EAD 350454-00-1104**

Detailed information and data is given in Annex A.

- 1) The intended use of MULCOL® MULTIMORTAR is to reinstate the fire resistance performance of flexible wall, rigid wall and floor constructions where they are penetrated by various cables, trays and metallic, plastic and composite pipes.
- 2) The specific elements of construction that the system MULCOL® MULTIMORTAR may be used to provide a penetration seal in, are as follows:
  - a. Flexible walls: The wall must have a minimum thickness of 100 mm and comprise steel studs or timber studs\* lined on both faces with minimum 2 layers of 12.5 mm thick boards.
  - b. Rigid walls: The wall must have a minimum thickness of 150 mm and comprise concrete, aerated concrete or masonry, with a minimum density of 650 kg/m<sup>3</sup>.
  - c. Rigid floors: The floor must have a minimum thickness of 150 mm and comprise aerated concrete or concrete with a minimum density of 650 kg/m<sup>3</sup>.

\* no part of the penetration seal may be closer than 100 mm to a stud, the cavity must be closed between the penetration seal and the stud, and minimum 100 mm of insulation of class A1 or A2 according to EN 13501-1 must be provided within the cavity between the penetration seal and the stud.

The supporting construction must be classified in accordance with EN 13501-2 for the required fire resistance period.

- 3) The System MULCOL® MULTIMORTAR may be used to provide a penetration seal with cables, cable trays, plastic pipes, composite pipes and metallic pipes with and without insulation (for details see Annex A).
- 4) The system MULCOL® MULTIMORTAR may be used to seal apertures in the separating element up to 2400mm wide by 1200mm high in a wall, and 2400mm by 1200 mm in a floor. The minimum permitted separation between adjacent seals/apertures is 200mm. Services within the system MULCOL® MULTIMORTAR seal do not require a minimum separation, except where specifically detailed in AnnexA.
- 5) Services in floors shall be supported at 250mm and 400mm from the top face. Services in walls shall be supported at 270mm and 470mm from both faces of the wall.
- 6) The provisions made in this European Technical Assessment are based on an assumed working life of the MULCOL® MULTIMORTAR of 30 years, provided that the conditions laid down in the product data sheet regarding packaging/transport/ storage/installation/use/repair are met. The indications given on the working life cannot be interpreted as a guarantee given by the producer or the Technical Assessment Body but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.
- 7) Type Z<sub>2</sub>: Intended for uses in internal conditions with humidity lower than 85 % RH excluding temperatures below 0°C, without exposure to rain or UV.

### **3 Performance of the product and references to the methods used for its assessment**

Product-type: Mortar		Intended use: Penetration Seal
	Basic Requirement	Performance
<b>BWR 1 Mechanical resistance and stability</b>		
	None	Not relevant
<b>BWR 2 Safety in case of fire</b>		
	Reaction to fire	Class 'A1'
	Resistance to fire	Annex A
<b>BWR 3 Hygiene, health and environment</b>		
	Air permeability (material property)	No performance assessed
	Water permeability (material property)	No performance assessed
	Release of dangerous substances	Use categories: IA1, S/W3 Declaration of manufacturer
<b>BWR 4 Safety in use</b>		
	Mechanical resistance and stability	Suitable for use in walls and floors in Zone Types I, II, III & IV
	Resistance to impact/movement	
	Adhesion	
<b>BWR 5 Protection against noise</b>		
	Airborne sound insulation	No performance assessed
<b>BWR 6 Energy economy and heat retention</b>		
	Thermal properties	No performance assessed
	Water vapour permeability	No performance assessed
<b>General aspects relating to fitness for use</b>		
	Durability and serviceability	Z <sub>2</sub>

**4 ASSESSMENT AND VERIFICATION OF CONSTANCY OF PERFORMANCE (HEREINAFTER AVCP) SYSTEM APPLIED, WITH REFERENCE TO ITS LEGAL BASE**


According to the decision 1999/454/EC – Commission Decision of date 22nd June 1999 on the procedure for attesting the conformity of construction products pursuant to Article 20(2) of Council Directive 89/106/EEC as regards fire stopping, fire sealing and fire protective products, published in the Official Journal of the European Union (OJEU) L178/52 of 14/07/1999, see <http://eur-lex.europa.eu/JOLIndex.do>) of the European Commission<sup>1</sup>, as amended, the system(s) of assessment and verification of constancy of performance (see Annex V to Regulation (EU) No 305/2011) given in the following table(s) applies (apply).

Product(s)	Intended use(s)	Level(s) or class(es)	System(s)
Fire stopping and Fire Sealing Products	For fire compartmentation and/or fire protection or fire performance	Any	1

**5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD**

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at ETA-Danmark A/S prior to CE marking

Issued in Copenhagen on 2021-01-01 by

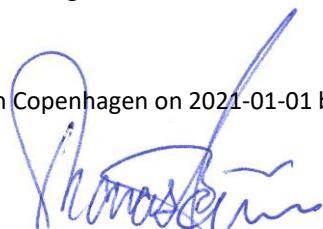

Thomas Bruun

Managing Director, ETA-Danmark

---

<sup>1</sup> Official Journal of the European Communities L178/52 of 14/7/1999

# Annex A - Resistance to fire classification - Mulcol® Multimortar


Fire test cable penetration seal

Mulcol® Multimortar

Rigid/Flexible wall construction according to I.2.2

**MULCOL**

**FIRE PROTECTION**



Scale : 1:5

Unit of measure : mm

Date : 19-5-2016


Company : Mulcol International B.V.

FW-CT-MM1.4.10

Department : Research & Development

A4

Draftsman : R.M.

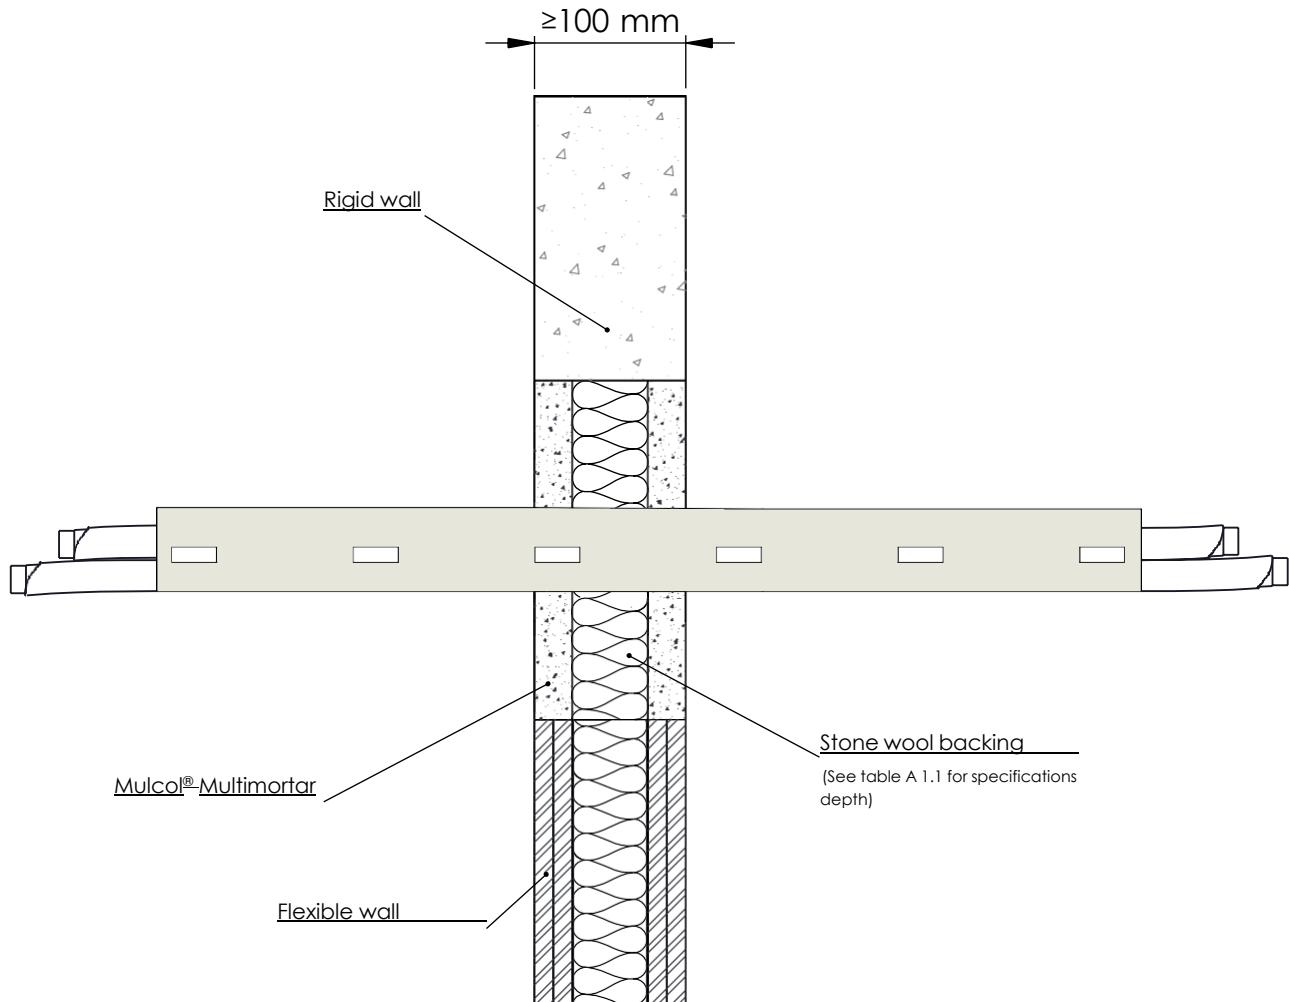

## A 1.1 Double side penetration seal with cables, trays and conduits

Services	Classification	Position Mulcol® Multimortar	Backing	Maximum seal	Position services
Blank seals	EI 120				
Electrical cables up to Ø 21 mm (min. 100 separation from other services)	E 120, EI 90				
Electrical cables up to Ø 80 mm (single, bundled and on trays)	E 120, EI 60	Both sides of the wall 25 mm thick	50 mm Stone wool insulation, 150 kg/m³	2400 x 1200 mm	Service fitted at any position within the aperture (min. separation 25 mm from seal edges and 100 mm from other services)
Telecommunication cables up to Ø 21 mm (single or bundles up to Ø 100mm)					
Steel cable trays and ladders (perforated or none perforated)					
Non-sheathed wires up to Ø 24 mm	E 120, EI 45				
PVC conduit up to Ø 16 mm	EI 120 C/U				

# Annex A - Resistance to fire classification - Mulcol® Multimortar


Fire test cable penetration seal

Mulcol® Multimortar

Rigid/Flexible wall construction according to I.2.2

**MULCOL**

FIRE PROTECTION



Scale : 1:5

Unit of measure : mm

Date : 6-4-2016


Company : Mulcol International B.V.

FW-PP-MM1.4.10

Department : Research & Development

Draftsman : R.M.

A4

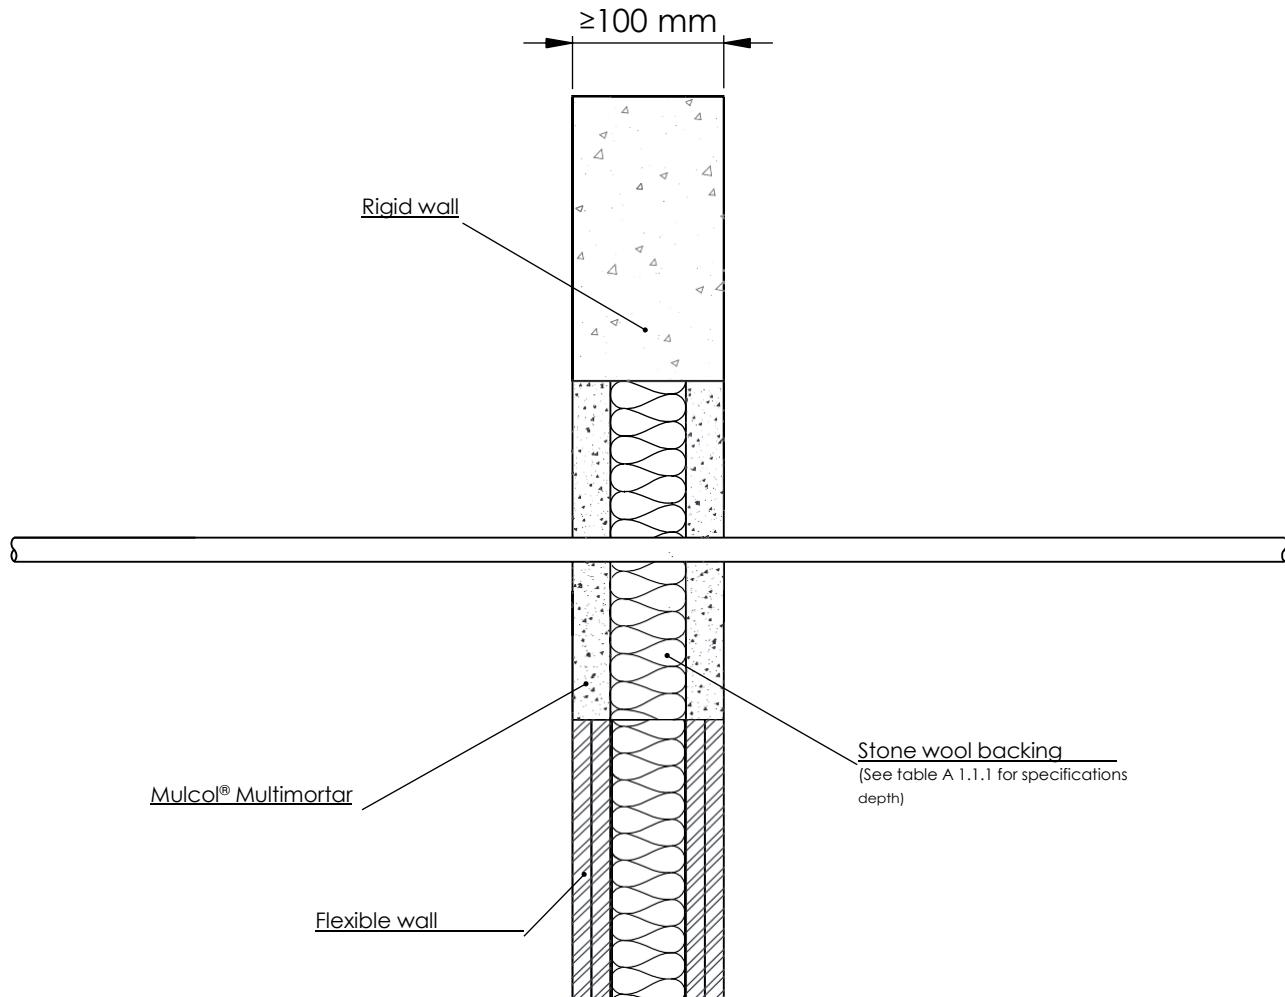

## A 1.1.1 Double side penetration seal with copper and steel conduits

Services	Classification	Position Mulcol® Multimortar	Backing	Maximum seal	Position services
Steel conduit up to $\varnothing 16 \text{ mm}$	E 120 C/U, EI 60 C/U	Both sides of the wall 25 mm thick	50 mm Stone wool insulation, 150 kg/m <sup>3</sup>	2400 x 1200 mm	Service fitted at any position within the aperture (min. separation 25 mm from seal edges and 100 mm from other services)
Copper conduit up to $\varnothing 16 \text{ mm}$	E 120 C/U, EI 45 C/U				

# Annex A - Resistance to fire classification - Mulcol® Multimortar


Fire test pipe penetration seal

Mulcol® Multimortar

Rigid/Flexible wall construction according to I.2.2

**MULCOL**

FIRE PROTECTION



Scale : 1:5

Unit of measure : mm

Date : 6-4-2016


Company : Mulcol International B.V.

FW-ST-MM1.4.20

Department : Research & Development

Draftsman : R.M.

A4

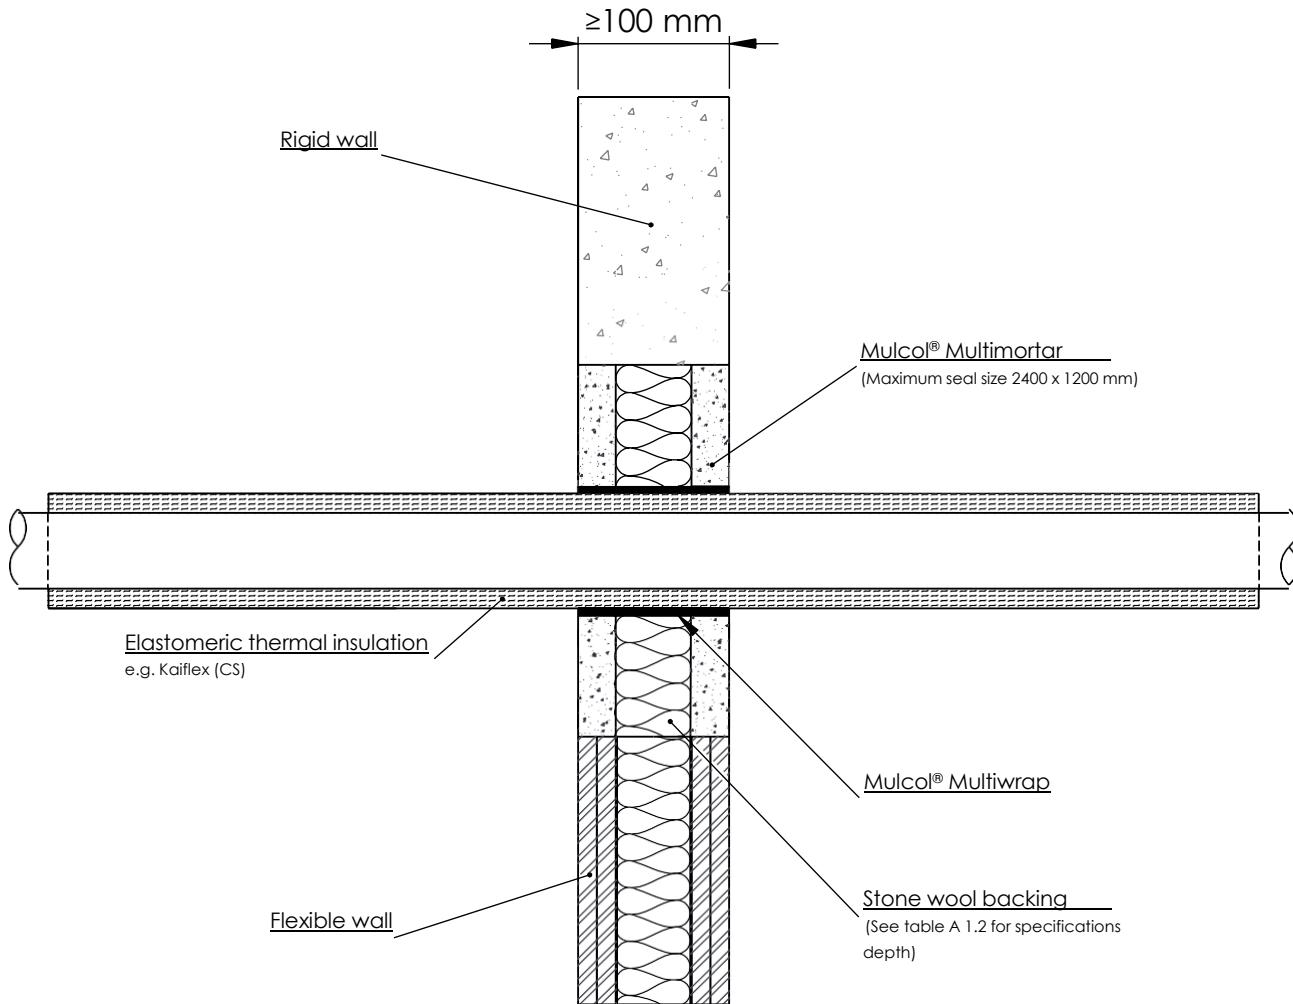


## A 1.2 Double side penetration seal with (stainless) steel pipes


Services	Classification	Position Mulcol® Multimortar	Insulation	Mulcol® Multiwrap	Position services
Steel pipe Ø 40 mm / 1-14.2 mm wall th.	EI 120 C/U	Both sides of the wall 25 mm thick backed with 50 mm stone wool insulation, 150 kg/m³	13 mm Kaiflex ST insulation	50 x 1.8 mm (1 layer) one fitted flush to each face of seal	Service fitted at any position within the aperture (min. separation 30 mm from seal edges and 0 mm from other services)
Steel pipe Ø 40 mm / 1-14.2 mm wall th.					
Steel pipe Ø 50 mm / 1.3-14.2 mm wall th.					
Steel pipe Ø 60 mm / 1.6-14.2 mm wall th.					
Steel pipe Ø 75 mm / 2.-14.2 mm wall th.					
Steel pipe Ø 90 mm / 2.4-14.2 mm wall th.					
Steel pipe Ø 100 mm / 2.7-14.2 mm wall th.					
Steel pipe Ø 115 mm / 3.1-14.2 mm wall th.					
Steel pipe Ø 140 mm / 3.8-14.2 mm wall th.					
Steel pipe Ø 165 mm / 4.5-14.2 mm wall th.					

See graph on page 11 for intermediate sizes

# Annex A - Resistance to fire classification - Mulcol® Multimortar

Fire test pipe penetration seal Mulcol® Multimortar Rigid/Flexible wall construction according to I.2.2		 <b>MULCOL</b> <b>FIRE PROTECTION</b>	
American projection 	Scale : 1:5	Company : Mulcol International B.V.	FW-ST-MM1.2.20
	Unit of measure : mm	Department : Research & Development	
	Date : 6-4-2016	Draftsman : R.M.	A4

**Intermediate sizes**

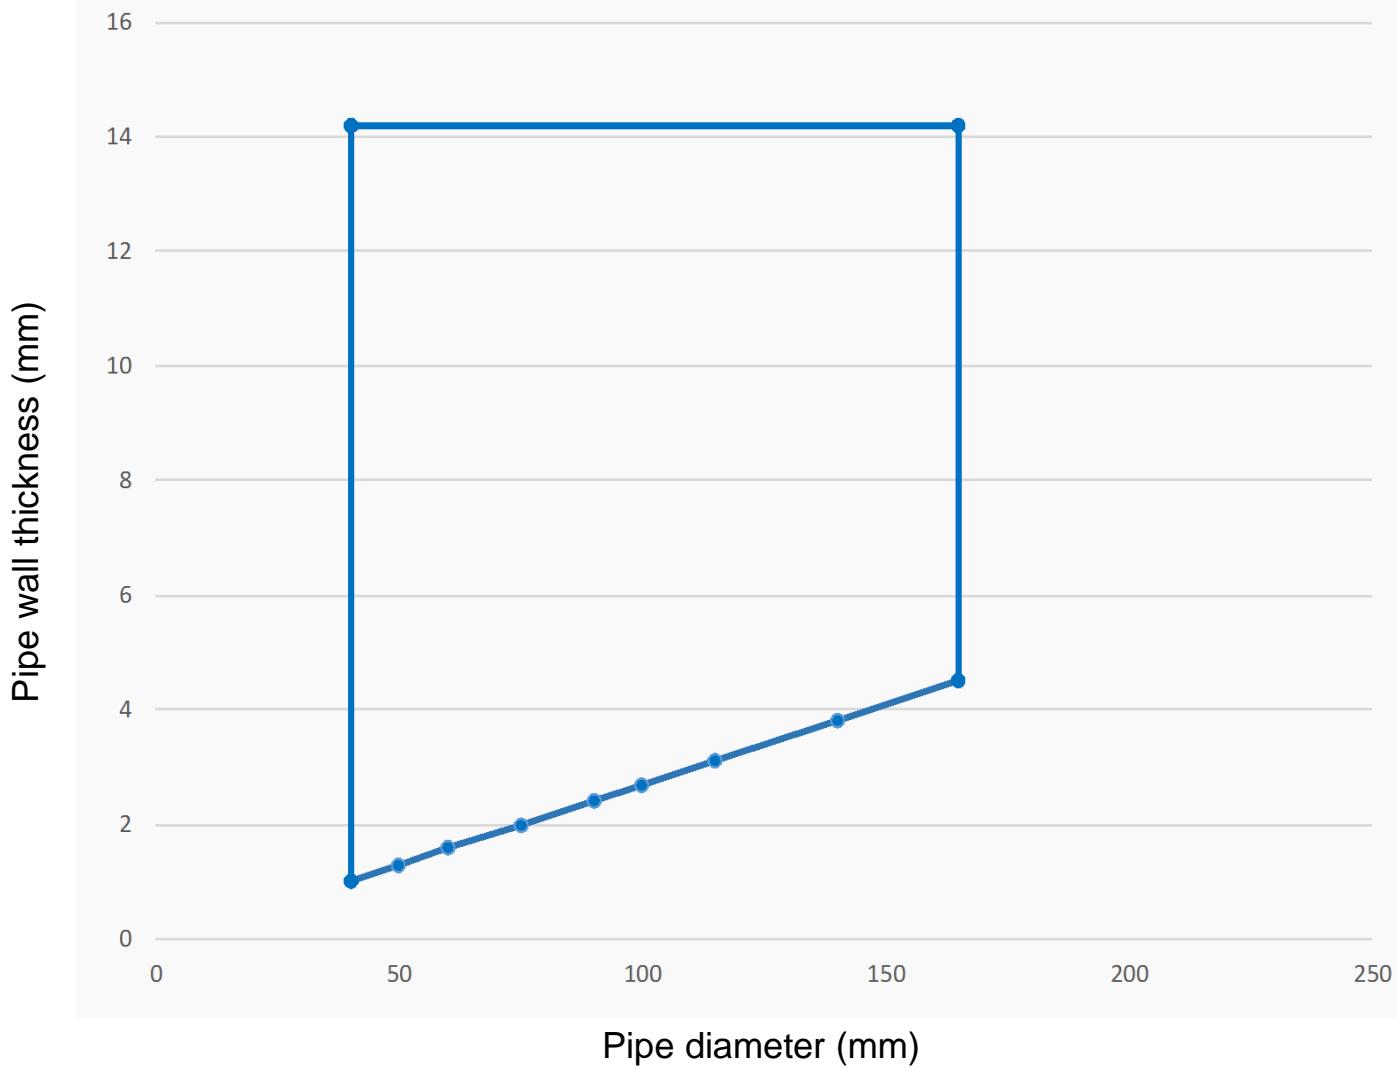

# Annex A - Resistance to fire classification - Mulcol® Multimortar


Fire test pipe penetration seal

Mulcol® Multimortar

Rigid/Flexible wall construction according to I.2.2

**MULCOL**

FIRE PROTECTION



Scale : 1:5

Unit of measure : mm

Date : 6-4-2016


Company : Mulcol International B.V.

Department : Research & Development

Draftsman : R.M.

FW-MLA-MM1.4.20

A4

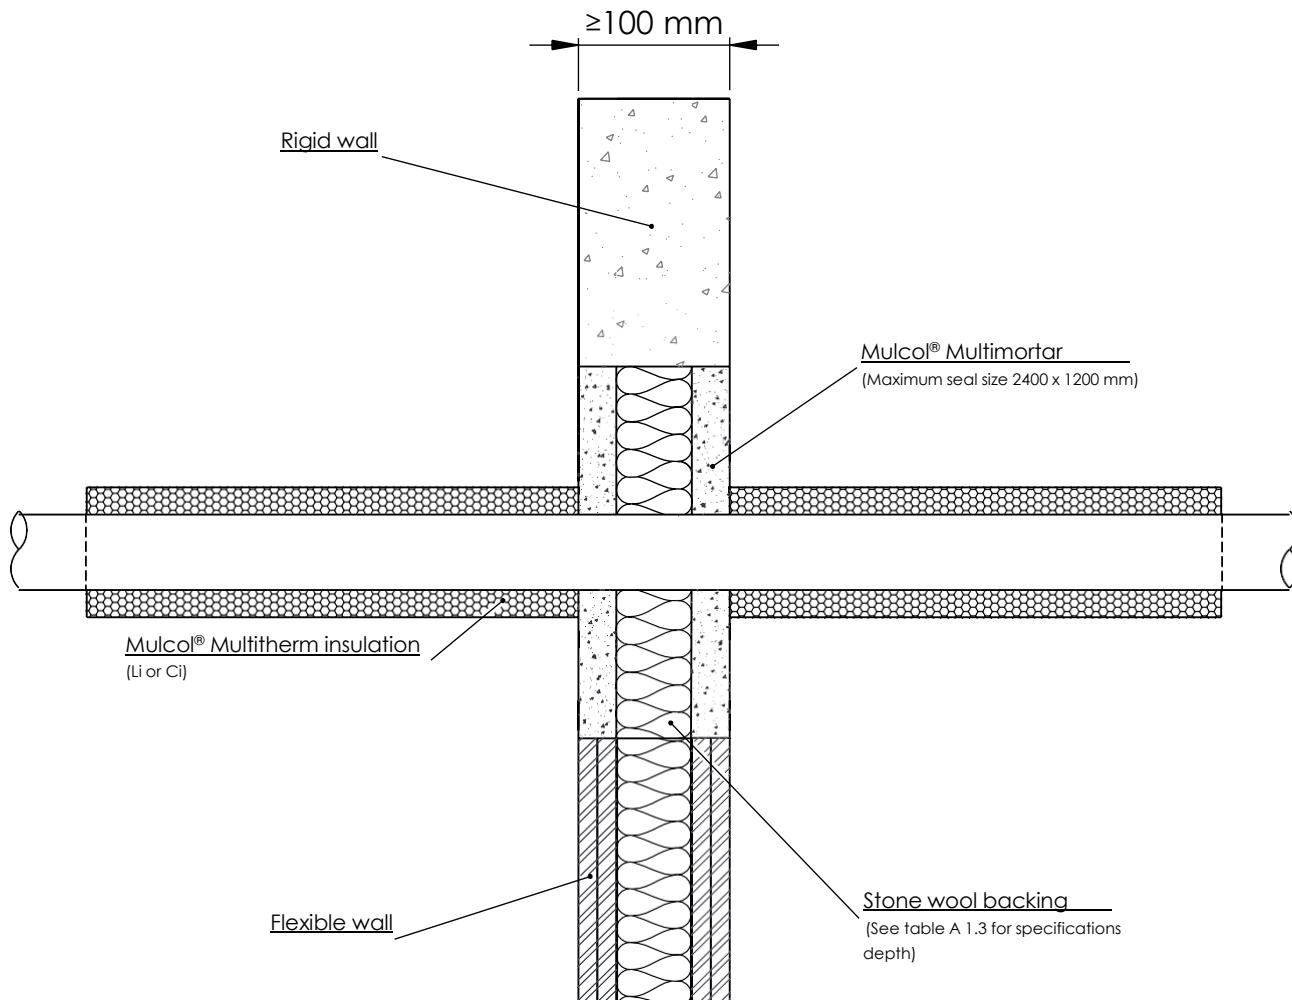

## A 1.3 Double side penetration seal with composite pipes

Services	Classification	Position Mulcol® Multimortar	Backing	Insulation	Position services
Alupex composite pipe Ø 75 mm / 7.5 mm wall th.	EI 60 U/U, EI 60 C/U, EI 60 U/C	To both sides of the wall 25mm thick	50 mm Stone wool insulation, 150 kg/m³	600 mm length of 25 mm Mulcol® multitherm insulation, 80 kg/m³	Service fitted at any position within the aperture (min. separation 40 mm from seal edges and 100 mm from other services)

# Annex A - Resistance to fire classification - Mulcol® Multimortar


Fire test pipe penetration seal

Mulcol® Multimortar

Rigid/Flexible wall construction according to I.2.2

**MULCOL**

FIRE PROTECTION



Scale : 1:5

Unit of measure : mm


Date : 6-4-2016

Company : Mulcol International B.V.

FW-ST-MM1.4.20

Department : Research & Development

A4

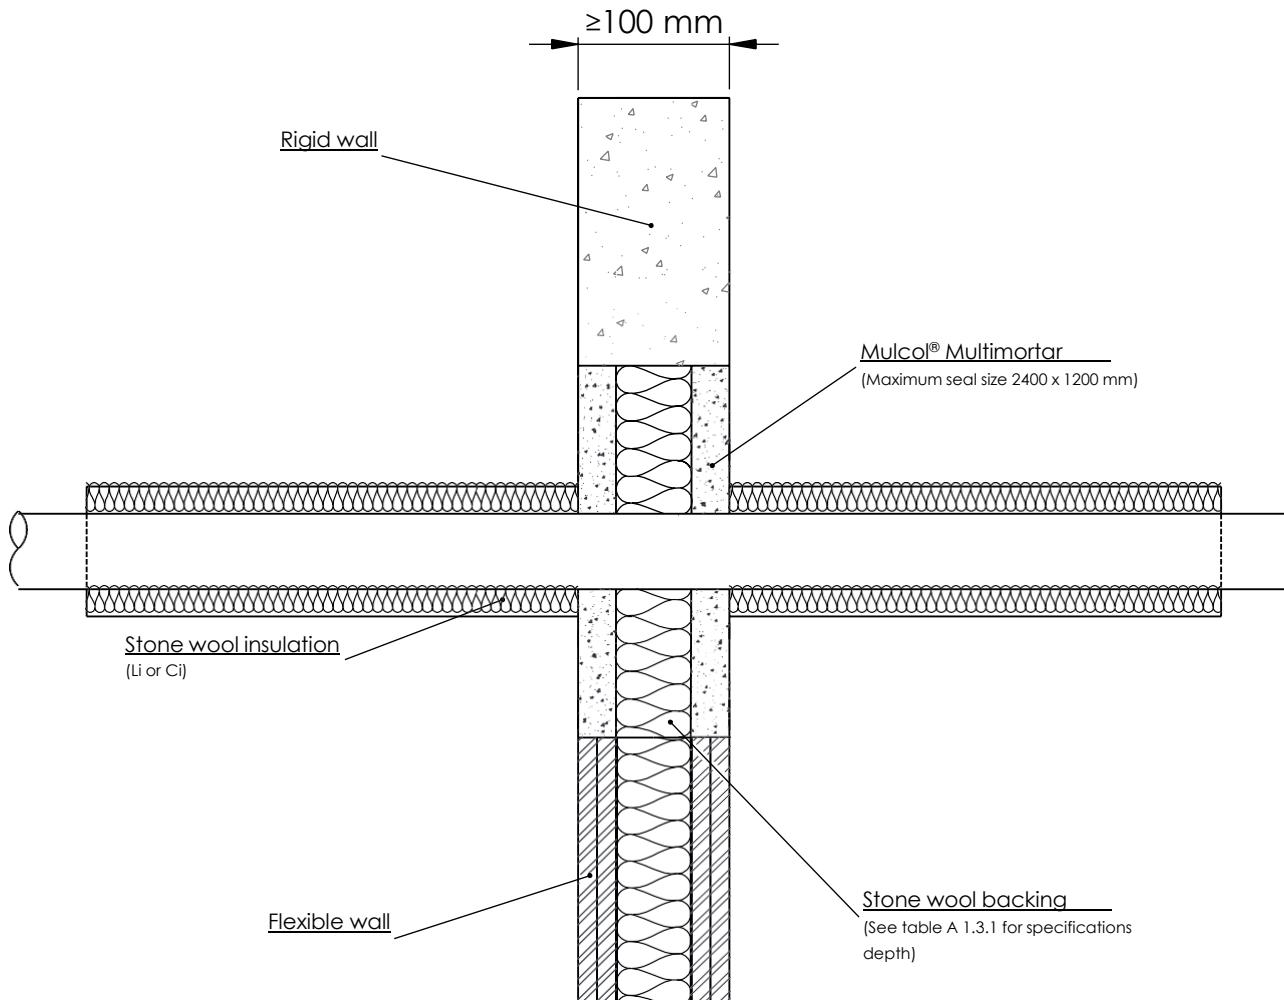

## A 1.3.1 Double side penetration seal with (stainless) steel pipes

Services	Classification	Position Mulcol® Multimortar	Backing	Insulation	Position services
Steel pipe Ø 40 mm / 1-14.2 mm wall th.	EI 120 C/U			500 mm length of 20 mm Stone wool insulation, 80 kg/m³	
Steel pipe Ø 40 mm / 1-14.2 mm wall th.					
Steel pipe Ø 50 mm / 1.2-14.2 mm wall th.					
Steel pipe Ø 60 mm / 1.4-14.2 mm wall th.					
Steel pipe Ø 75 mm / 1.7-14.2 mm wall th.					
Steel pipe Ø 90 mm / 2-14.2 mm wall th.					
Steel pipe Ø 100 mm / 2.2-14.2 mm wall th.					
Steel pipe Ø 115 mm / 2.5-14.2 mm wall th.					
Steel pipe Ø 140 mm / 3-14.2 mm wall th.					
Steel pipe Ø 165 mm / 3.5-14.2 mm wall th.					
Steel pipe Ø 180 mm / 3.8-14.2 mm wall th.					
Steel pipe Ø 200 mm / 4.2-14.2 mm wall th.					
Steel pipe Ø 219 mm / 4.5-14.2 mm wall th.					
See graph on page 14 for intermediate sizes					

# Annex A - Resistance to fire classification - Mulcol® Multimortar


Fire test pipe penetration seal

Mulcol® Multimastic FB2

Rigid/Flexible wall construction according to I.2.2

**MULCOL**

FIRE PROTECTION



Scale : 1:5

Unit of measure : mm

Date : 6-4-2016

Company : Mulcol International B.V.


Department : Research & Development

Draftsman : R.M.

FW-ST-MM1.4.20

A4

**Intermediate sizes**

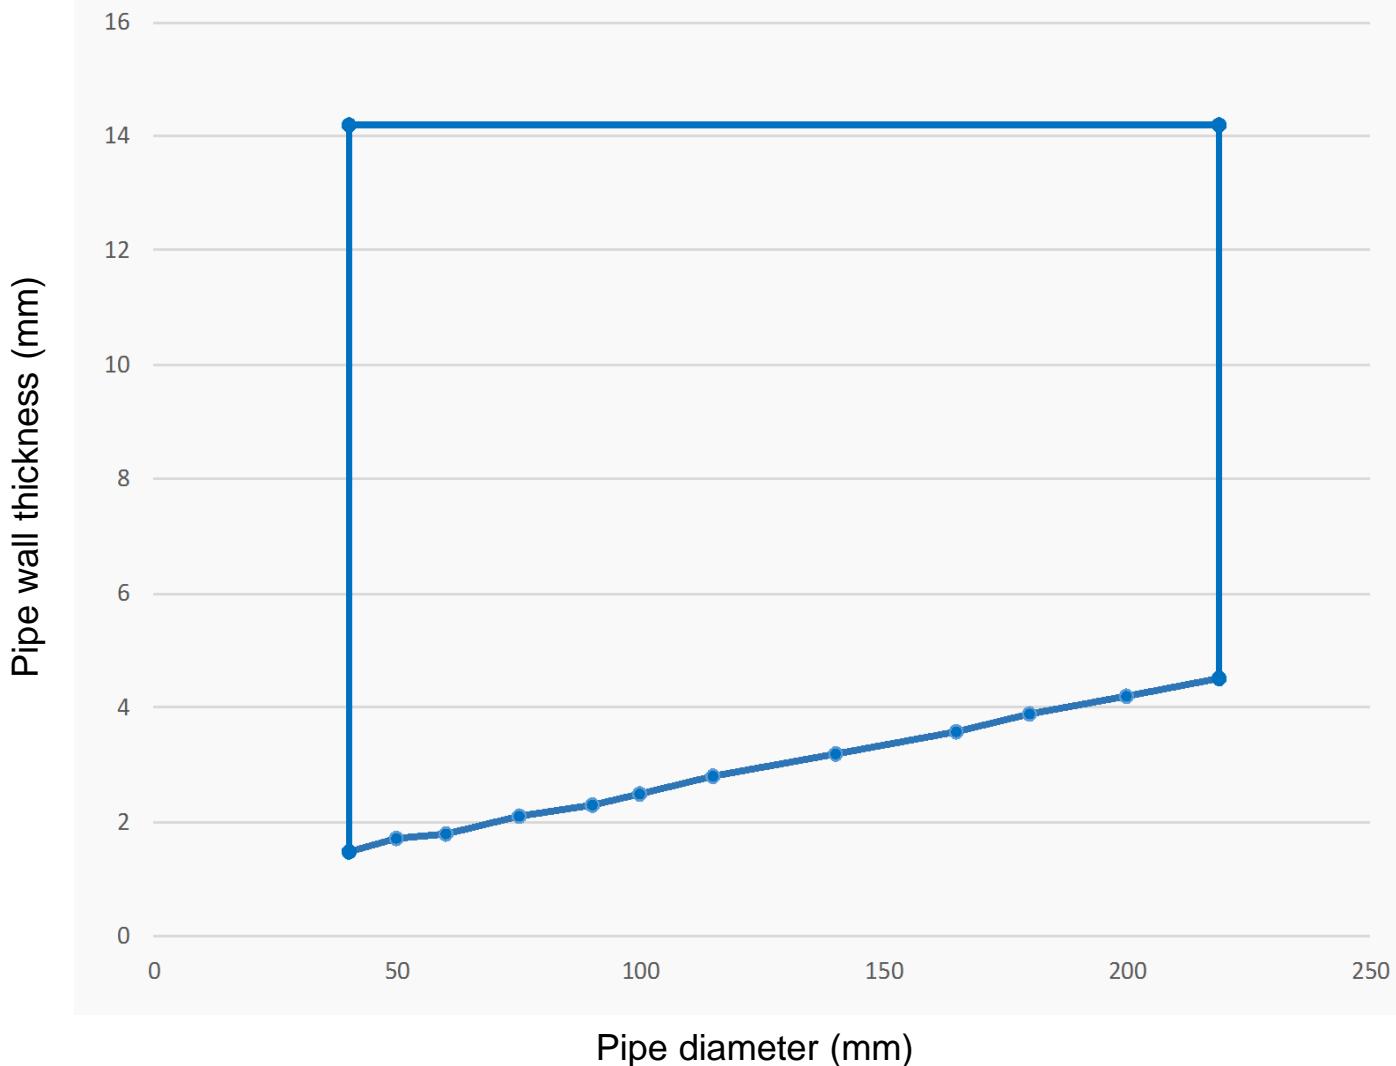

# Annex A - Resistance to fire classification - Mulcol® Multimortar


Fire test pipe penetration seal

Mulcol® Multimortar

Rigid/Flexible wall construction according tot I.2.2

**MULCOL**

FIRE PROTECTION



Scale : 1:5

Unit of measure : mm

Date : 6-4-2016

Company : Mulcol International B.V.


FW-ST-MM2.2.20

Department : Research & Development

Draftsman : R.M.


A4

Option 1

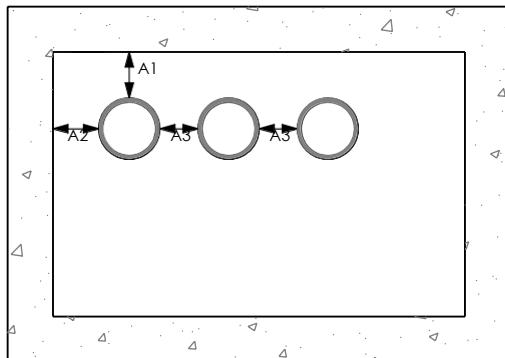


A1 : Pipe / top edge of seal separation min. 30 mm  
A2 : Pipe / side edge of seal separation min. 30 mm  
A3 : Pipe / pipe separation min. 30 mm

$\geq 100 \text{ mm}$

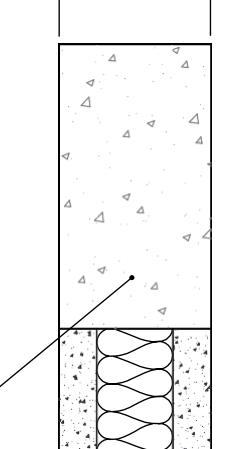

Option 2

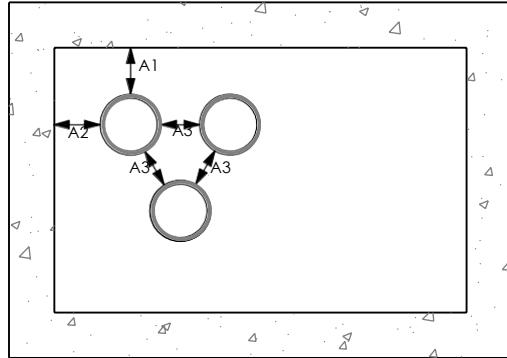


A1 : Pipe / top edge of seal separation min. 30 mm  
A2 : Pipe / side edge of seal separation min. 30 mm  
A3 : Pipe / pipe separation min. 30 mm



Mulcol® Multimortar

Stone wool backing  
(See table A.1.4 for specifications depth)

Flexible wall

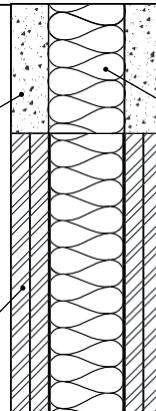

## A 1.4 Double side penetration seal with combustible pipes

Services	Classification	Position Mulcol® Multimortar	Maximum seal	Configuration
<b>PVC-U pipe according to EN 1329-1, EN 1452 and EN 1453-1**, PVC-C according to EN 1566-1</b>				
up to $\varnothing$ 32 mm / 1.6 - 2.4 mm wall th.	EI 120 U/C	Both sides of the wall 25 mm thick backed with 50 mm stone wool insulation, 140 kg/m <sup>3</sup>	2400 x 1200 mm	1 & 2 between all specified pipes
<b>PE ( PE-HD) pipe according to EN 1519-1, EN 12201-2 and EN 12006-1*, ABS according to EN 1455-1 and pipes made from SAN+PVC according to EN 1565-1</b>				
up to $\varnothing$ 32 mm / 1.8 - 3.0 mm wall th.	EI 120 U/C	Both sides of the wall 25 mm thick backed with 50 mm stone wool insulation, 140 kg/m <sup>3</sup>	2400 x 1200 mm	1 & 2 between all specified pipes
<b>PP pipe according to EN 1852-1: 2009</b>				
up to $\varnothing$ 32 mm / 1.9 - 4.4 mm wall th.	EI 120 U/C	Both sides of the wall 25 mm thick backed with 50 mm stone wool insulation, 140 kg/m <sup>3</sup>	2400 x 1200 mm	1 & 2 between all specified pipes

\* In Germany the pipes have additionally to comply with DIN 19535-10  
\*\* In Germany the pipes have additionally to comply with DIN 19531-10

# Annex A - Resistance to fire classification - Mulcol® Multimortar


Fire test cable penetration seal

Mulcol® Multimortar

Rigid/Flexible wall construction according to I.2.2

**MULCOL**

**FIRE PROTECTION**



Scale : 1:5

Unit of measure : mm

Date : 6-4-2016


Company : Mulcol International B.V.

FW-ST-MM2.2.20

Department : Research & Development

A4

Draftsman : R.M.

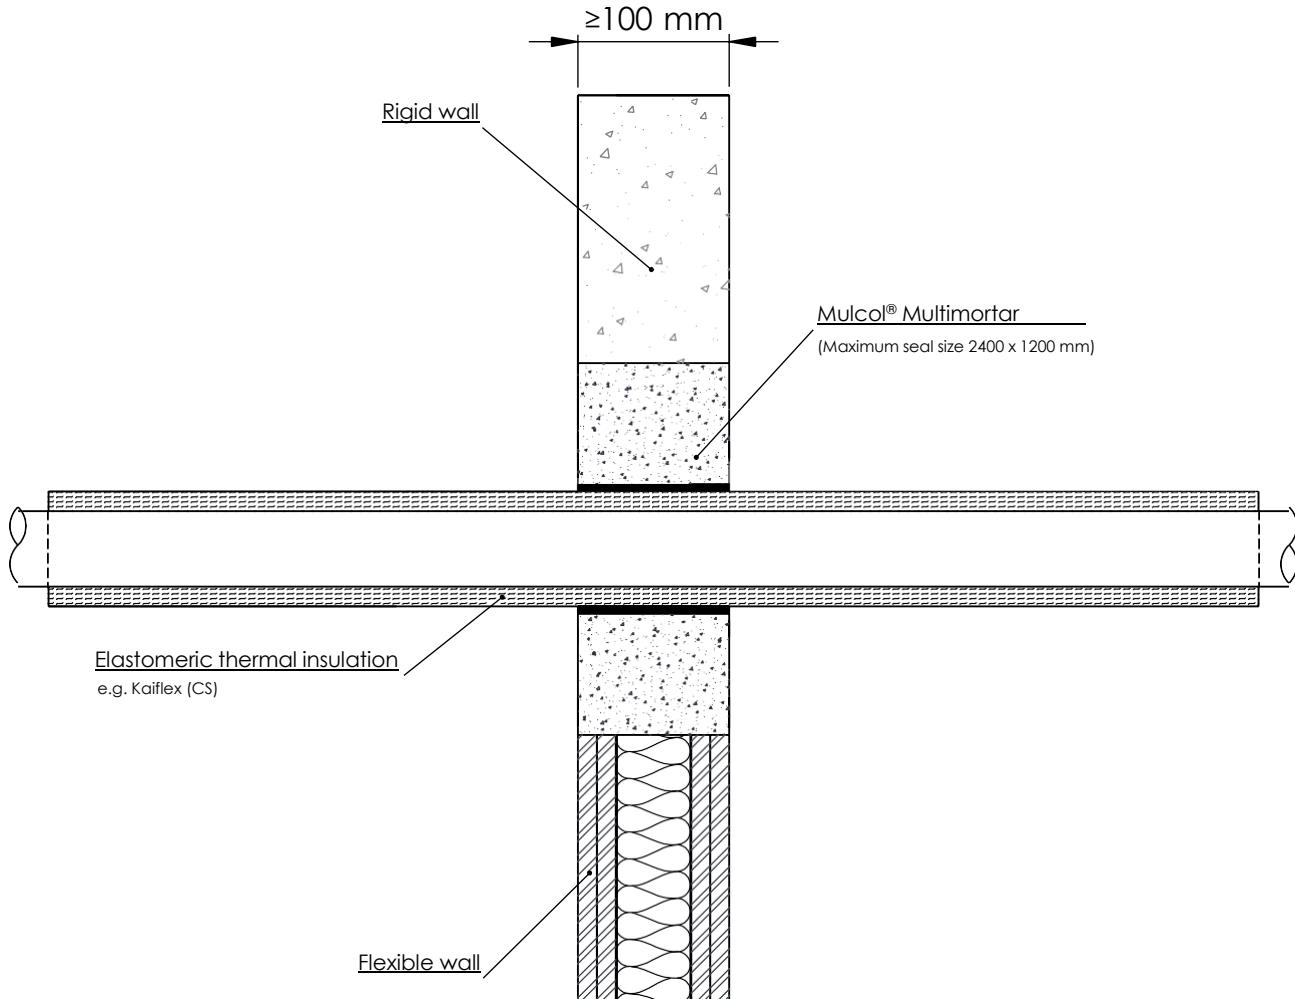

## A 1.5 Penetration seal with (stainless) steel pipes

Services	Classification	Position Mulcol® Multimortar	Insulation	Mulcol® Multiwrap	Position services
Steel pipe Ø 40 mm / 1-14.2 mm wall th.	E 120 C/U, EI 60 C/U	Entire wall thickness 100 mm	13-32 mm KKaiflex ST insulation	50 x 3.6 mm (2 layers) one fitted flush to each face of seal	Service fitted at any position within the aperture (min. separation 30 mm from seal edges and 0 mm from other services)
Steel pipe Ø 50 mm / 1.3-14.2 mm wall th.					
Steel pipe Ø 60 mm / 1.6-14.2 mm wall th.					
Steel pipe Ø 75 mm / 2.-14.2 mm wall th.					
Steel pipe Ø 90 mm / 2.4-14.2 mm wall th.					
Steel pipe Ø 100 mm / 2.7-14.2 mm wall th.					
Steel pipe Ø 115 mm / 3.1-14.2 mm wall th.					
Steel pipe Ø 140 mm / 3.8-14.2 mm wall th.					
Steel pipe Ø 165 mm / 4.5-14.2 mm wall th.					

See graph on page 17 for intermediate sizes

# Annex A - Resistance to fire classification - Mulcol® Multimortar


Fire test pipe penetration seal

Mulcol® Multimastic FB2

Rigid/Flexible wall construction according to I.2.2

**MULCOL**

FIRE PROTECTION



Scale : 1:5

Unit of measure : mm

Date : 6-4-2016

Company : Mulcol International B.V.


FW-ST-MFB2.2.20

Department : Research & Development

Draftsman : R.M.

A4

## Intermediate sizes

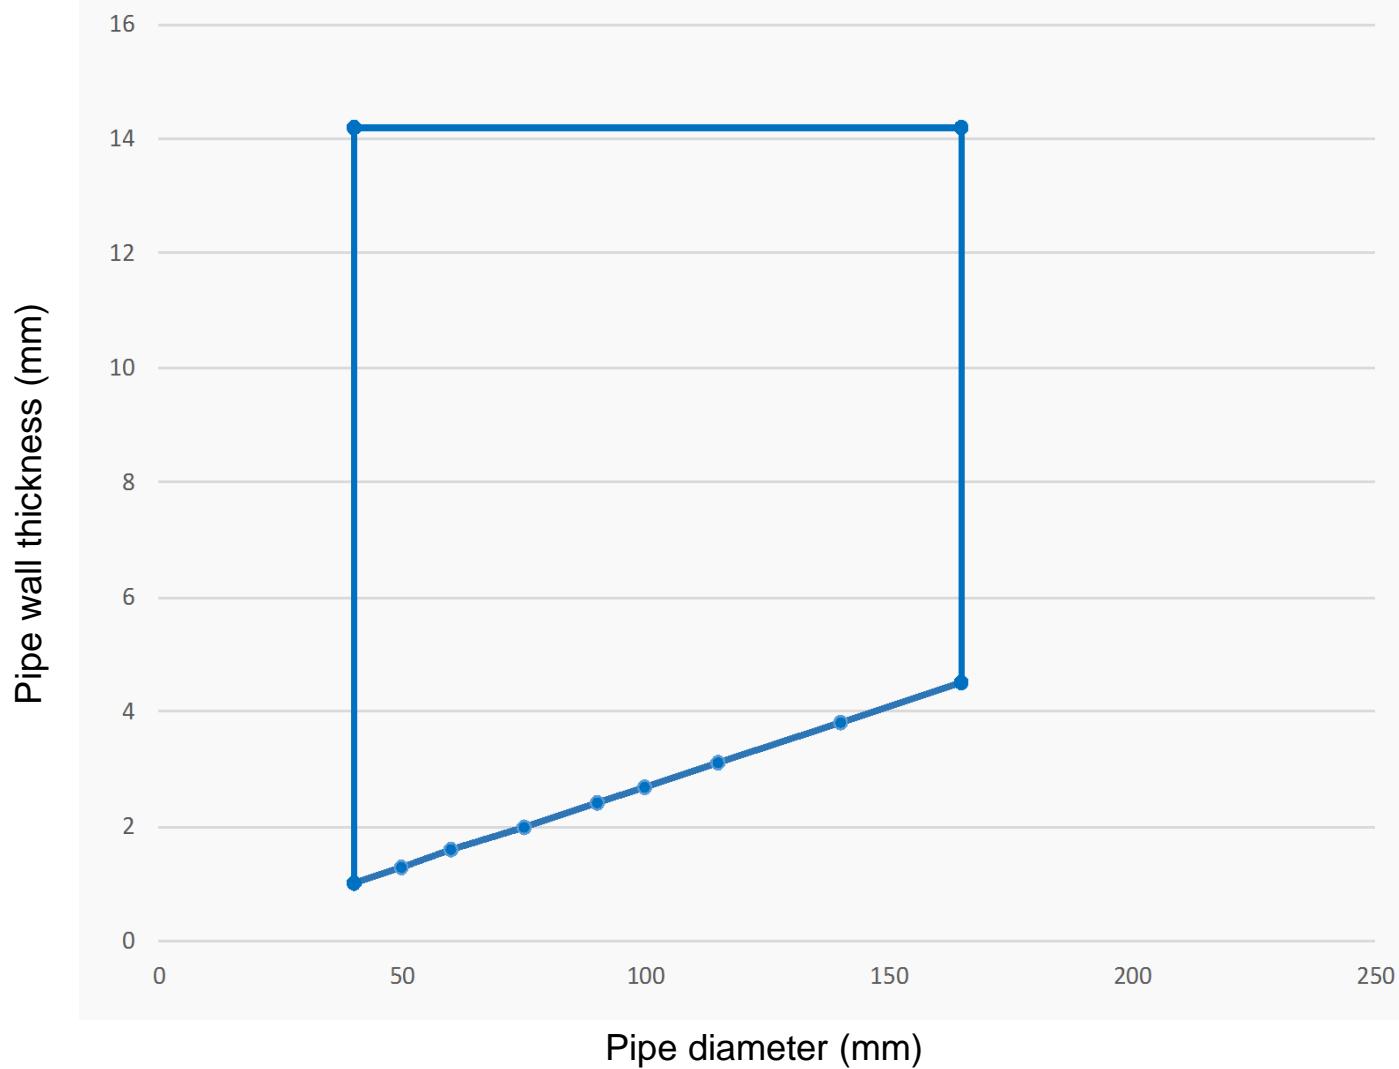

# Annex A - Resistance to fire classification - Mulcol® Multimortar


Fire test cable penetration seal

Mulcol® Multimortar

Rigid wall construction according to I.2.2

**MULCOL**

FIRE PROTECTION



Scale : 1:5

Unit of measure : mm

Date : 6-4-2016


Company : Mulcol International B.V.

RW-EC-MM1.5.10

Department : Research & Development

A4

Draftsman : R.M.

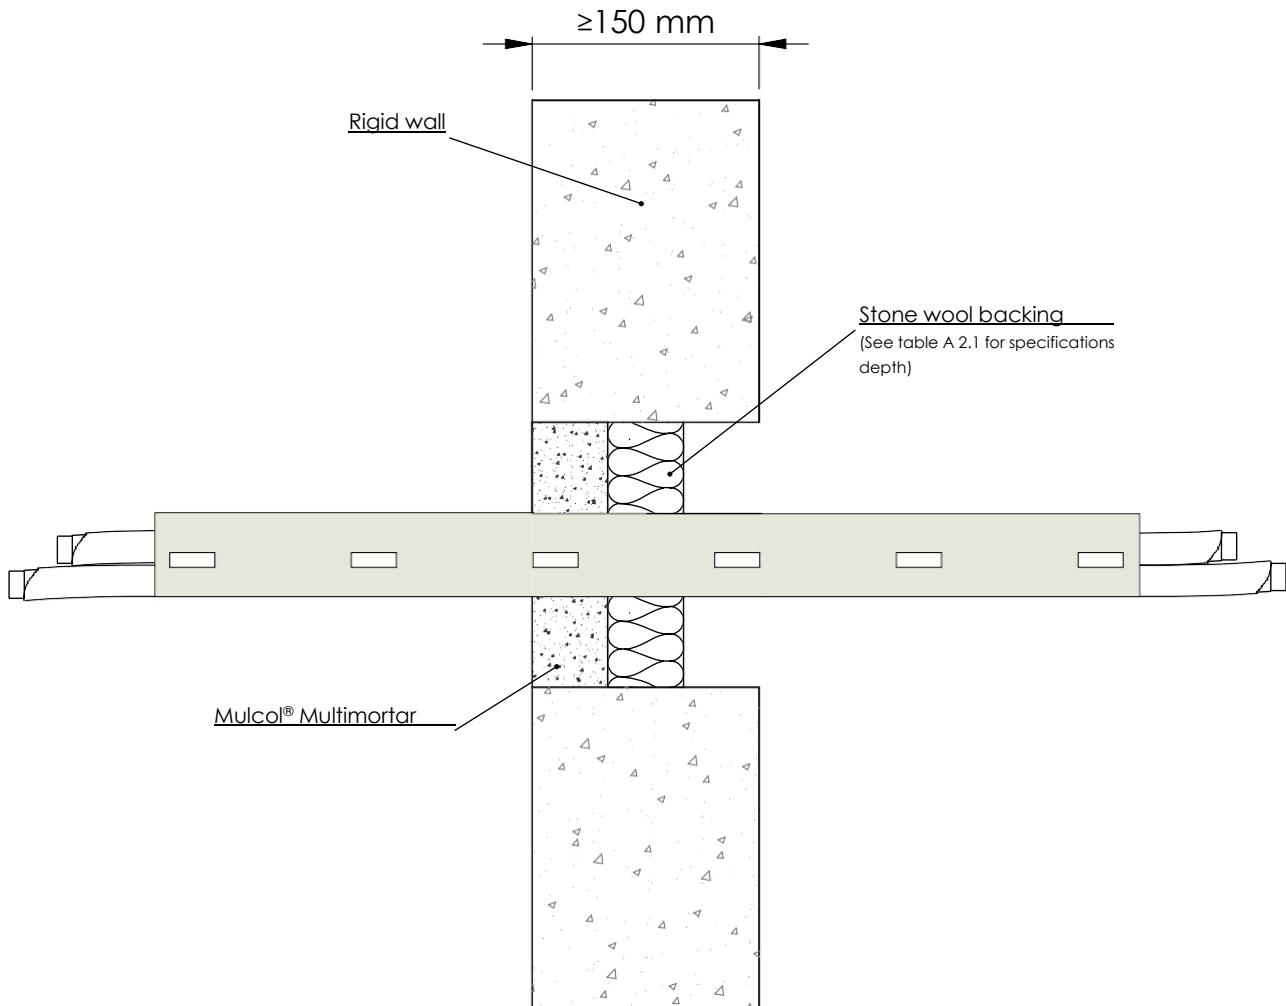

## A 2.1 Single side penetration seal with cables, trays and conduits

Services	Classification	Position Mulcol® Multimortar	Backing	Maximum seal	Position Services
Blank seals	E 180, EI 120	Either side of the wall (or anywhere in between) 50 mm thick	50 mm Stone wool insulation, 150 kg/m³	2400 x 1200 mm	Service fitted at any position within the aperture (min. separation 25 mm from seal edges and 0 mm from other services)
Single electrical cables up to Ø 21 mm	E 180, EI 60			80 x 80 mm	
Single electrical cables up to Ø 21 mm	E 240, EI 60				
Electrical cables up to Ø 21 mm (single, bundled and on trays)	E 180, EI 60				
Electrical cables up to Ø 50 mm (single, bundled and on trays)	E 180, EI 45				
Electrical cables up to Ø 80 mm (single, bundled and on trays)	E 120, EI 45				
Telecommunication cables up to Ø 21 mm (single or bundles up to Ø 100mm)	E 180, EI 90			2400 x 1200 mm	
Steel cable trays & ladders (perforated and none-perforated)	E 180, EI 60				
None-Sheathed wires up to Ø 17 mm	E 180, EI 45				
None-Sheathed wires up to Ø 24 mm	E 180 , EI 30				
PVC conduit up to Ø 16 mm	E 180 C/U, EI 60 C/U				

# Annex A - Resistance to fire classification - Mulcol® Multimortar


Fire test cable penetration seal

Mulcol® Multimortar

Rigid wall construction according to I.2.2

**MULCOL**

FIRE PROTECTION



Scale : 1:5

Unit of measure : mm

Date : 6-4-2016


Company : Mulcol International B.V.

RW-EC-MM1.5.10

Department : Research & Development

A4

Draftsman : R.M.

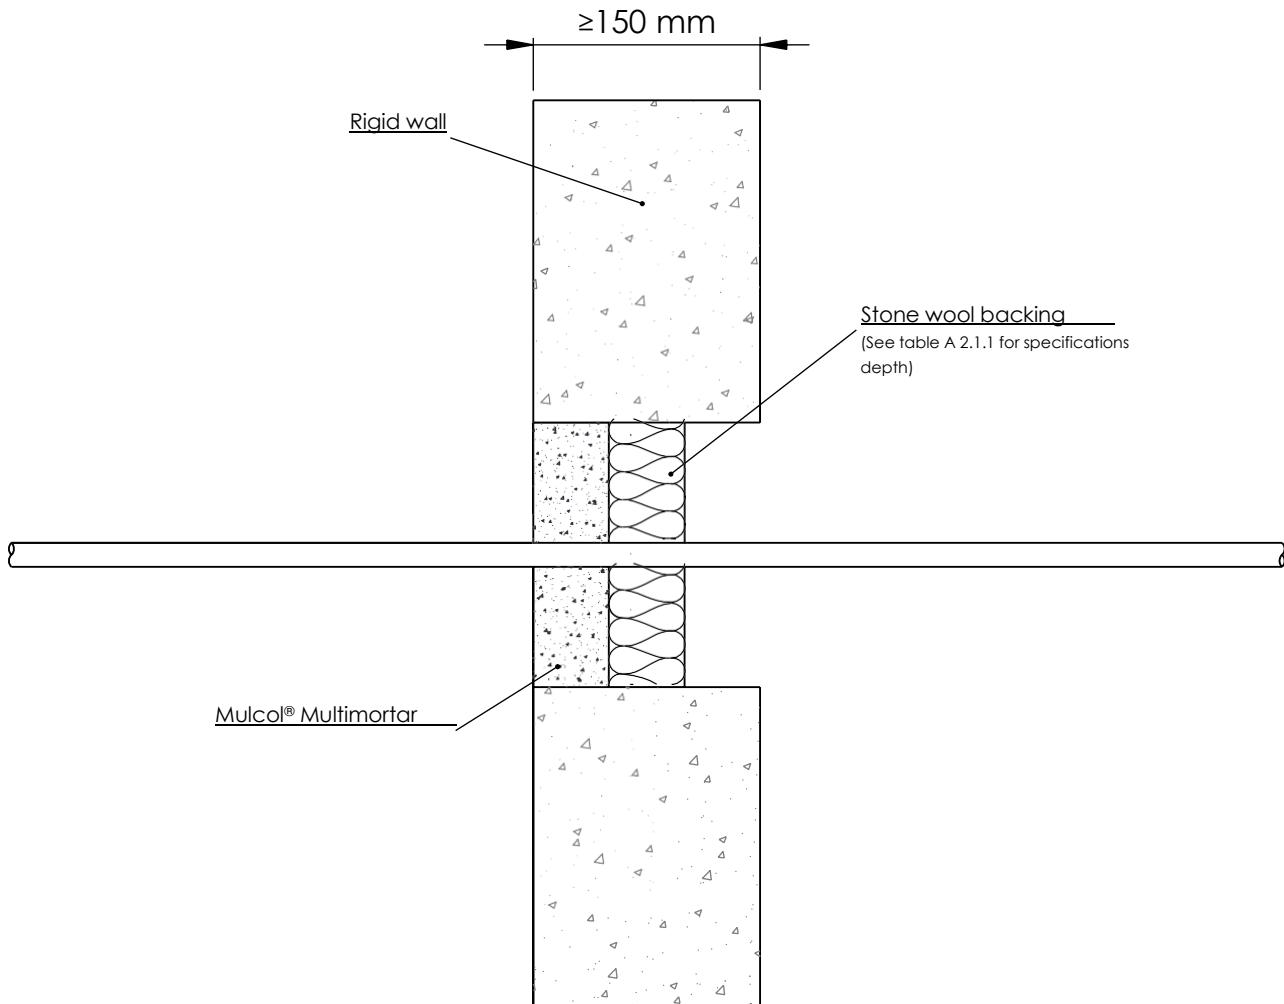

## A 2.1.1 Single side penetration seal with copper and steel conduits

Services	Classification	Position Mulcol® Multimortar	Backing	Maximum seal	Position Services
Copper conduit up to Ø 16 mm	E 180 C/U, EI 30 C/U	Either side of the wall (or anywhere in between) 50 mm thick	50 mm Stone wool insulation, 150 kg/m³	2400 x 1200 mm	Service fitted at any position within the aperture (min. separation 25 mm from seal edges and 0 mm from other services)
Steel conduit up to Ø 16 mm	E 180 C/U, EI 60 C/U				

# Annex A - Resistance to fire classification - Mulcol® Multimortar


Fire test cable penetration seal

Mulcol® Multimortar

Rigid floor construction according to I.2.2

**MULCOL**

FIRE PROTECTION



Scale : 1:5

Unit of measure : mm

Date : 6-4-2016


Company : Mulcol International B.V.

RW-ST-MM1.5.20

Department : Research & Development

A4

Draftsman : R.M.

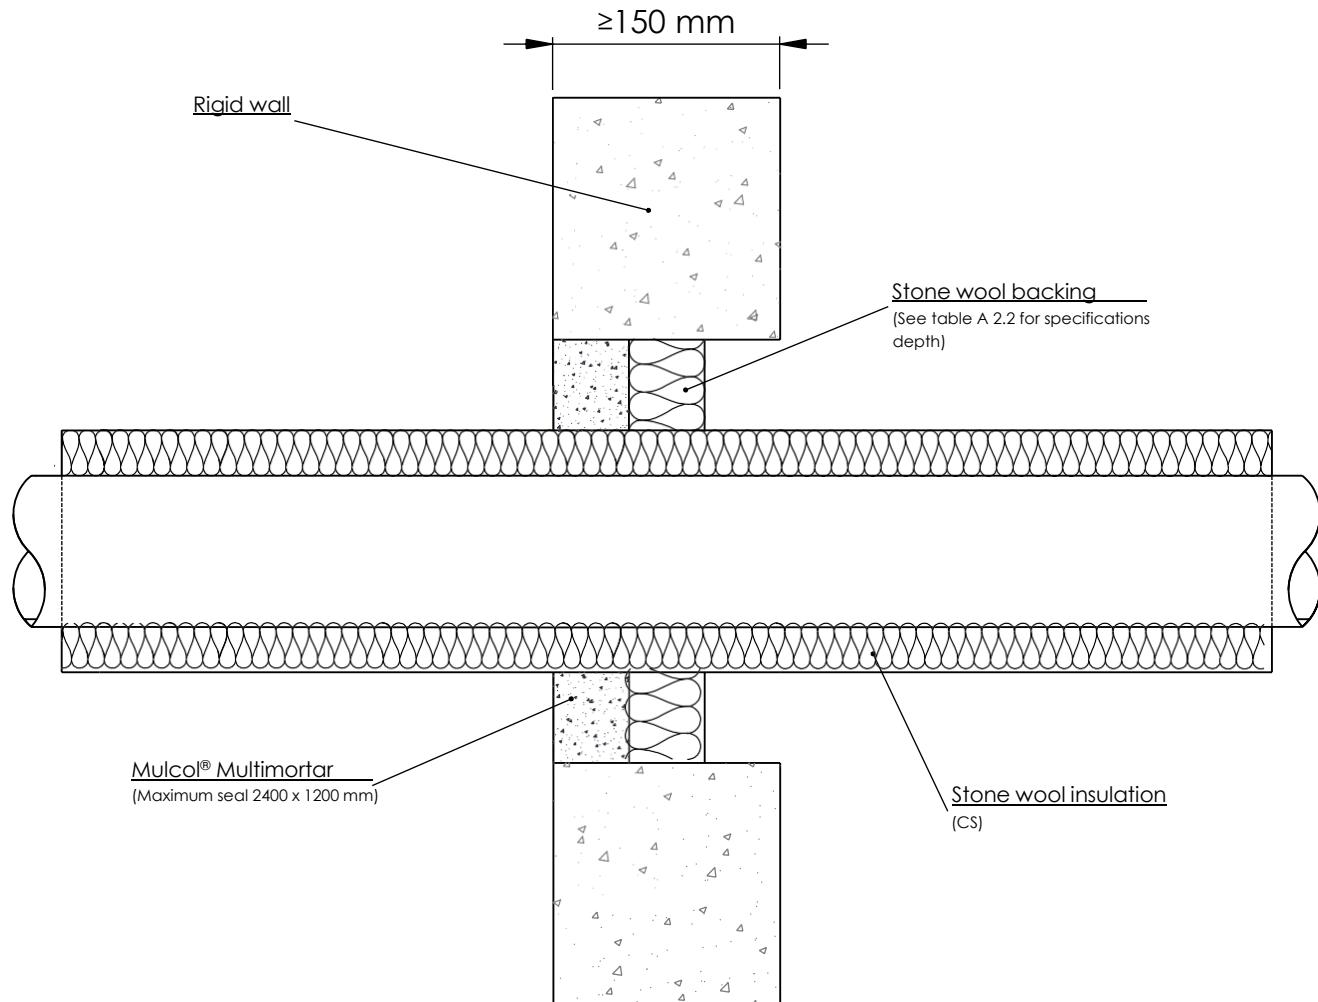

## A 2.2 Single side penetration seal with (stainless) steel pipes

Services	Classification	Position Mulcol® Multimortar	Backing	Insulation	Position services
Steel pipe Ø 219 mm / 5.0-14.2 mm wall th.	E 120 C/U, EI 90 C/U	Either side of the wall (or anywhere in between) 50 mm thick	50 mm Stone wool insulation, 150 kg/m³	30 mm Stone wool insulation, 80 kg/m³	Service fitted at any position within the aperture (min. separation 30 mm from seal edges and 0 mm from other services)

# Annex A - Resistance to fire classification - Mulcol® Multimortar


Fire test cable penetration seal

Mulcol® Multimortar

Rigid wall construction according to I.2.2

**MULCOL**

**FIRE PROTECTION**



Scale : 1:5

Unit of measure : mm

Date : 6-4-2016


Company : Mulcol International B.V.

RW-ST-MMM1.2.20

Department : Research & Development

Draftsman : R.M.

A4

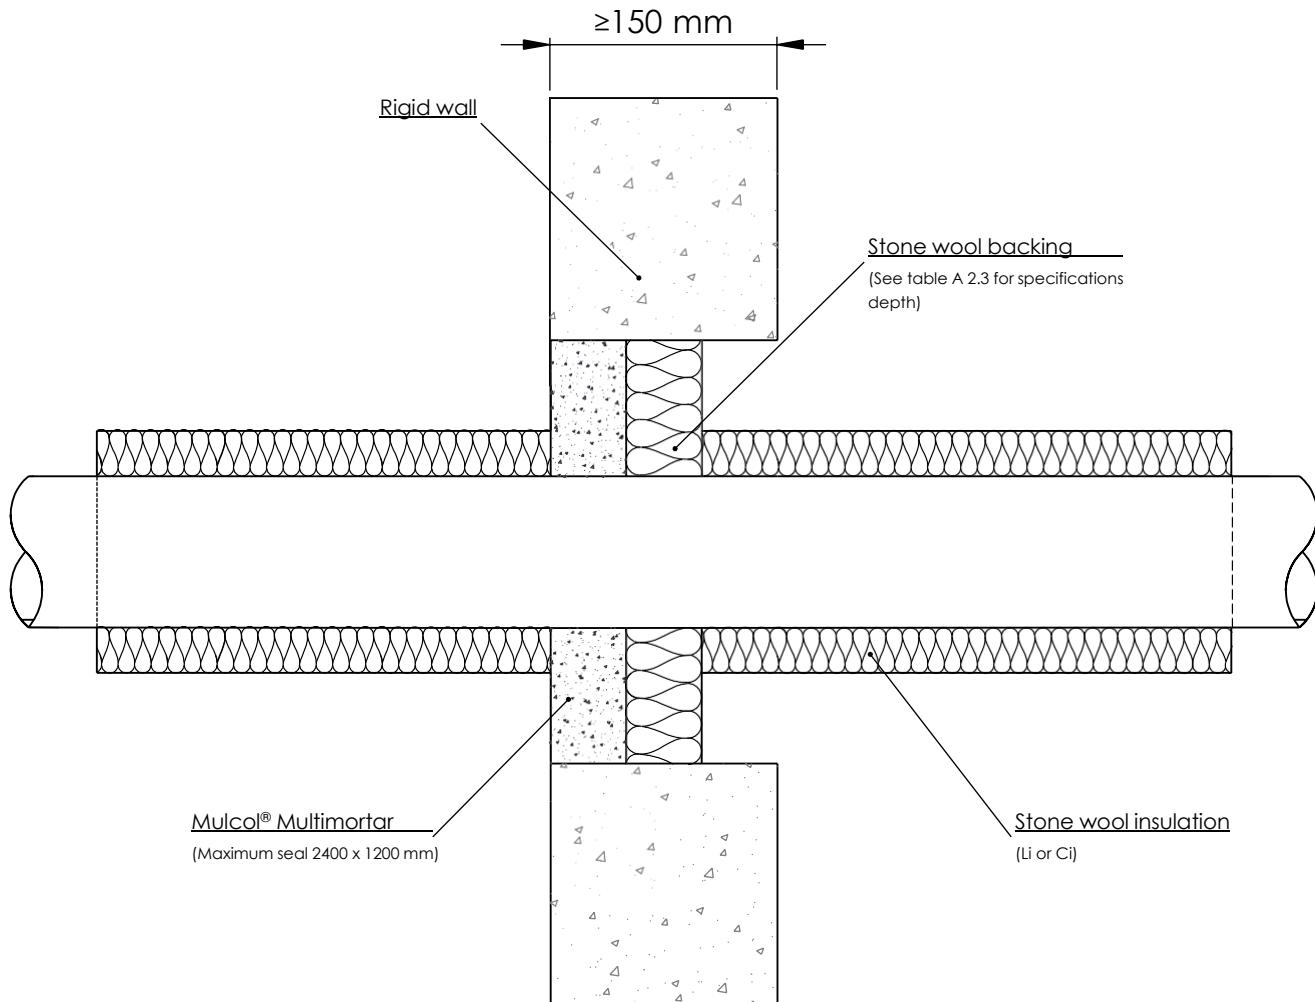

## A 2.3 Single side penetration seal with (stainless) steel pipes

Services	Classification	Position Mulcol® Multimortar	Insulation	Maximum seal	Position services
Steel pipe Ø 40 mm / 1.5-14.2 mm wall th.	EI 240 C/U		1000 mm length of 20 mm Stone wool insulation, 80 kg/m³	100 x 100 mm	
Steel pipe Ø 40 mm / 1.5-14.2 mm wall th.	E 180 C/U, EI 120 C/U			2400 x 1200 mm	
Steel pipe Ø 50 mm / 1.7-14.2 mm wall th.		Either side of the wall (or anywhere in between) 50 mm thick backed with 50 mm stone wool insulation, 150 kg/m³	1000 mm lenght of 30 mm Mineral wool insulation, 80 kg/m³	2400 x 1200 mm	Service fitted at any position within the aperture (min. separation 30 mm from seal edges and 0 mm from other services)
Steel pipe Ø 60 mm / 1.9-14.2 mm wall th.					
Steel pipe Ø 75 mm / 2.2-14.2 mm wall th.					
Steel pipe Ø 90 mm / 2.5-14.2 mm wall th.					
Steel pipe Ø 100 mm / 2.7-14.2 mm wall th.					
Steel pipe Ø 115 mm / 3.0-14.2 mm wall th.					
Steel pipe Ø 140 mm / 3.5-14.2 mm wall th.					
Steel pipe Ø 165 mm / 3.9-14.2 mm wall th.					
Steel pipe Ø 180 mm / 4.2-14.2 mm wall th.					
Steel pipe Ø 200 mm / 4.6-14.2 mm wall th.					
Steel pipe Ø 219 mm / 5.0-14.2 mm wall th.					

See graph on page 22 for intermediate sizes

# Annex A - Resistance to fire classification - Mulcol® Multimortar


Fire test pipe penetration seal

Mulcol® Multimortar

Rigid wall construction according to I.2.2

**MULCOL**

FIRE PROTECTION



Scale : 1:5

Unit of measure : mm

Date : 6-4-2016

Company : Mulcol International B.V.


Department : Research & Development

Draftsman : R.M.

RW-ST-MM1.2.20

A4

## Intermediate sizes

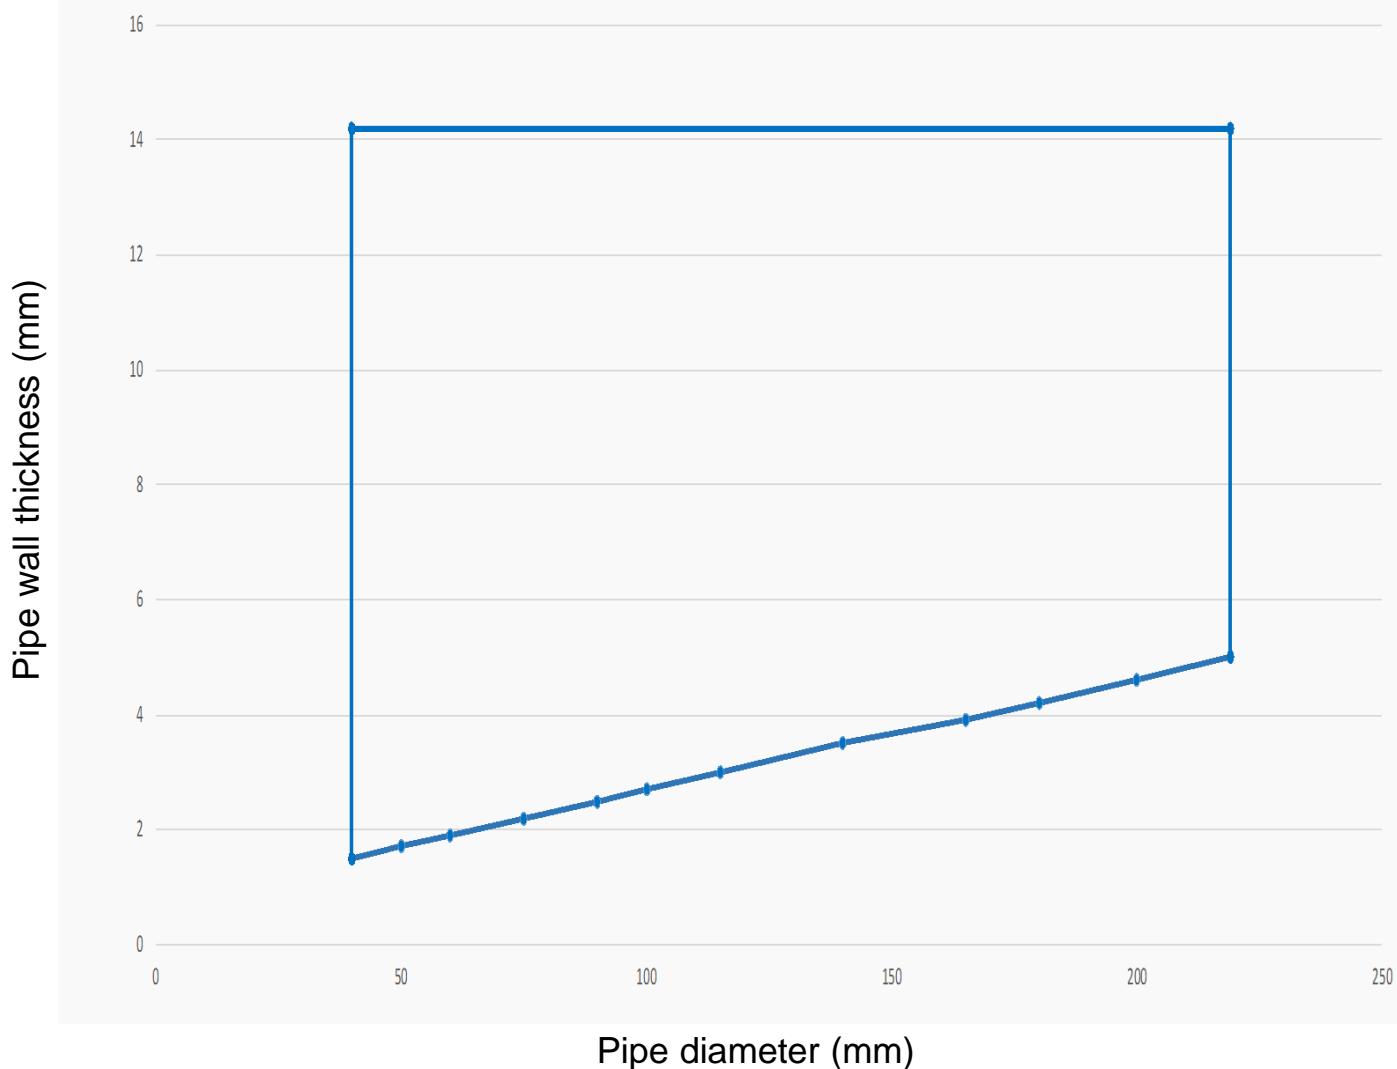

# Annex A - Resistance to fire classification - Mulcol® Multimortar


Fire test cable penetration seal

Mulcol® Multimortar

Rigid wall construction according to I.2.2

**MULCOL**

FIRE PROTECTION



Scale : 1:5

Unit of measure : mm

Date : 6-4-2016


Company : Mulcol International B.V.

RW-EC-MM1.2.10

Department : Research & Development

A4

Draftsman : R.M.

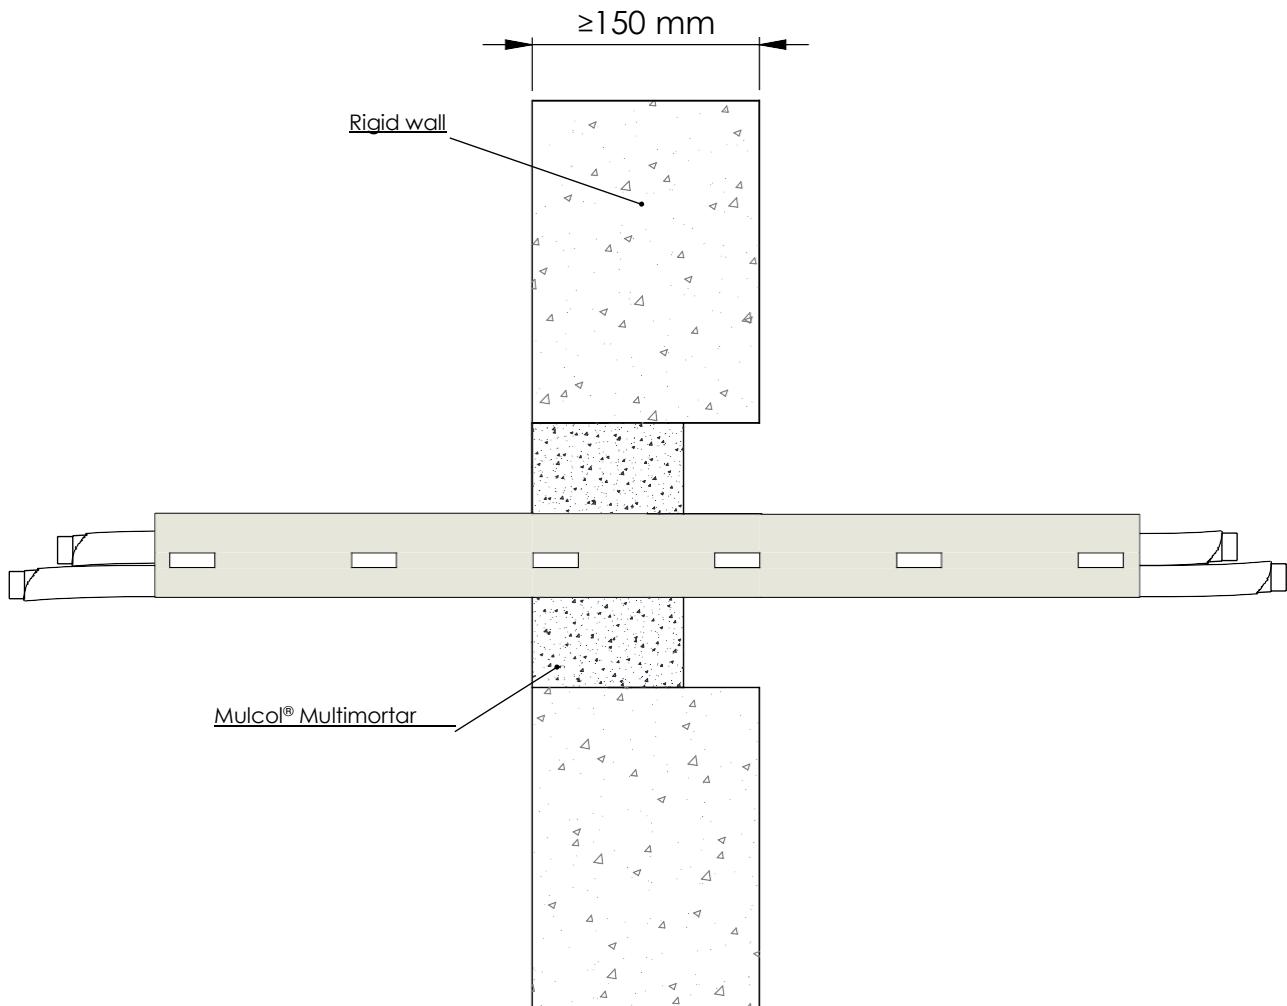

## A 2.4 Penetration seal with cables, trays and conduits

Services	Classification	Position Mulcol® Multimortar	Maximum seal	Position services
Blank seals	EI 240	Either side of the wall (or anywhere in between) 100 mm thick	2400 x 1200 mm	Service fitted at any position within the aperture (min. separation 25 mm from seal edges and 0 mm from other services)
Electrical cables up to Ø 21 mm (single, bundled and on trays)	E 240, EI 60			
Electrical cables up to Ø 80 mm (single, bundled and on trays)	E 240, EI 60			
Telecommunication cables up to Ø 21 mm (single or bundles up to Ø 100mm)	EI 120			
Steel cable trays & ladders (perforated and none-perforated)	E 120, EI 60			
None-Sheathed cables up to Ø 24 mm	E 120, EI 60			
PVC conduit up to Ø 16 mm	EI 240 C/U			

# Annex A - Resistance to fire classification - Mulcol® Multimortar


Fire test pipe penetration seal

Mulcol® Multimortar

Rigid wall construction according to I.2.2

**MULCOL**

FIRE PROTECTION



Scale : 1:5

Unit of measure : mm

Date : 6-4-2016


Company : Mulcol International B.V.

RW-ST-MM1.2.10

Department : Research & Development

A4

Draftsman : R.M.

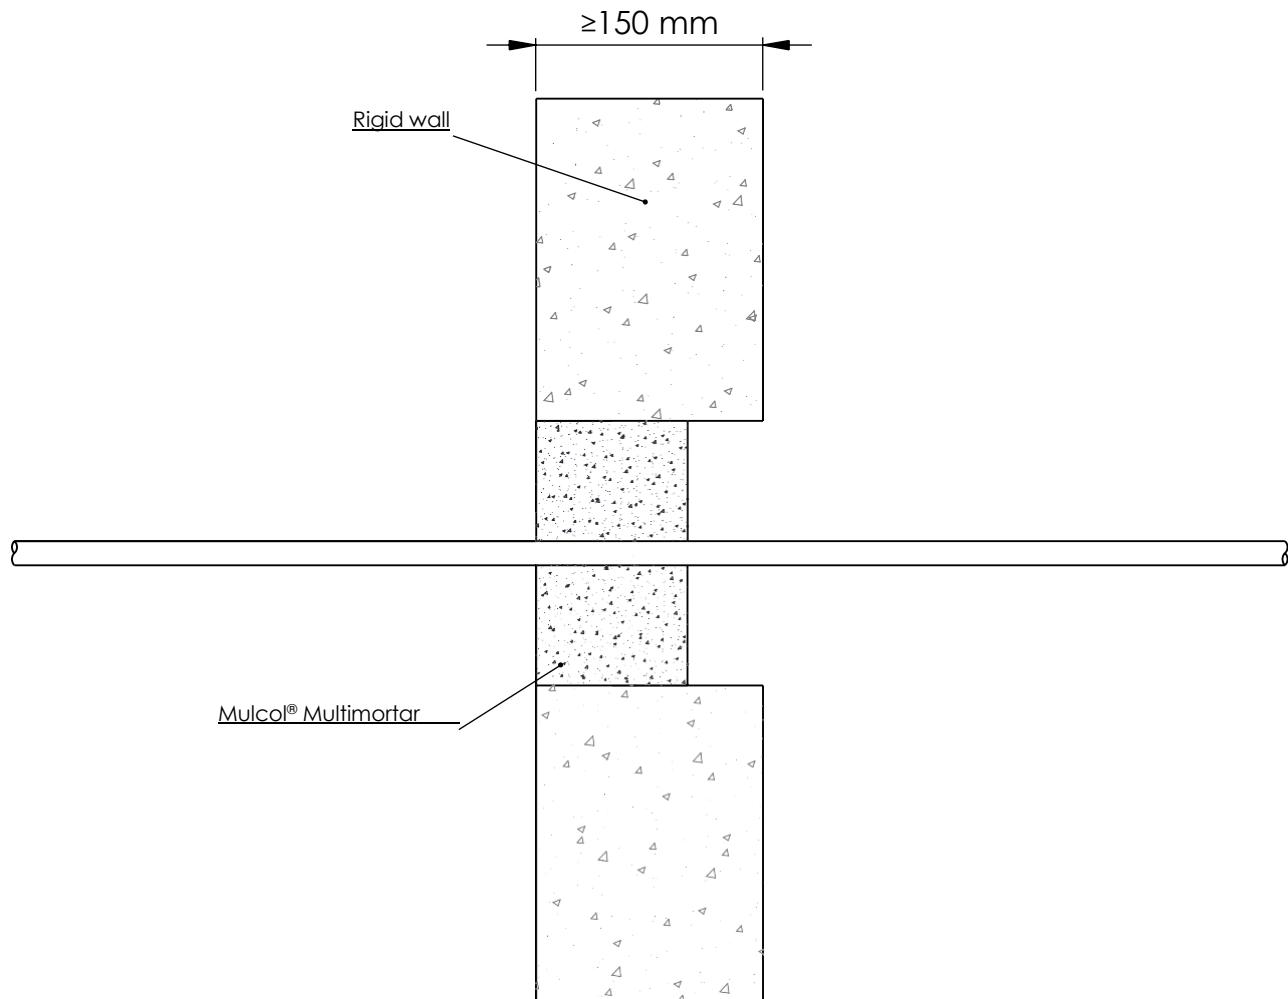

## A 2.4.1 Penetration seal with copper and steel conduits

Services	Classification	Position Mulcol® Multimortar	Maximum seal	Position services
Copper conduit up to $\varnothing$ 16 mm	E 180 C/U, EI 30 C/U	Either side of the wall (or anywhere in between) 100 mm thick	2400 x 1200 mm	Service fitted at any position within the aperture (min. separation 25 mm from seal edges and 0 mm from other services)
Steel conduit up to $\varnothing$ 16 mm	E 180 C/U, EI 60 C/U			

# Annex A - Resistance to fire classification - Mulcol® Multimortar


Fire test pipe penetration seal

Mulcol® Multimortar

Rigid wall construction according to I.2.2

**MULCOL**

FIRE PROTECTION



Scale : 1:5

Unit of measure : mm

Date : 6-4-2016


Company : Mulcol International B.V.

RW-ST-MM1.2.20

Department : Research & Development

A4

Draftsman : R.M.

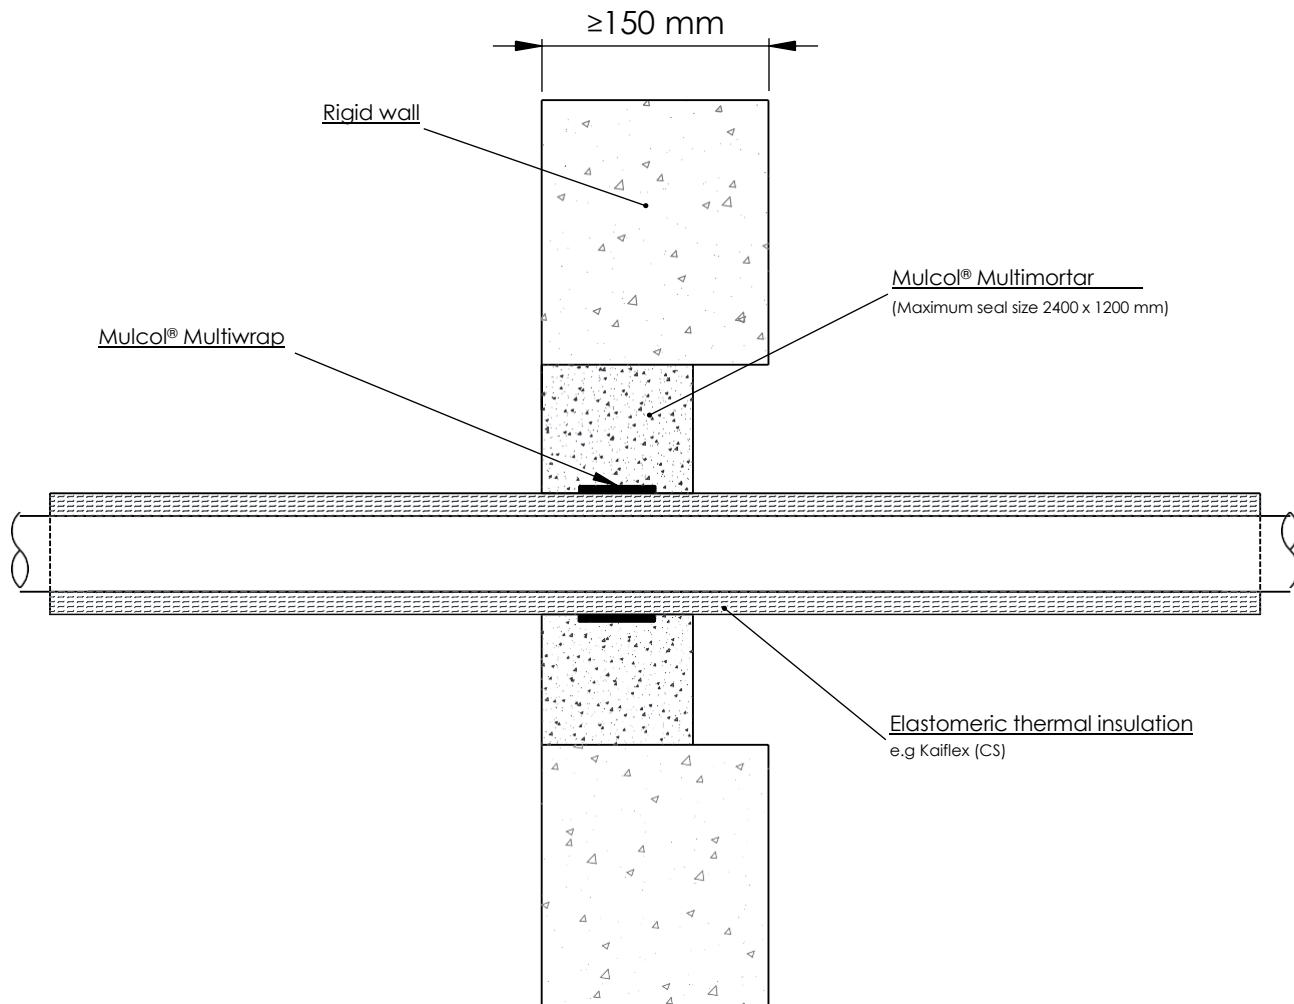

## A 2.5 Penetration seal with (stainless) steel pipes

Services	Classification	Position Mulcol® Multimortar	Insulation	Mulcol® Multiwrap	Position services
Steel pipe Ø 40 mm / 1.5-14.2 mm wall th.	EI 240 C/U		13 mm Kaiflex insulation		
Steel pipe Ø 165 mm / 4.5-14.2 mm wall th.	E 240 C/U, EI 30 C/U		9 mm Kaiflex insulation	50 x 3.6 mm (2 layers) centrally fitted	
Steel pipe Ø 40 mm / 1.5-14.2 mm wall th.					
Steel pipe Ø 50 mm / 1.6-14.2 mm wall th.					
Steel pipe Ø 60 mm / 1.7-14.2 mm wall th.					
Steel pipe Ø 75 mm / 1.9-14.2 mm wall th.					
Steel pipe Ø 90 mm / 2.0-14.2 mm wall th.					
Steel pipe Ø 100 mm / 2.1-14.2 mm wall th.					
Steel pipe Ø 115 mm / 2.3-14.2 mm wall th.					
Steel pipe Ø 140 mm / 2.6-14.2 mm wall th.					
Steel pipe Ø 165 mm / 2.8-14.2 mm wall th.					
See graph on page 26 for intermediate sizes					

# Annex A - Resistance to fire classification - Mulcol® Multimortar


Fire test pipe penetration seal

Mulcol® Multimortar

Rigid wall construction according to I.2.2

**MULCOL**

FIRE PROTECTION



Scale : 1:5

Unit of measure : mm

Date : 6-4-2016

Company : Mulcol International B.V.


RW-ST-MM1.2.20

Department : Research & Development

Draftsman : R.M.

A4

Intermediate sizes

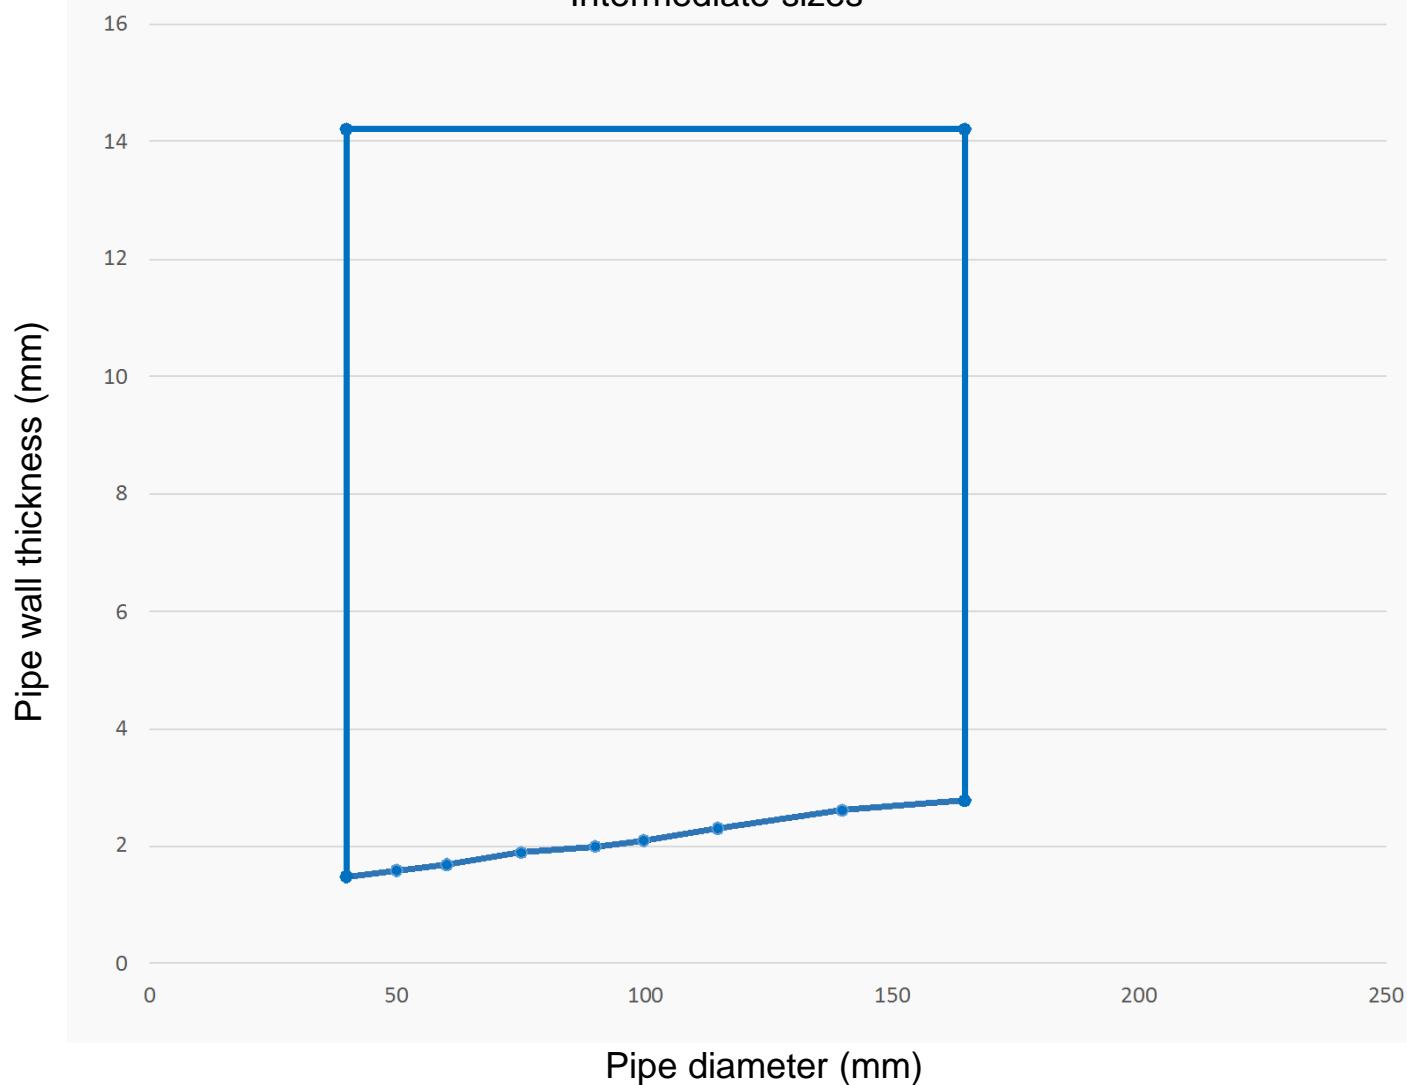

# Annex A - Resistance to fire classification - Mulcol® Multimortar


Fire test pipe penetration seal

Mulcol® Multimortar

Rigid wall construction according to I.2.2

**MULCOL**

FIRE PROTECTION



Scale : 1:5

Unit of measure : mm

Date : 6-4-2016


Company : Mulcol International B.V.

Department : Research & Development

Draftsman : R.M.

RW-ST-MM1.2.20

A4

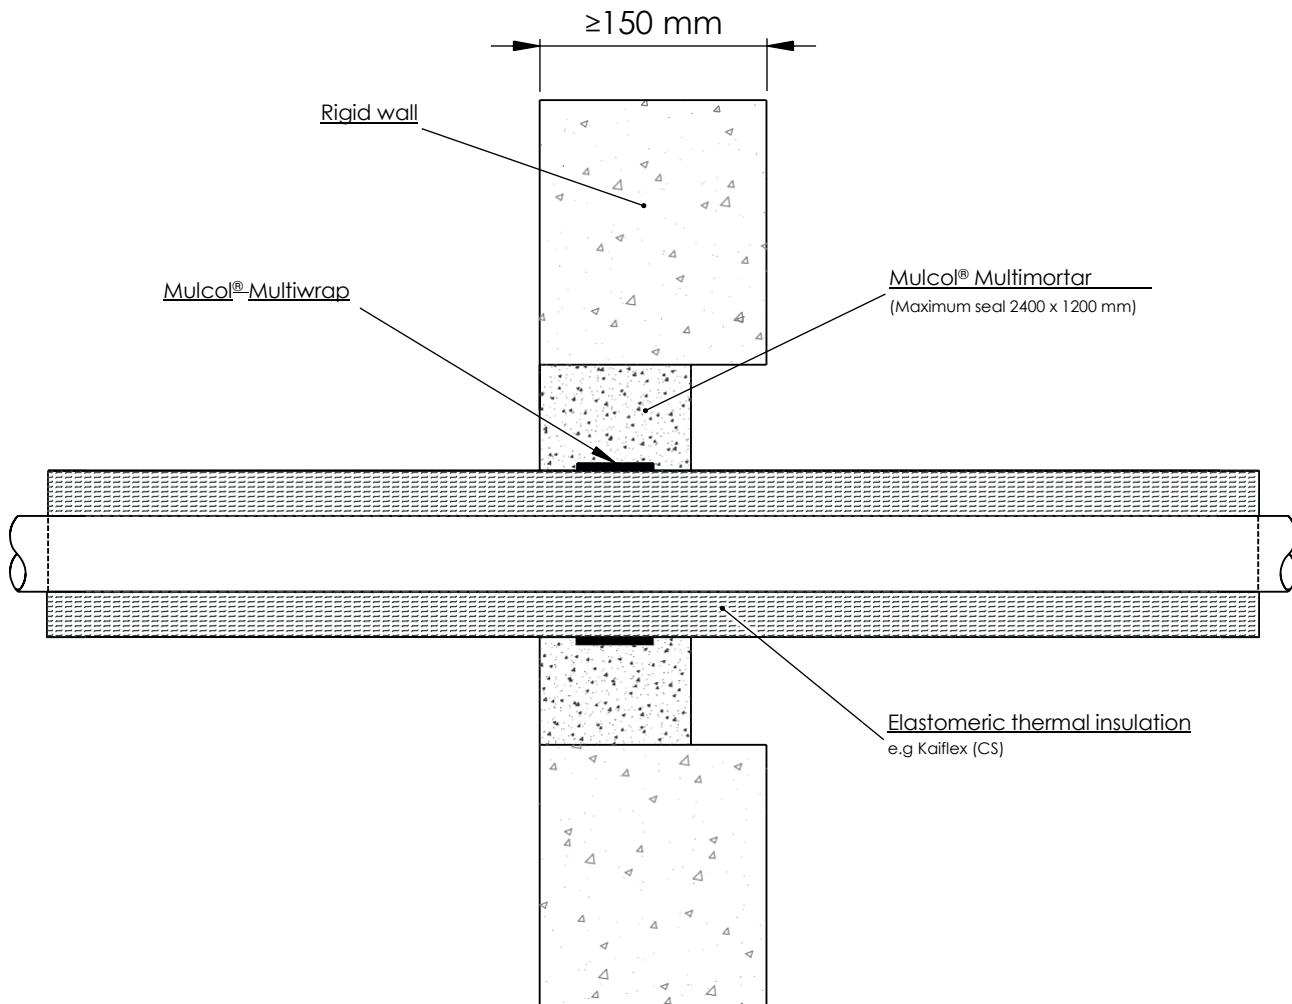

## A 2.5.1 Penetration seal with (stainless) steel pipes

Services	Classification	Position Mulcol® Multimortar	Mulcol® Multiwrap	Insulation	Position of services
Steel pipe Ø 40 mm / 1.5-14.2 mm wall th.					
Steel pipe Ø 50 mm / 1.8-14.2 mm wall th.					
Steel pipe Ø 60 mm / 2.0-14.2 mm wall th.					
Steel pipe Ø 75 mm / 2.3-14.2 mm wall th.					
Steel pipe Ø 90 mm / 2.7-14.2 mm wall th.					
Steel pipe Ø 100 mm / 2.9-14.2 mm wall th.					
Steel pipe Ø 115 mm / 3.3-14.2 mm wall th.					
Steel pipe Ø 140 mm / 3.9-14.2 mm wall th.					
Steel pipe Ø 165 mm / 4.5-14.2 mm wall th.					
See graph on page 28 for intermediate sizes					

# Annex A - Resistance to fire classification - Mulcol® Multimortar


Fire test pipe penetration seal

Mulcol® Multimortar

Rigid wall construction according to I.2.2

**MULCOL**

FIRE PROTECTION



Scale : 1:5

Unit of measure : mm

Date : 6-4-2016

Company : Mulcol International B.V.


RW-ST-MM1.2.20

Department : Research & Development

Draftsman : R.M.

A4

## Intermediate sizes

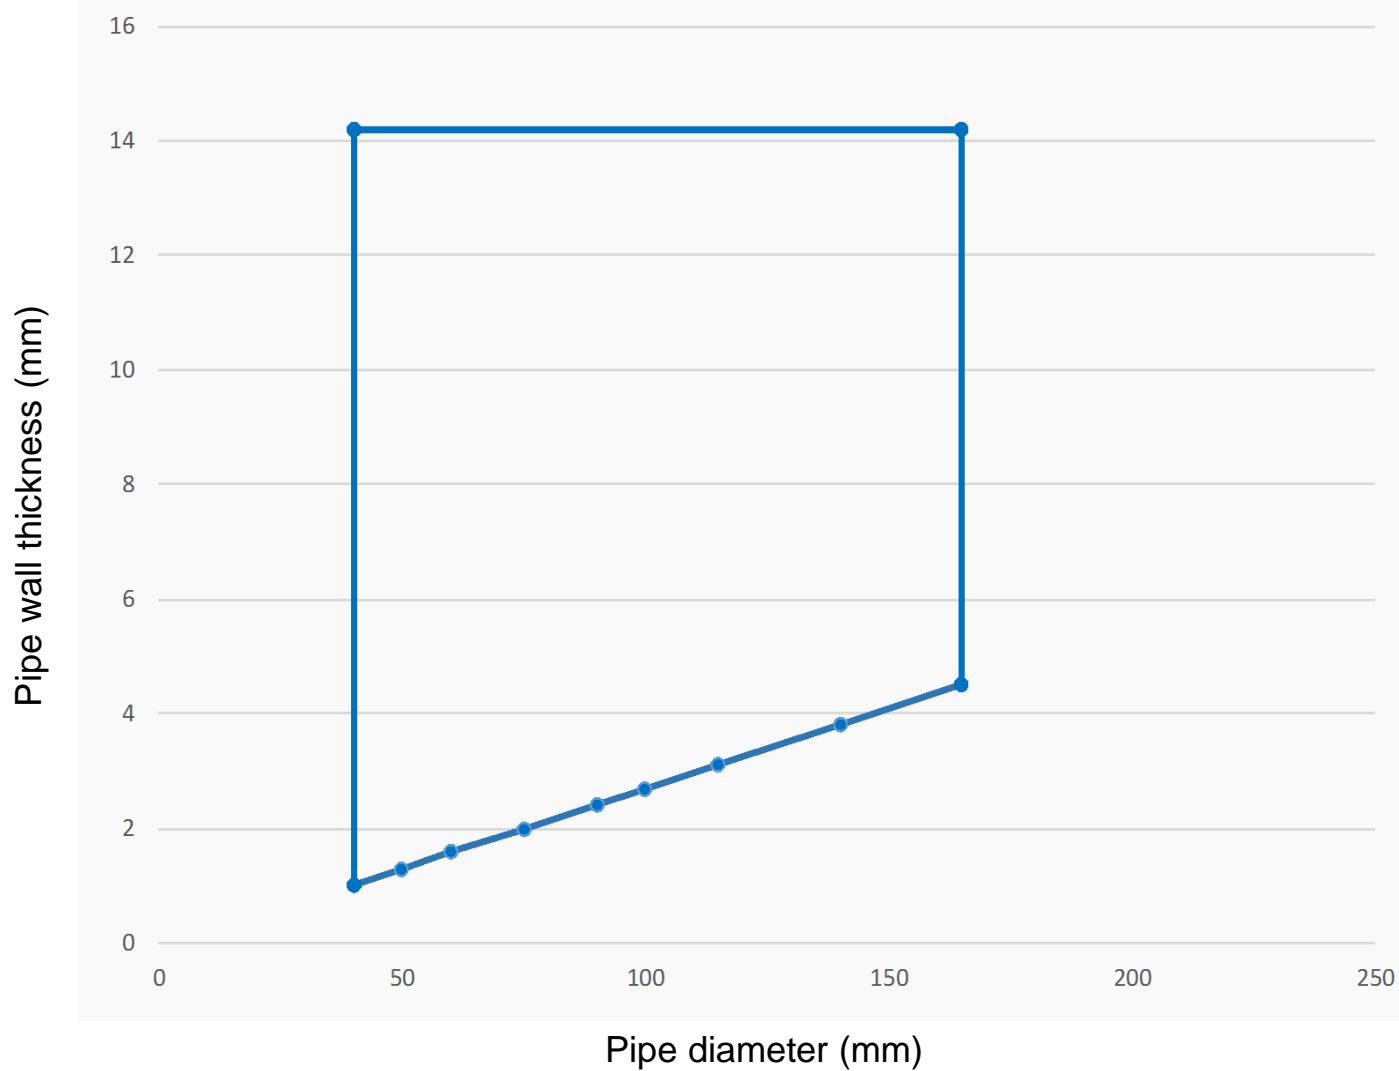

# Annex A - Resistance to fire classification - Mulcol® Multimortar


Fire test pipe penetration seal

Mulcol® Multimortar

Rigid wall construction according to I.2.2

**MULCOL**

**FIRE PROTECTION**



Scale : 1:5

Unit of measure : mm

Date : 9-2-2017

Company : Mulcol International B.V.


RW-PP-MM1.2.10

Department : Research & Development


Draftsman : R.M.

A4


Option 1

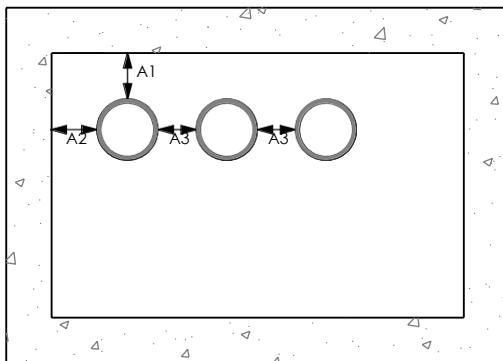


A1 : Pipe / top edge of seal separation min. 30 mm  
A2 : Pipe / side edge of seal separation min. 30 mm  
A3 : Pipe / pipe separation min. 30 mm

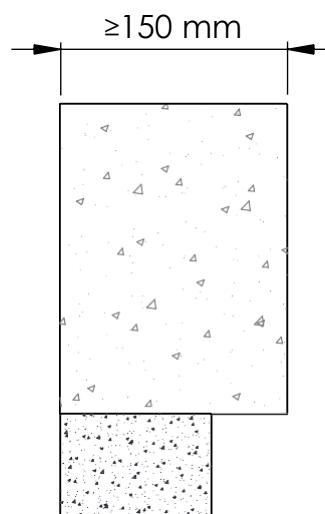

Option 2

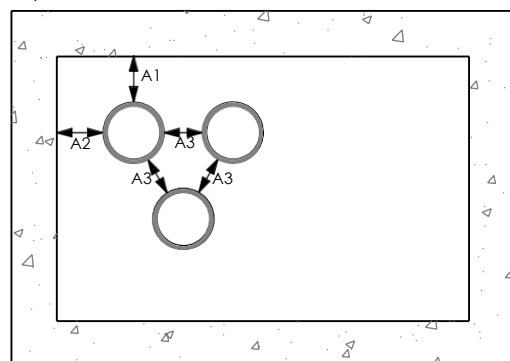

A1 : Pipe / top edge of seal separation min. 30 mm  
A2 : Pipe / side edge of seal separation min. 30 mm  
A3 : Pipe / pipe separation min. 30 mm

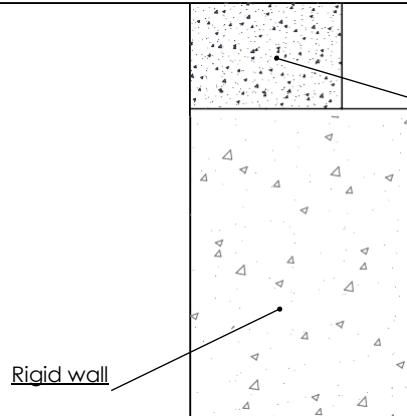

## A 2.6 Penetration seal with combustible pipes

Services	Classification	Position Mulcol® Multimortar	Configuration	Maximum seal
<b>PVC-U pipes according to EN 1329-1, EN 1452-2 or EN 1453-1, PVC-C according to EN 1566-1</b>				
Up to $\varnothing$ 32 mm / 1.6 - 2.4 mm wall th.	EI 120 U/C	To either side of the wall 100 mm thick	1 & 2 between all specified pipes	2400 x 1200 mm
<b>PE pipe according to EN 1519-1, EN 12201-2 and EN 12006-1, ABS according to EN 1455-1 and pipes made from SAN+pvc according to EN 1565-1</b>				
Up to $\varnothing$ 32 mm / 1.8 - 3.0 mm wall th.	EI 120 U/C	To either side of the wall 100 mm thick	1 & 2 between all specified pipes	2400 x 1200 mm
<b>PP pipe according to EN 1852-1:2009</b>				
Up to $\varnothing$ 32 mm / 1.9 - 4.4 mm wall th.	EI 120 U/C	To either side of the wall 100 mm thick	1 & 2 between all specified pipes	2400 x 1200 mm

# Annex A - Resistance to fire classification - Mulcol® Multimortar


Fire test pipe penetration seal

Mulcol® Multimortar

Rigid wall construction according to I.2.2

**MULCOL**

**FIRE PROTECTION**



Scale : 1:5

Unit of measure : mm

Date : 6-4-2016


Company : Mulcol International B.V.

RW-ST-MM1.2.20

Department : Research & Development

A4

Draftsman : R.M.

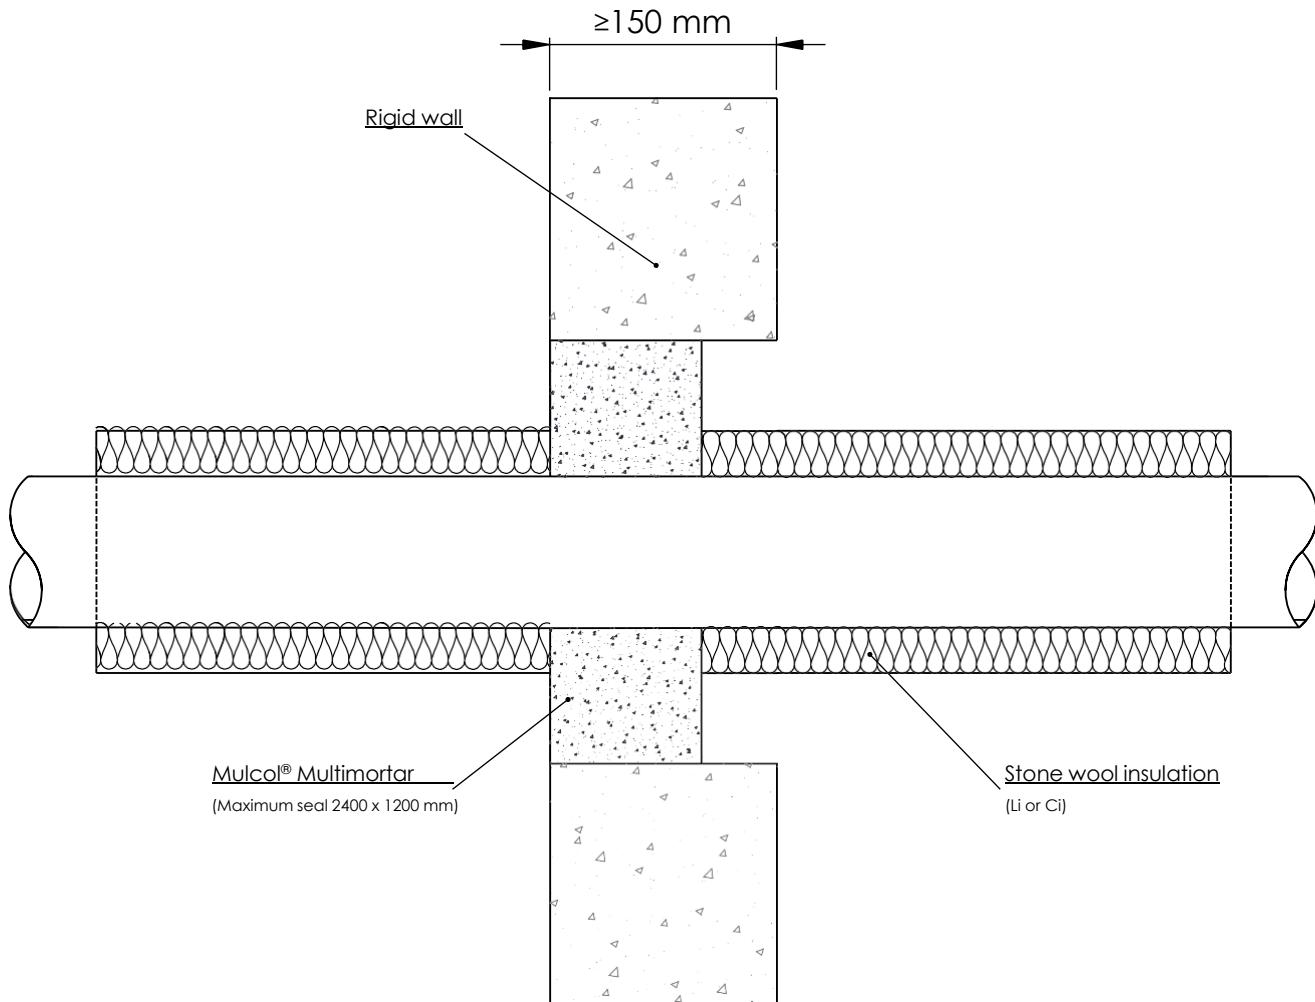

## A 2.7 Penetration seal with (stainless) steel pipes

Services	Classification	Position Mulcol® Multimortar	Insulation	Maximum seal	Position services
Steel pipe 40 mm / 1.5-14.2 mm wall th.	EI 240 C/U	E 240 C/U, EI 120 C/U	1000 mm length of 20 mm Stone wool insulation, 80 kg/m³	2400 x 1200 mm	Service fitted at any position within the aperture (min. separation 20 mm from seal edges and 0 mm from other services)
Steel pipe Ø 40 mm / 1.5-14.2 mm wall th.	E 240 C/U, EI 120 C/U				
Steel pipe 50 mm / 1.7-14.2 mm wall th.					
Steel pipe 60 mm / 1.9-14.2 mm wall th.					
Steel pipe 75 mm / 2.2-14.2 mm wall th.					
Steel pipe Ø 90 mm / 2.5-14.2 mm wall th.					
Steel pipe Ø 100 mm / 2.7-14.2 mm wall th.					
Steel pipe Ø 115 mm / 3.0-14.2 mm wall th.					
Steel pipe 140 mm / 3.5-14.2 mm wall th.					
Steel pipe 165 mm / 3.9-14.2 mm wall th.					
Steel pipe 180 mm / 4.2-14.2 mm wall th.					
Steel pipe 200 mm / 4.6-14.2 mm wall th.					
Steel pipe 219 mm / 5.0-14.2 mm wall th.					

See graph on page 31 for intermediate sizes

## Annex A - Resistance to fire classification - Mulcol® Multimortar


Fire test pipe penetration seal

Mulcol® Multimortar

Rigid wall construction according to I.2.2

**MULCOL**

FIRE PROTECTION



Scale : 1:5

Unit of measure : mm

Date : 6-4-2016

Company : Mulcol International B.V.


RW-ST-MM1.2.20

Department : Research & Development

Draftsman : R.M.

A4

### Intermediate sizes

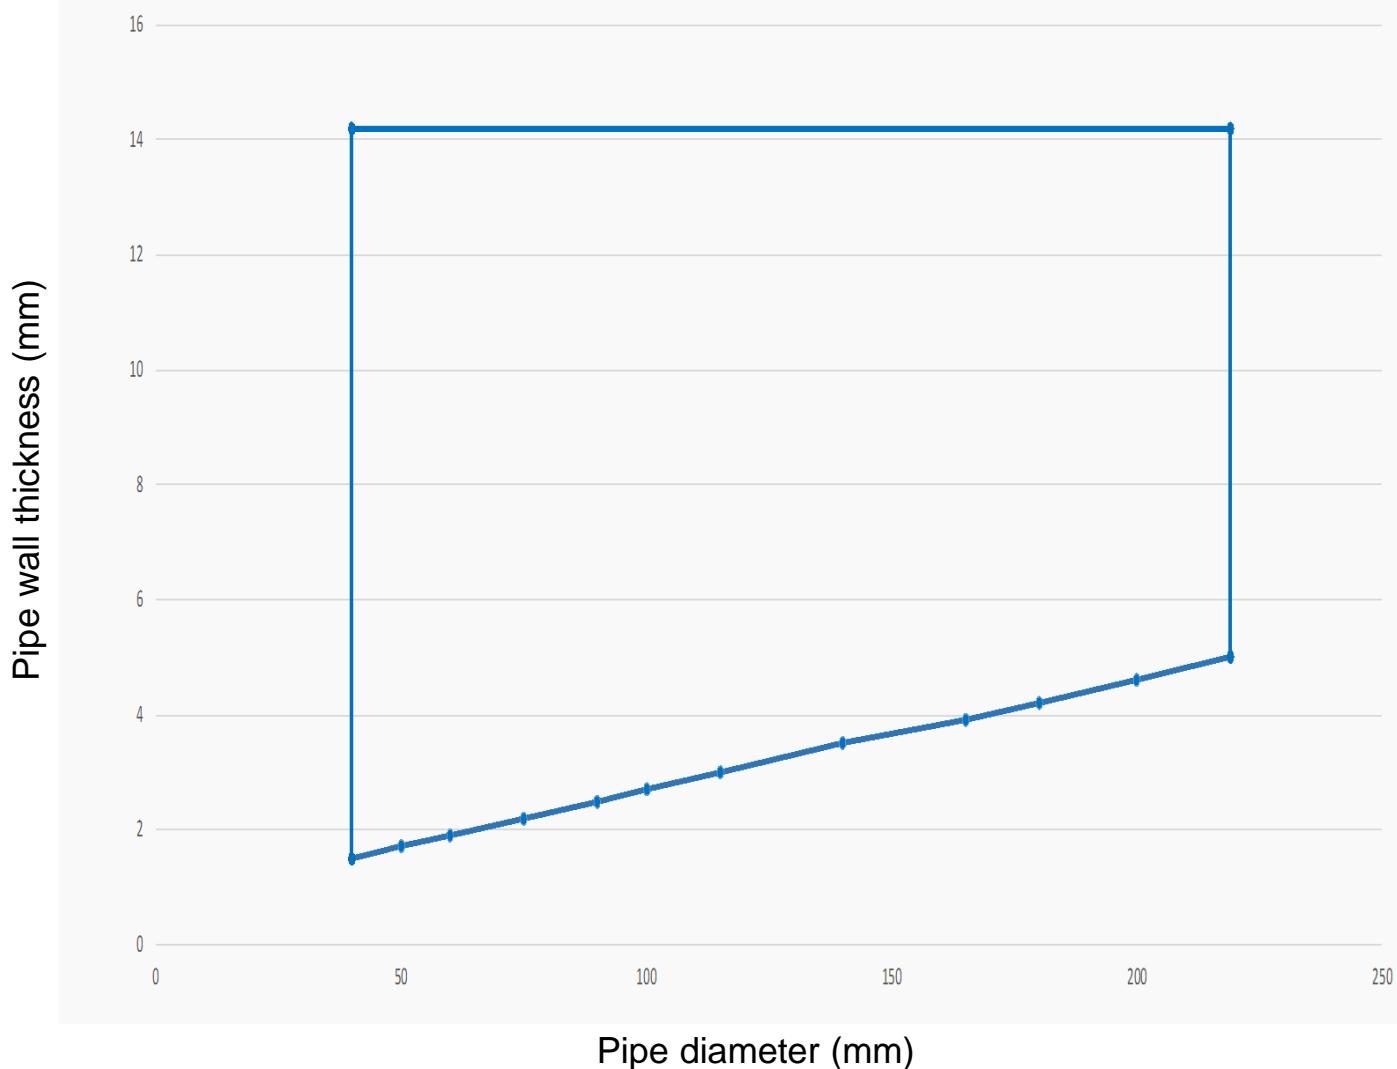

# Annex A - Resistance to fire classification - Mulcol® Multimortar


Fire test cable penetration seal

Mulcol® Multimortar

Rigid wall construction according to I.2.2

**MULCOL**

FIRE PROTECTION



Scale : 1:5

Unit of measure : mm

Date : 6-4-2016


Company : Mulcol International B.V.

RW-EC-MM1.6.10

Department : Research & Development

A4

Draftsman : R.M.

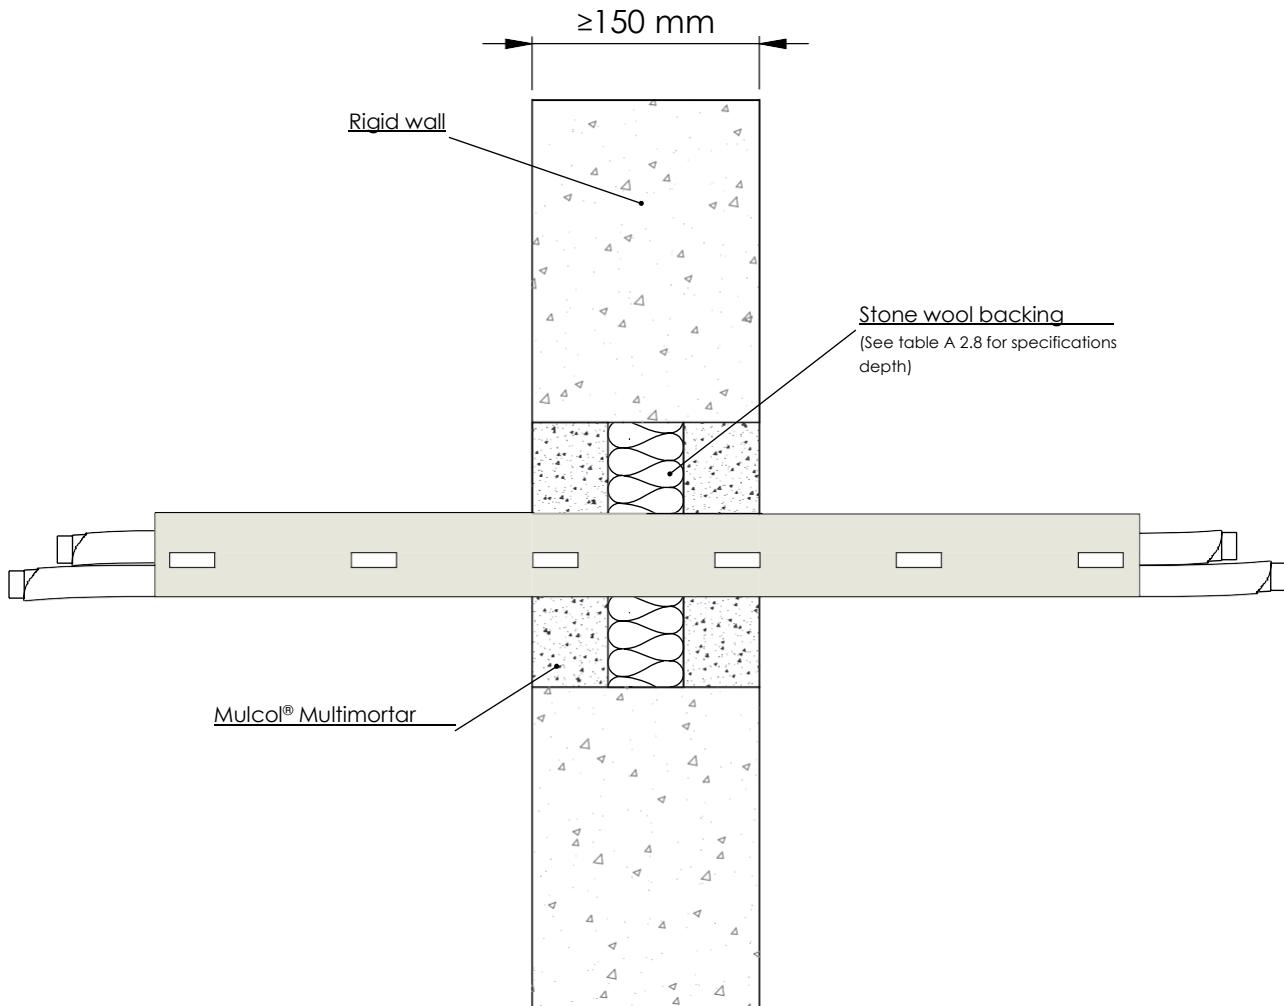

## A 2.8 Double side penetration seal with cables and trays

Services	Classification	Position Mulcol® Multimortar	Backing	Maximum seal	Position services
Blank seals	EI 240	Both sides of the wall 50 mm thick	50 mm Stone wool insulation, 150 kg/m³	2400 x 1200 mm	Service fitted at any position within the aperture (min. separation 30 mm from seal edges and 30 mm from other services)
Single electrical cables up to Ø 80 mm single or in a bundle	E 240, EI 60				
Steel cable trays and ladders up to 500 mm wide	E 240, EI 60				
Telecom cables up to Ø 21 mm single or in a bundle up to Ø 100 mm	EI 60				
Non-sheathed wire up to Ø 24 mm	E 240, EI 120				

# Annex A - Resistance to fire classification - Mulcol® Multimortar


Fire test cable penetration seal

Mulcol® Multimortar

Rigid floor construction according to I.2.2

**MULCOL**

FIRE PROTECTION



Scale : 1:5

Unit of measure : mm

Date : 6-4-2016


Company : Mulcol International B.V.

RF-CT-MM1.5.10

Department : Research & Development

A4

Draftsman : R.M.

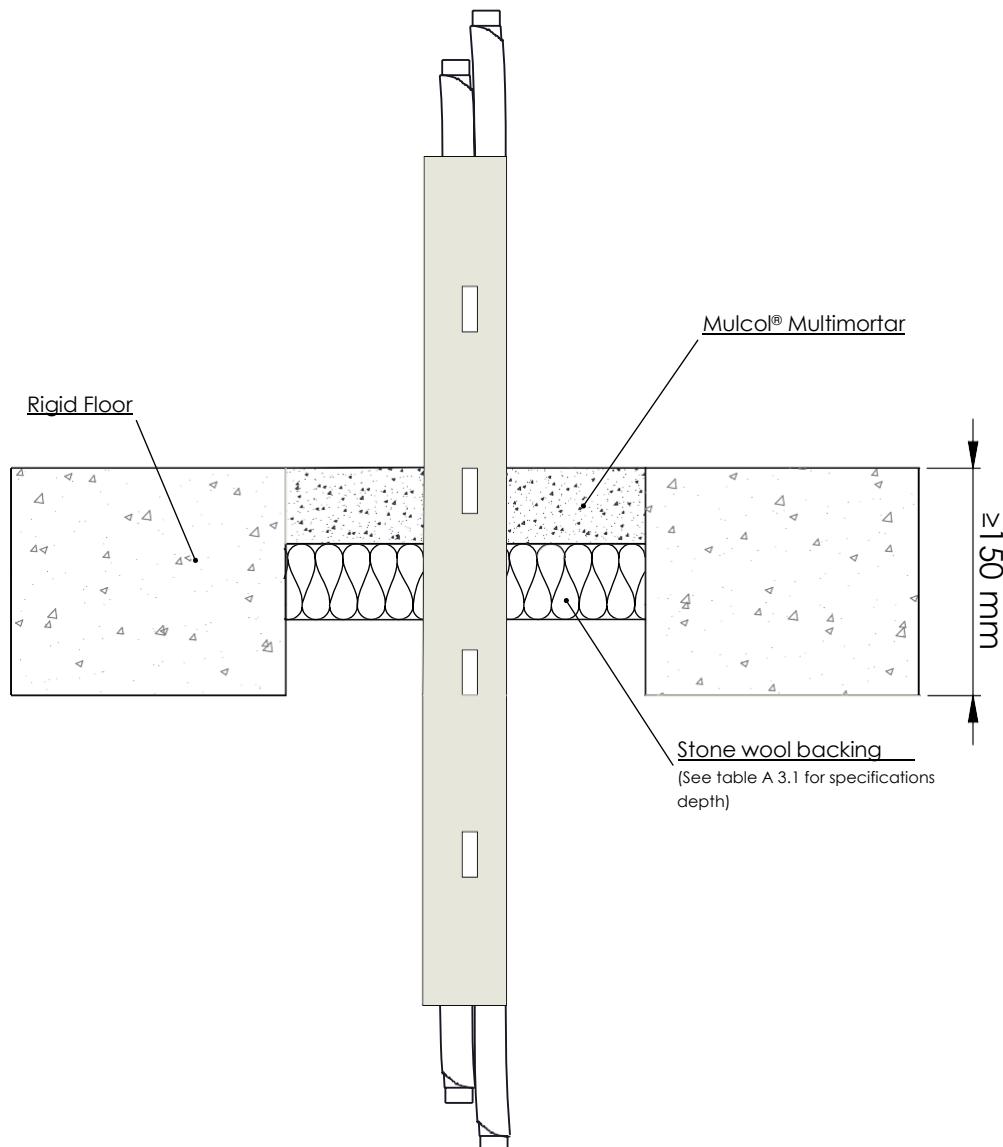

## A 3.1 Single side penetration seal with cables, trays and conduits

Services	Classification	Position Mulcol® Multimortar	Backing	Maximum seal	Position services
Single electrical cables up to $\varnothing$ 21 mm	E 180, EI 90				Service fitted at any position within the aperture (min. separation 30 mm from seal edges and 100 mm from other services)
Blank seal	EI 180				
Electrical cables up to $\varnothing$ 21 mm (single, bundled and on trays)	E 180, EI 60				
Electrical cables up to $\varnothing$ 80 mm (single, bundled and on trays)	E 90, EI 45				
Telecommunication cables up to $\varnothing$ 21 mm (single or bundles up to $\varnothing$ 100mm)	EI 180				
Steel cable trays & ladders (perforated or non-perforated)	E 90, EI 60				
Non-sheathed wires up to $\varnothing$ 17 mm	E 180, EI 60				
Non-sheathed wires up to $\varnothing$ 24 mm	E 180 , EI 30				
PVC conduit up to $\varnothing$ 16 mm	EI 180 C/U				
Top side of the floor 50 mm thick					
50 mm Stone wool insulation, 150 kg/m³					
2400 x 1200 mm					
Service fitted at any position within the aperture (min. separation 30 mm from seal edges and 0 mm from other services)					

# Annex A - Resistance to fire classification - Mulcol® Multimortar


Fire test pipe penetration seal

Mulcol® Multimortar

Rigid floor construction according to I.2.2

**MULCOL**

**FIRE PROTECTION**



Scale : 1:5

Unit of measure : mm

Date : 8-2-2018

Company : Mulcol International B.V.


RF-ST-MM1.2.20

Department : Research & Development

A4

Draftsman : K.J.

Option 1

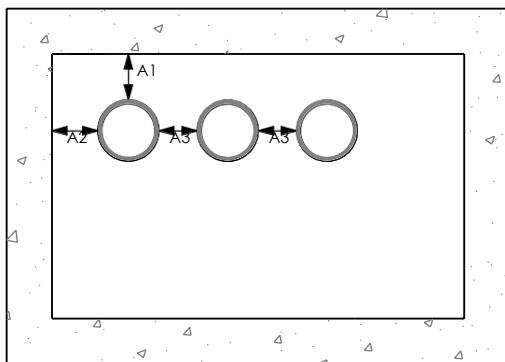


A1 : Pipe / top edge of seal separation min. 30 mm

A2 : Pipe / side edge of seal separation min. 30 mm

A3 : Pipe / pipe separation min. 30 mm


Option 2

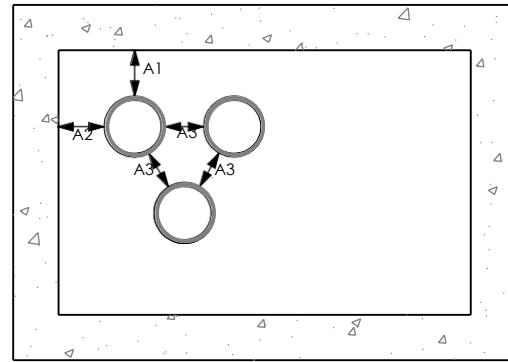

A1 : Pipe / top edge of seal separation min. 30 mm

A2 : Pipe / side edge of seal separation min. 30 mm

A3 : Pipe / pipe separation min. 30 mm

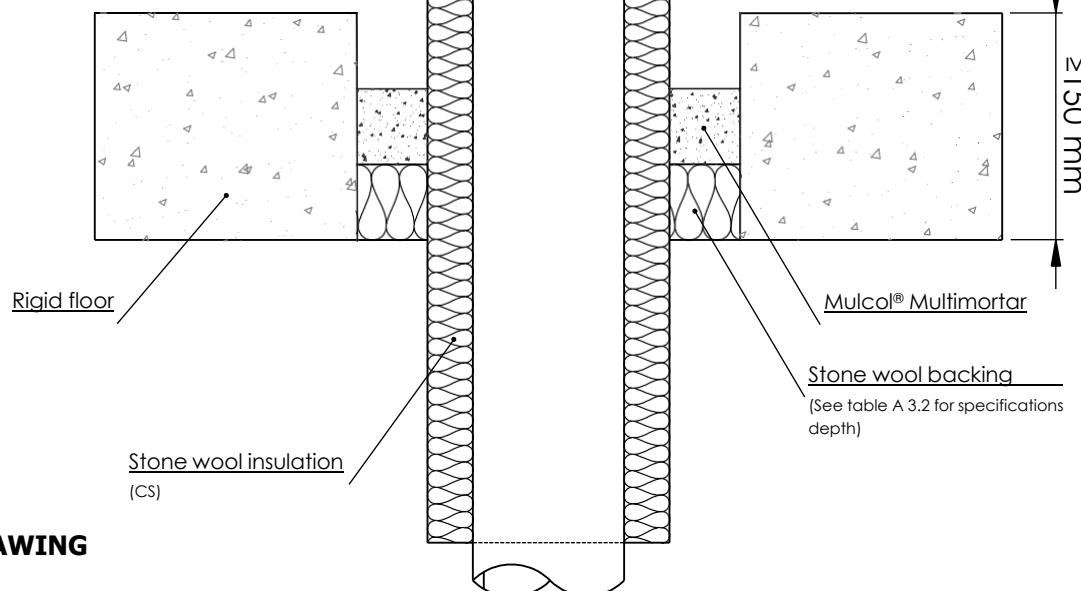

## NEW 2D-DRAWING

### A 3.2 Single side penetration seal with (stainless) steel pipes

Services	Classification	Position Mulcol® Multimortar	Backing	Insulation	Configuration	Maximum seal
Ø 40 mm / 1-14.2 mm wall th.				20 mm thick stone, mineral wool min. 80 kg/m³		
Ø 40 mm / 1-14.2 mm wall th.						
Ø 50 mm / 1.2-14.2 mm wall th.						
Ø 60 mm / 1.4-14.2 mm wall th.						
Ø 75 mm / 1.6-14.2 mm wall th.						
Ø 90 mm / 1.9-14.2 mm wall th.						
Ø 100 mm / 2.1-14.2 mm wall th.						
Ø 115 mm / 2.4-14.2 mm wall th.						
Ø 140 mm / 2.9-14.2 mm wall th.						
Ø 165 mm / 3.4-14.2 mm wall th.						
Ø 180 mm / 3.6-14.2 mm wall th.						
Ø 200 mm / 4.0-14.2 mm wall th.						
Ø 219 mm / 4.3-14.2 mm wall th.						
Ø 250 mm / 5.0-14.2 mm wall th.						
Ø 300 mm / 5.9-14.2 mm wall th.						
Ø 324 mm / 6.35-14.2 mm wall th.						
See graph on page 36 for intermediate sizes						

# Annex A - Resistance to fire classification - Mulcol® Multimortar


Fire test pipe penetration seal

Mulcol® Multimortar

Rigid floor construction according to I.2.2

**MULCOL**

**FIRE PROTECTION**



Scale : 1:5

Unit of measure : mm

Date : 8-2-2018

Company : Mulcol International B.V.


RF-ST-MM1.2.20

Department : Research & Development

A4

Draftsman : K.J.

Option 1

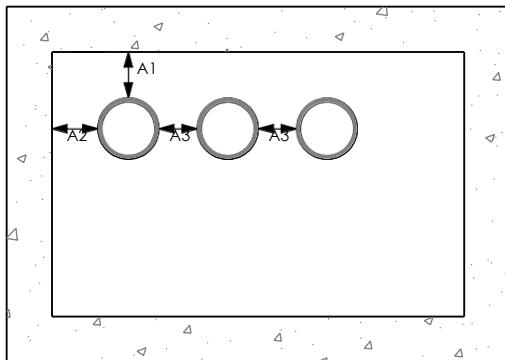


A1 : Pipe / top edge of seal separation min. 30 mm

A2 : Pipe / side edge of seal separation min. 30 mm

A3 : Pipe / pipe separation min. 30 mm


Option 2

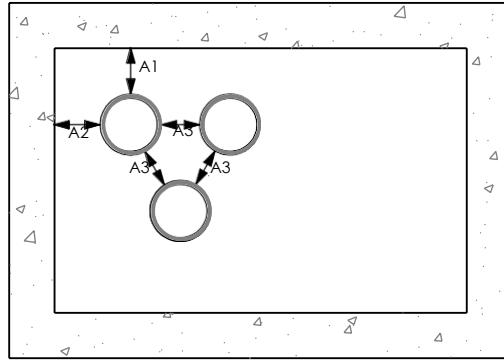

A1 : Pipe / top edge of seal separation min. 30 mm

A2 : Pipe / side edge of seal separation min. 30 mm

A3 : Pipe / pipe separation min. 30 mm

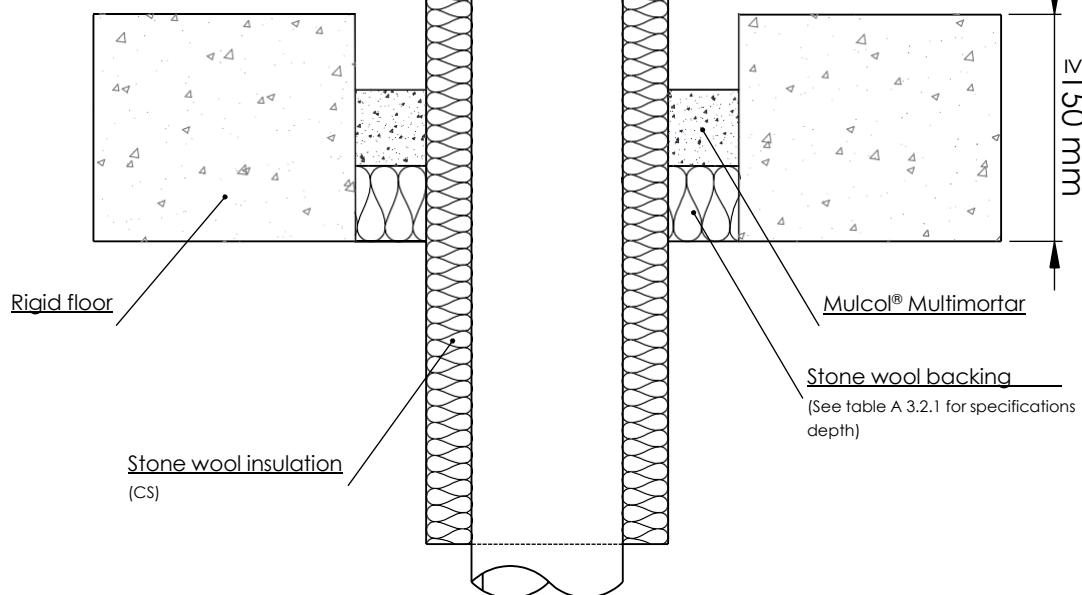

## A 3.2.1 Single side penetration seal with (stainless) steel pipes

Services	Classification	Position Mulcol® Multimortar	Backing	Insulation	Configuration	Maximum seal
Ø 40 mm / 1-14.2 mm wall th.	EI 240 C/U	At any height within the depth of the floor	50 mm Stone wool insulation, 140 kg/m³	30-80 mm thick stone, mineral wool min. 80 kg/m³	1 & 2	550 x 1100 mm
Ø 50 mm / 1.2-14.2 mm wall th.						
Ø 60 mm / 1.4-14.2 mm wall th.						
Ø 75 mm / 1.6-14.2 mm wall th.						
Ø 90 mm / 1.9-14.2 mm wall th.						
Ø 100 mm / 2.1-14.2 mm wall th.						
Ø 115 mm / 2.4-14.2 mm wall th.						
Ø 140 mm / 2.9-14.2 mm wall th.						
Ø 165 mm / 3.4-14.2 mm wall th.						
Ø 180 mm / 3.6-14.2 mm wall th.						
Ø 200 mm / 4.0-14.2 mm wall th.						
Ø 219 mm / 4.3-14.2 mm wall th.						
Ø 250 mm / 5.0-14.2 mm wall th.						
Ø 300 mm / 5.9-14.2 mm wall th.						
Ø 324 mm / 6.35-14.2 mm wall th.						

See graph on page 36 for intermediate sizes

# Annex A - Resistance to fire classification - Mulcol® Multimortar


Fire test pipe penetration seal

Mulcol® Multimortar

Rigid floor construction according to I.2.2

**MULCOL**

FIRE PROTECTION



Scale : 1:5

Unit of measure : mm

Date : 8-2-2016

Company : Mulcol International B.V.


RF-ST-MM1.2.20

Department : Research & Development

Draftsman : K.J.

A4

**Intermediate sizes**

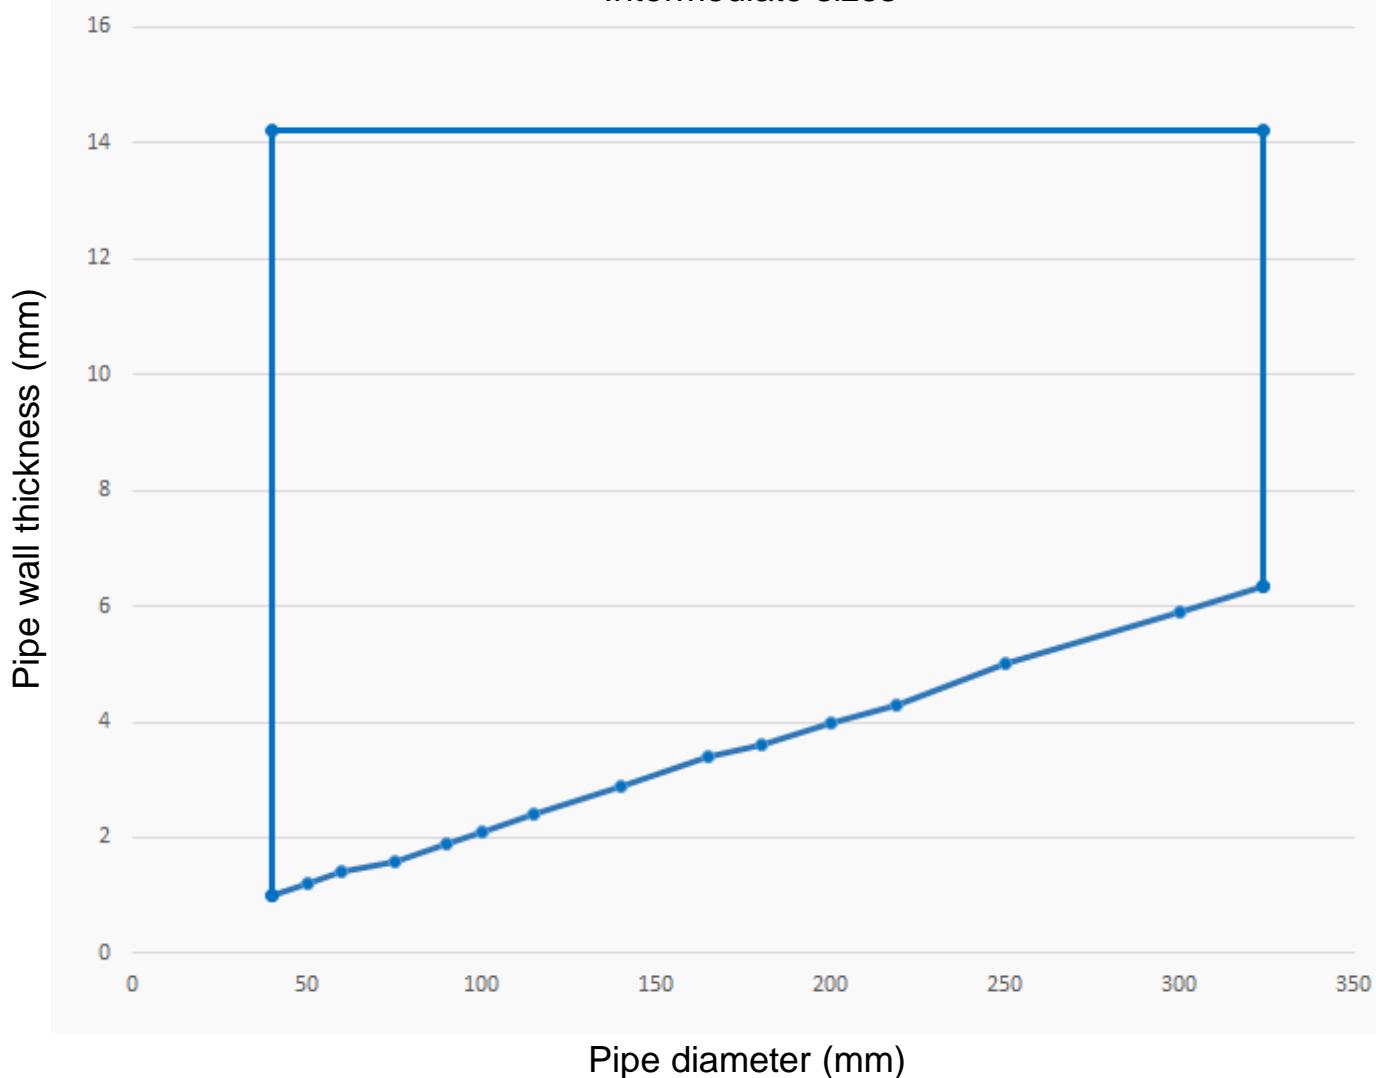

# Annex A - Resistance to fire classification - Mulcol® Multimortar


Fire test pipe penetration seal

Mulcol® Multimortar

Rigid floor construction according to I.2.2

**MULCOL**

**FIRE PROTECTION**



Scale : 1:5

Unit of measure : mm

Date : 6-4-2016


Company : Mulcol International B.V.

RF-ST-MM1.2.20

Department : Research & Development

A4

Draftsman : R.M.

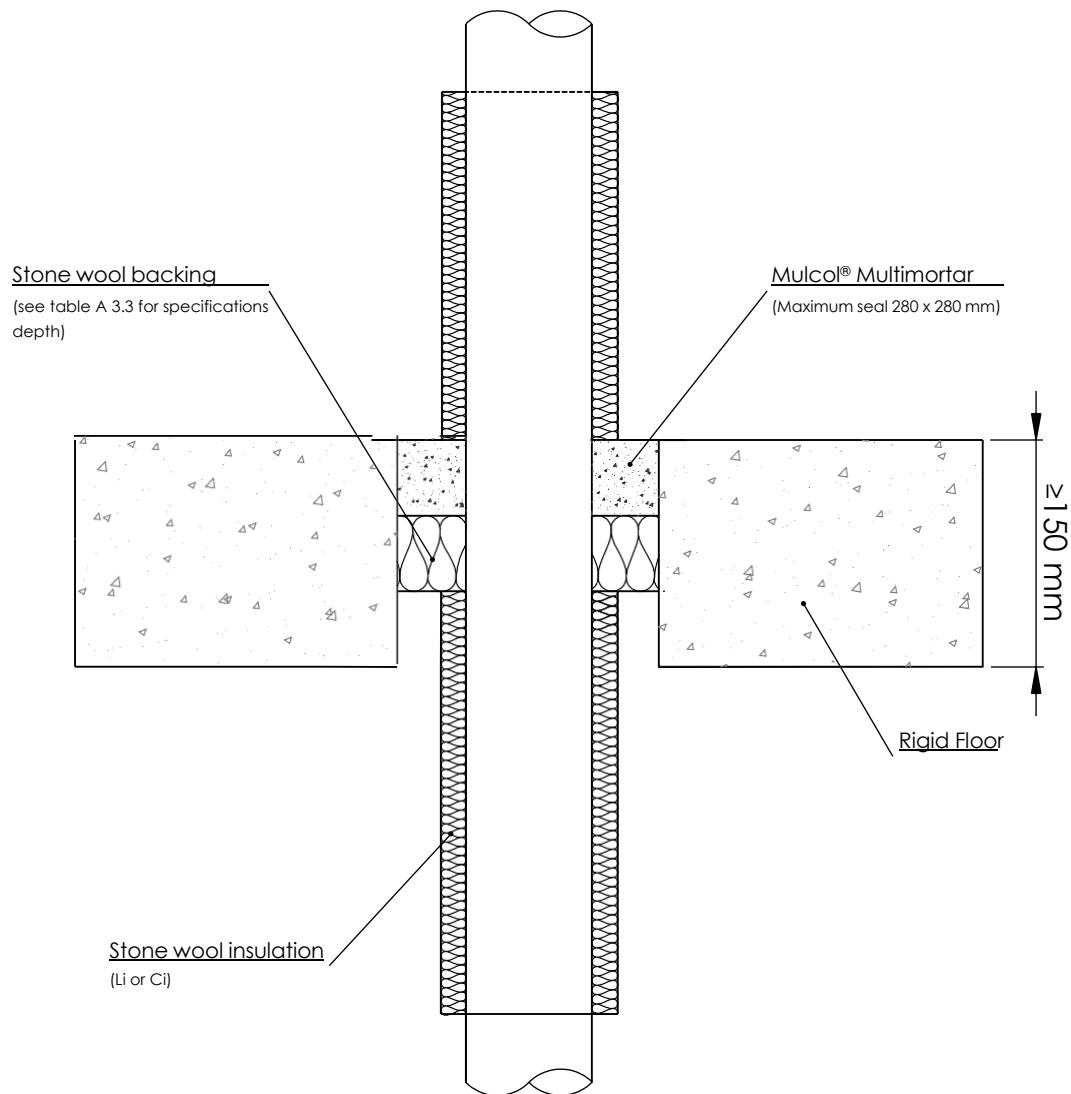

## A 3.3 Single side penetration seal with (stainless) steel pipes

Services	Classification	Position Mulcol® Multimortar	Backing	Insulation	Position services
Steel pipe 40 mm / 1-14.2 mm wall th.	EI 240 C/U	E 240 C/U, EI 90 C/U	Top side of the floor 50 mm thick	1000 mm length of 20 mm Stone wool insulation, 80 kg/m³  50 mm Stone wool insulation, 150 kg/m³  1000 mm length of 30 mm Stone wool insulation, 80 kg/m³	Service fitted at any position within the aperture (min. separation 30 mm from seal edges and 0 mm from other services)
Steel pipe Ø 40 mm / 1-14.2 mm wall th.					
Steel pipe Ø 50 mm / 1.2-14.2 mm wall th.					
Steel pipe Ø 60 mm / 1.4-14.2 mm wall th.					
Steel pipe Ø 75 mm / 1.7-14.2 mm wall th.					
Steel pipe Ø 90 mm / 2-14.2 mm wall th.					
Steel pipe Ø 100 mm / 2.2-14.2 mm wall th.					
Steel pipe Ø 115 mm / 2.5-14.2 mm wall th.					
Steel pipe Ø 140 mm / 3-14.2 mm wall th.					
Steel pipe Ø 165 mm / 3.5-14.2 mm wall th.					
Steel pipe Ø 180 mm / 3.8-14.2 mm wall th.					
Steel pipe Ø 200 mm / 4.2-14.2 mm wall th.					
Steel pipe Ø 219 mm / 4.5-14.2 mm wall th.					

See graph on page 39 for intermediate sizes

# Annex A - Resistance to fire classification - Mulcol® Multimortar


Fire test pipe penetration seal

Mulcol® Multimortar

Rigid floor construction according to I.2.2

**MULCOL**

**FIRE PROTECTION**



Scale : 1:5

Unit of measure : mm

Date : 6-4-2016


Company : Mulcol International B.V.

RF-PP-MM1.2.10

Department : Research & Development

A4

Draftsman : R.M.

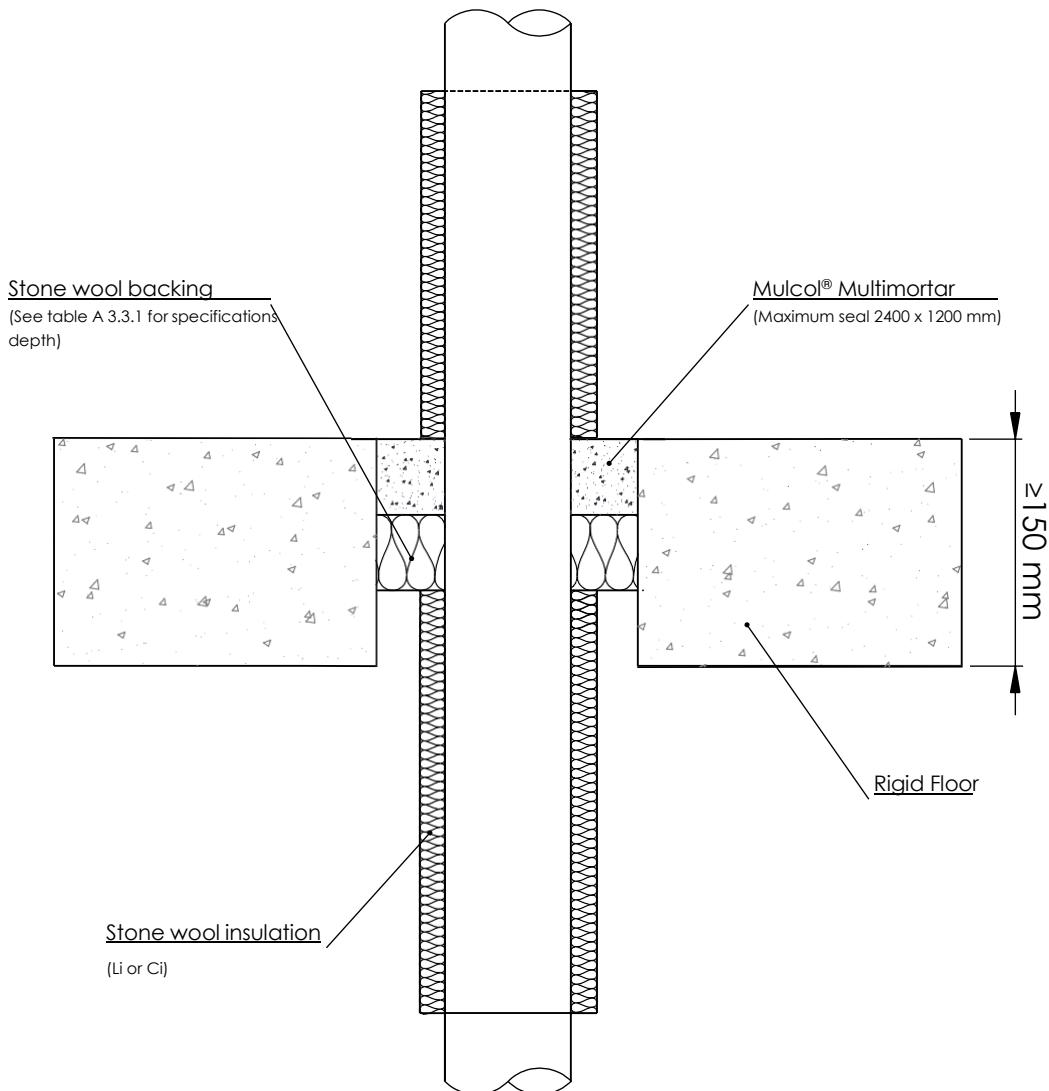

## A 3.3.1 Single side penetration seal with (stainless) steel pipes

Services	Classification	Position Mulcol® Multimortar	Backing	Insulation	Position of services
Steel pipe Ø 40 mm / 1-14.2 mm wall th.	EI 180 C/U			1000 mm length of 20 mm Stone wool insulation, 80 kg/m³	
Steel pipe Ø 40 mm / 1-14.2 mm wall th.					
Steel pipe Ø 50 mm / 1.2-14.2 mm wall th.					
Steel pipe Ø 60 mm / 1.4-14.2 mm wall th.					
Steel pipe Ø 75 mm / 1.7-14.2 mm wall th.					
Steel pipe Ø 90 mm / 2-14.2 mm wall th.					
Steel pipe Ø 100 mm / 2.2-14.2 mm wall th.					
Steel pipe Ø 115 mm / 2.5-14.2 mm wall th.					
Steel pipe Ø 140 mm / 3-14.2 mm wall th.					
Steel pipe Ø 165 mm / 3.5-14.2 mm wall th.					
Steel pipe Ø 180 mm / 3.8-14.2 mm wall th.					
Steel pipe Ø 200 mm / 4.2-14.2 mm wall th.					
Steel pipe Ø 219 mm / 4.5-14.2 mm wall th.					
See graph on page 39 for intermediate sizes					

# Annex A - Resistance to fire classification - Mulcol® Multimortar


Fire test pipe penetration seal

Mulcol® Multimortar

Rigid floor construction according to I.2.2

**MULCOL**

FIRE PROTECTION



Scale : 1:5

Unit of measure : mm

Date : 6-4-2016

Company : Mulcol International B.V.


RF-ST-MM1.2.10

Department : Research & Development

Draftsman : R.M.

A4

**Intermediate sizes**

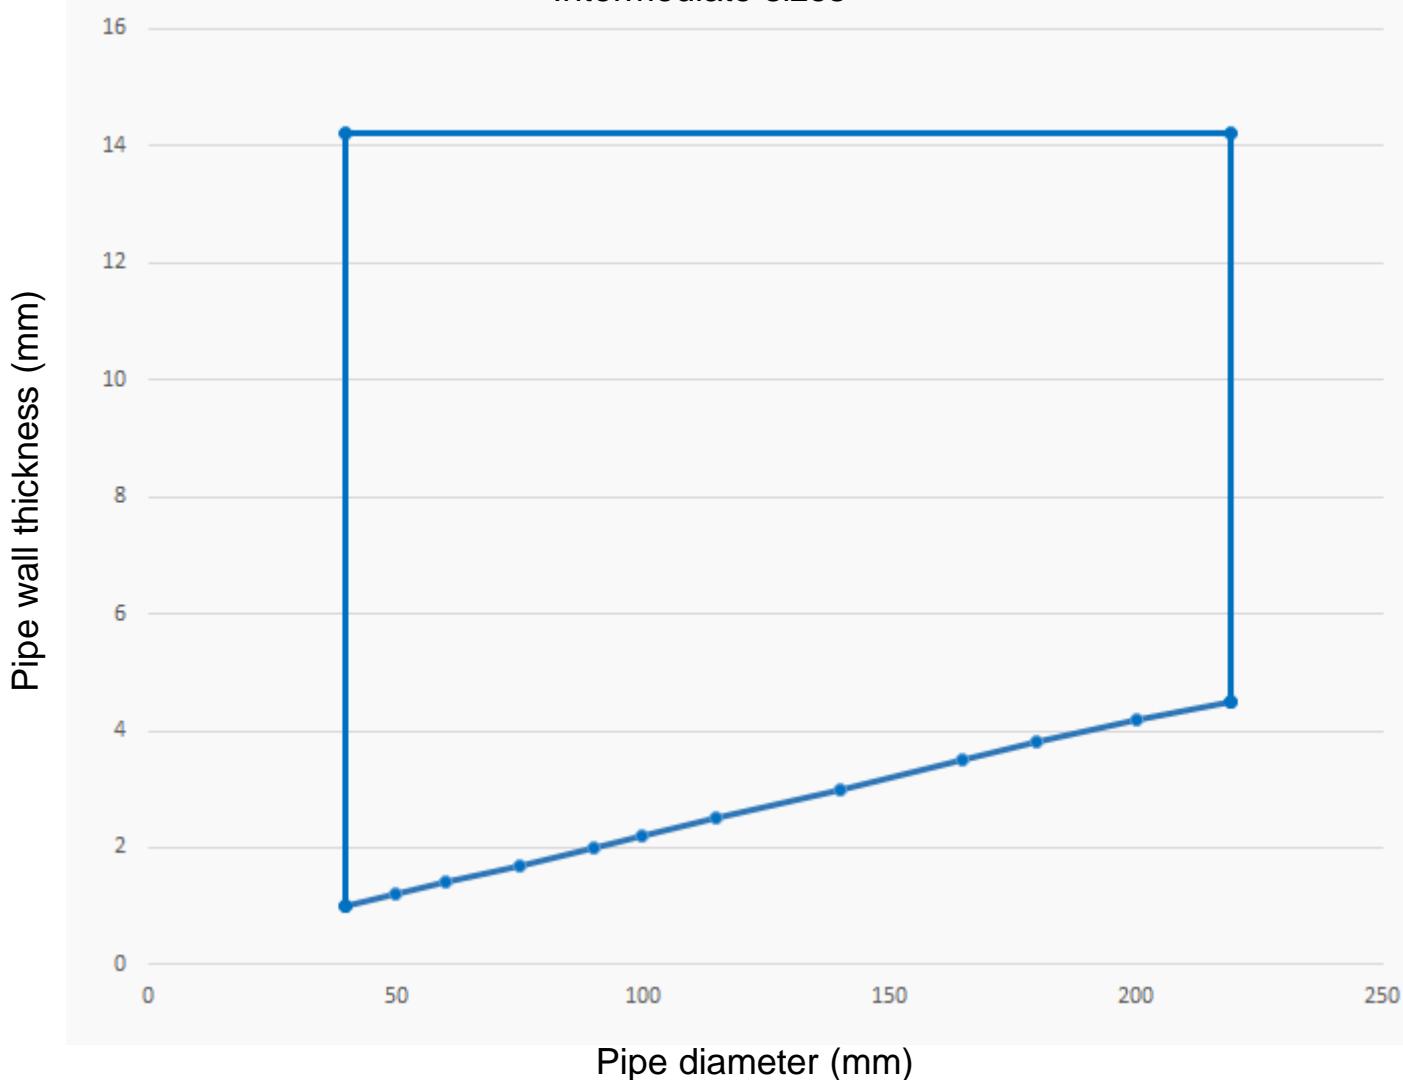

# Annex A - Resistance to fire classification - Mulcol® Multimortar


Fire test cable penetration seal

Mulcol® Multimortar

Rigid floor construction according to I.2.2

**MULCOL**

FIRE PROTECTION



Scale : 1:5

Unit of measure : mm

Date : 6-4-2016


Company : Mulcol International B.V.

RF-EC-MM1.2.10

Department : Research & Development

A4

Draftsman : R.M.

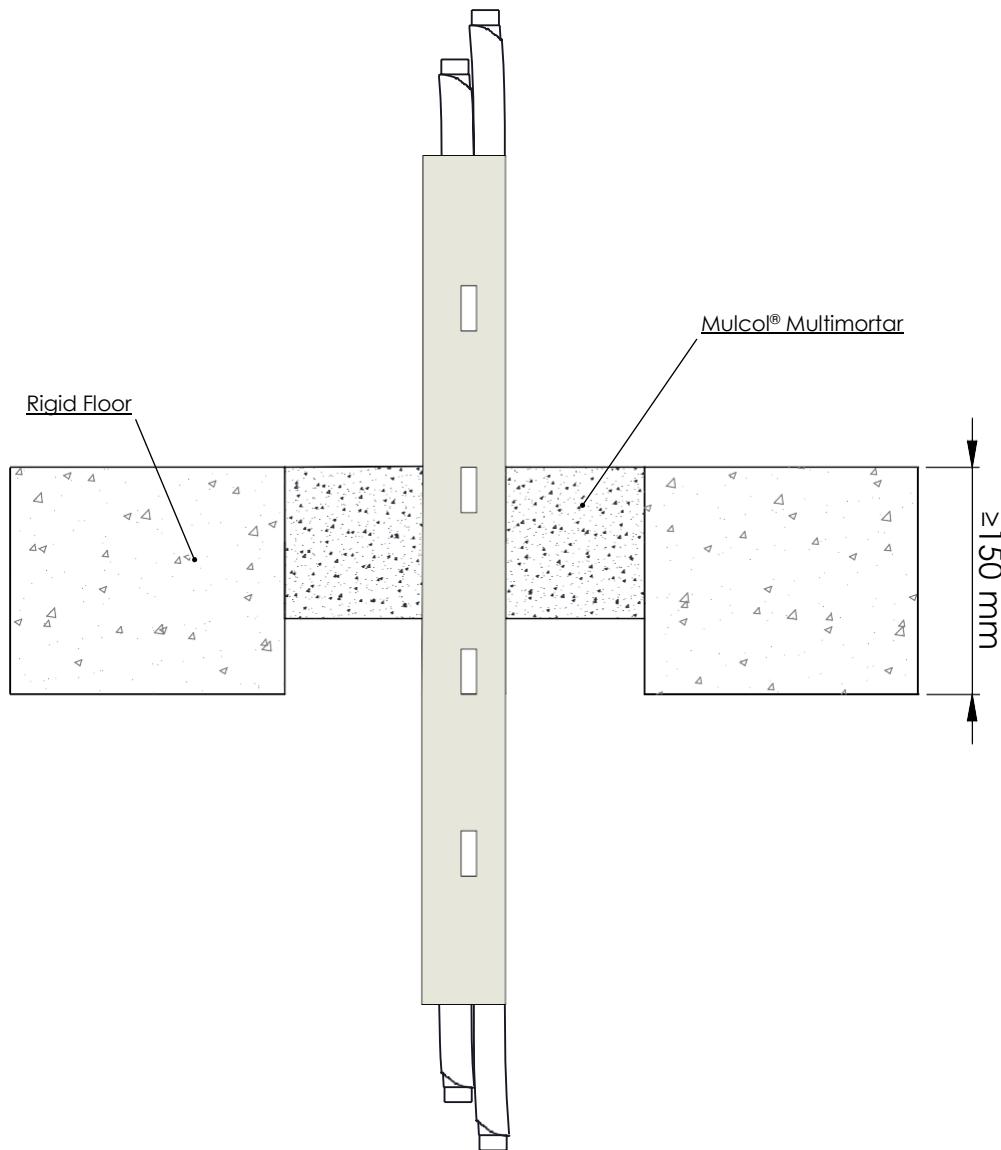

## A 3.4 Penetration seal with cables, trays and conduits

Services	Classification	Position Mulcol® Multimortar	Maximum seal	Position services
Blank seals	EI 240	Top side of the floor 100 mm thick	2400 x 1200 mm	Service fitted at any position within the aperture (min. separation 100 mm from seal edges and 0 mm from other services)
Electrical cables up to Ø 50 mm (single, bundled and on trays)	E 180, EI 60			
Electrical cables up to Ø 80 mm (single, bundled and on trays)	E 120, EI 60			
Telecommunication cables up to Ø 21 mm (single or bundles up to Ø 100mm)	E 180, EI 120			
Steel cable trays & ladders (perforated and none perforated)	E 120, EI 60			
Non-sheathed wires up to Ø17 mm	E 180, EI 90			
Non-sheathed wires up to Ø24 mm	E 180, EI 20			
PVC conduit up to Ø 16 mm	EI 180 C/U			

# Annex A - Resistance to fire classification - Mulcol® Multimortar


Fire test pipe penetration seal

Mulcol® Multimortar

Rigid floor construction according to I.2.2

**MULCOL**

FIRE PROTECTION



Scale : 1:5

Unit of measure : mm

Date : 6-4-2016


Company : Mulcol International B.V.

RF-PP-MM1.2.10

Department : Research & Development

A4

Draftsman : R.M.

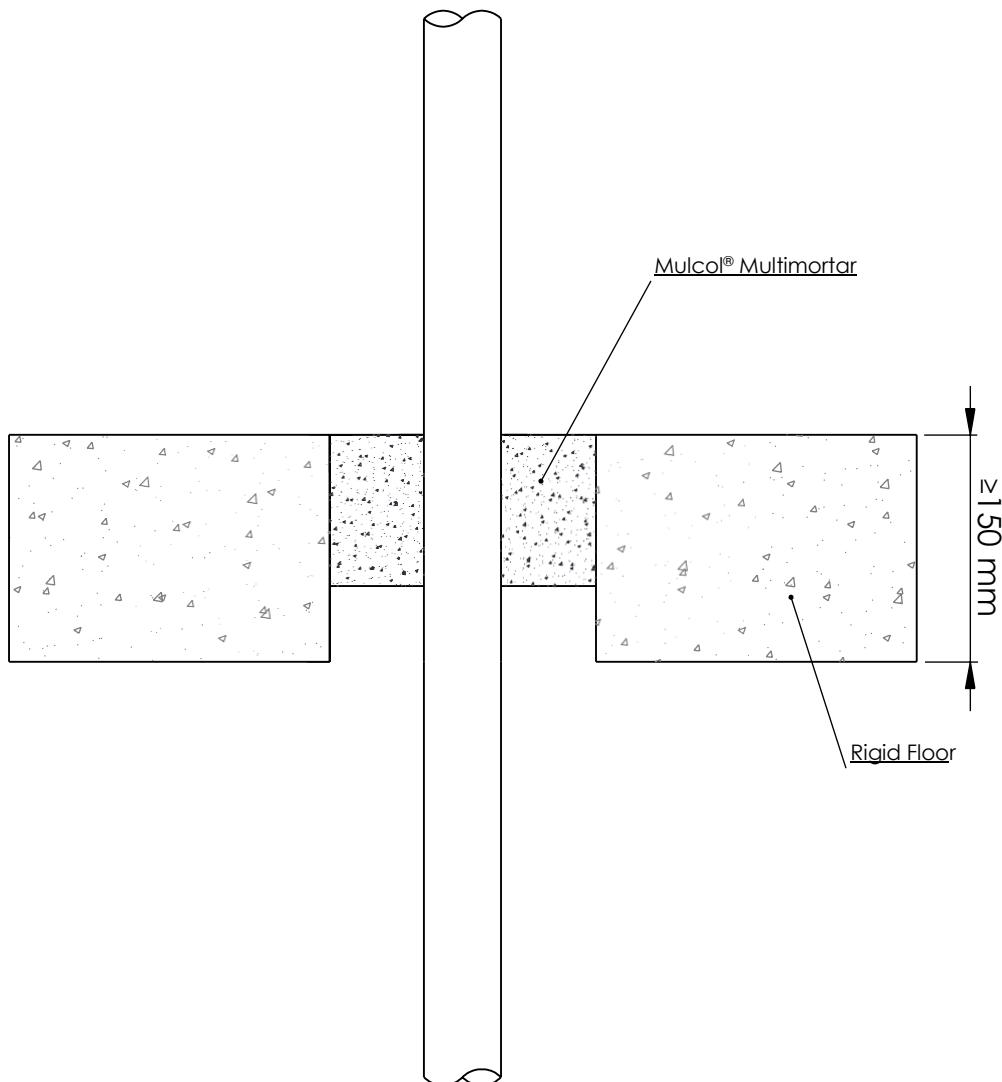

## A 3.5 Penetration seal with composite pipes

Services	Classification	Position Mulcol® Multimortar	Maximum seal	Position services
Alupex composite pipe Ø 75 mm / 4.6 mm wall thickness	E 240 U/C, EI 20 U/C	Top side of the floor 100 mm thick	2400 x 1200 mm	Service fitted at any position within the aperture (min. separation 30 mm from seal edges and 0 mm from other services)

# Annex A - Resistance to fire classification - Mulcol® Multimortar


Fire test pipe penetration seal

Mulcol® Multimortar

Rigid floor construction according to I.2.2

**MULCOL**

FIRE PROTECTION



Scale : 1:5

Unit of measure : mm

Date : 6-4-2016


Company : Mulcol International B.V.

RF-ST-MM1.2.20

Department : Research & Development

A4

Draftsman : R.M.

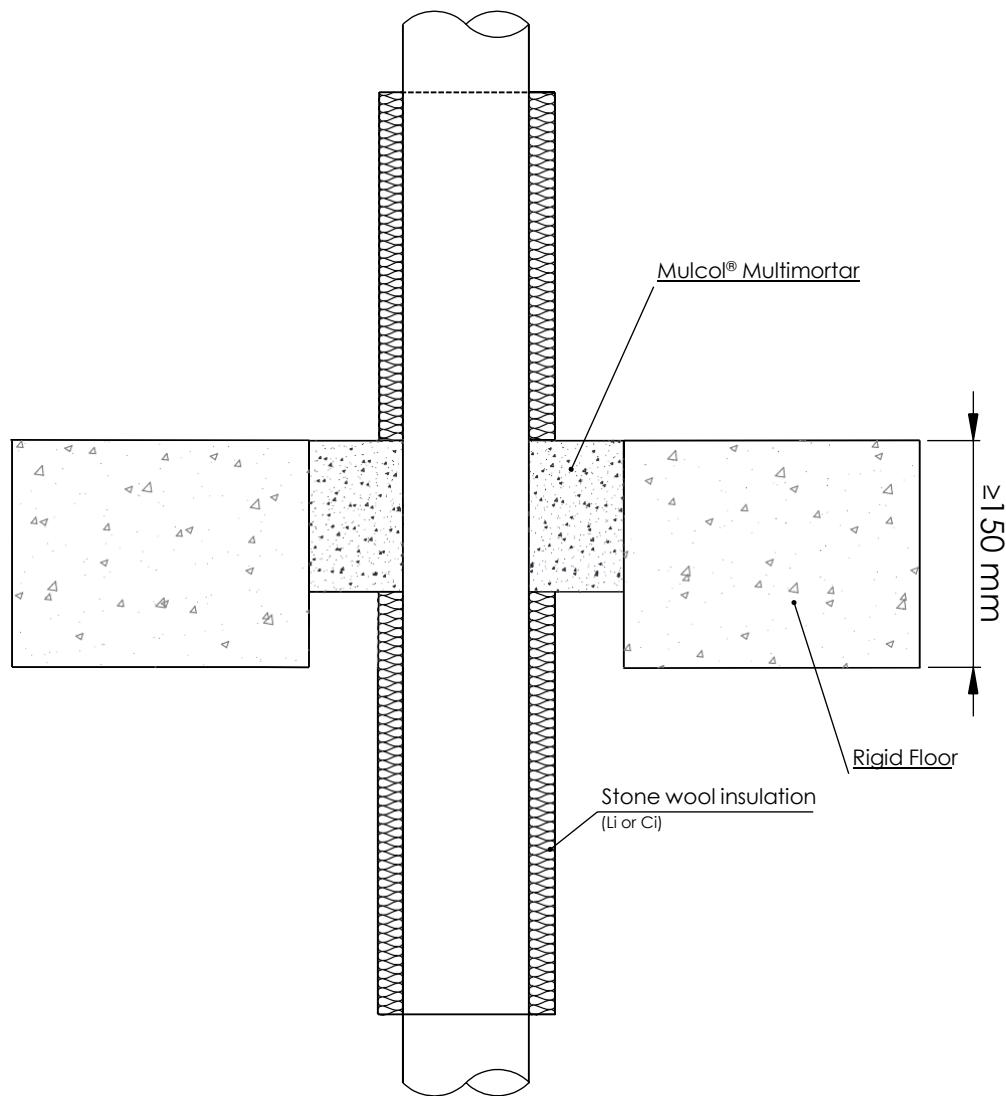

## A 3.6 Penetration seal with (stainless) steel pipes

Services	Classification	Position Mulcol® Multimortar	Insulation	Maximum seal	Position services			
Steel pipe Ø 40 mm / 1.5-14.2 mm wall th.	EI 240 C/U	Top side of the floor 100 mm thick	1000 mm length of 20 mm Stone wool insulation, 80 kg/m³	2400 x 1200 mm	Service fitted at any position within the aperture (min. separation 30 mm from seal edges and 0 mm from other services)			
Steel pipe Ø 40 mm / 1.5-14.2 mm wall th.	E 240 C/U, EI 120 C/U		1000 mm length of 30 mm Mineral wool insulation, 80 kg/m³					
Steel pipe Ø 50 mm / 1.7-14.2 mm wall th.								
Steel pipe Ø 60 mm / 1.8-14.2 mm wall th.								
Steel pipe Ø 75 mm / 2.1-14.2 mm wall th.								
Steel pipe Ø 90 mm / 2.3-14.2 mm wall th.								
Steel pipe Ø 100 mm / 2.5-14.2 mm wall th.								
Steel pipe Ø 115 mm / 2.8-14.2 mm wall th.								
Steel pipe Ø 140 mm / 3.2-14.2 mm wall th.								
Steel pipe Ø 165 mm / 3.6-14.2 mm wall th.								
Steel pipe Ø 180 mm / 3.9-14.2 mm wall th.								
Steel pipe Ø 200 mm / 4.2-14.2 mm wall th.								
Steel pipe Ø 219 mm / 4.5-14.2 mm wall th.								

See graph on page 43 for intermediate sizes

# Annex A - Resistance to fire classification - Mulcol® Multimortar


Fire test pipe penetration seal

Mulcol® Multimortar

Rigid floor construction according to I.2.2

**MULCOL**

FIRE PROTECTION



Scale : 1:5

Unit of measure : mm

Date : 6-4-2016

Company : Mulcol International B.V.


Department : Research & Development

Draftsman : R.M.

RF-ST-MM1.2.20


A4

**Intermediate sizes**

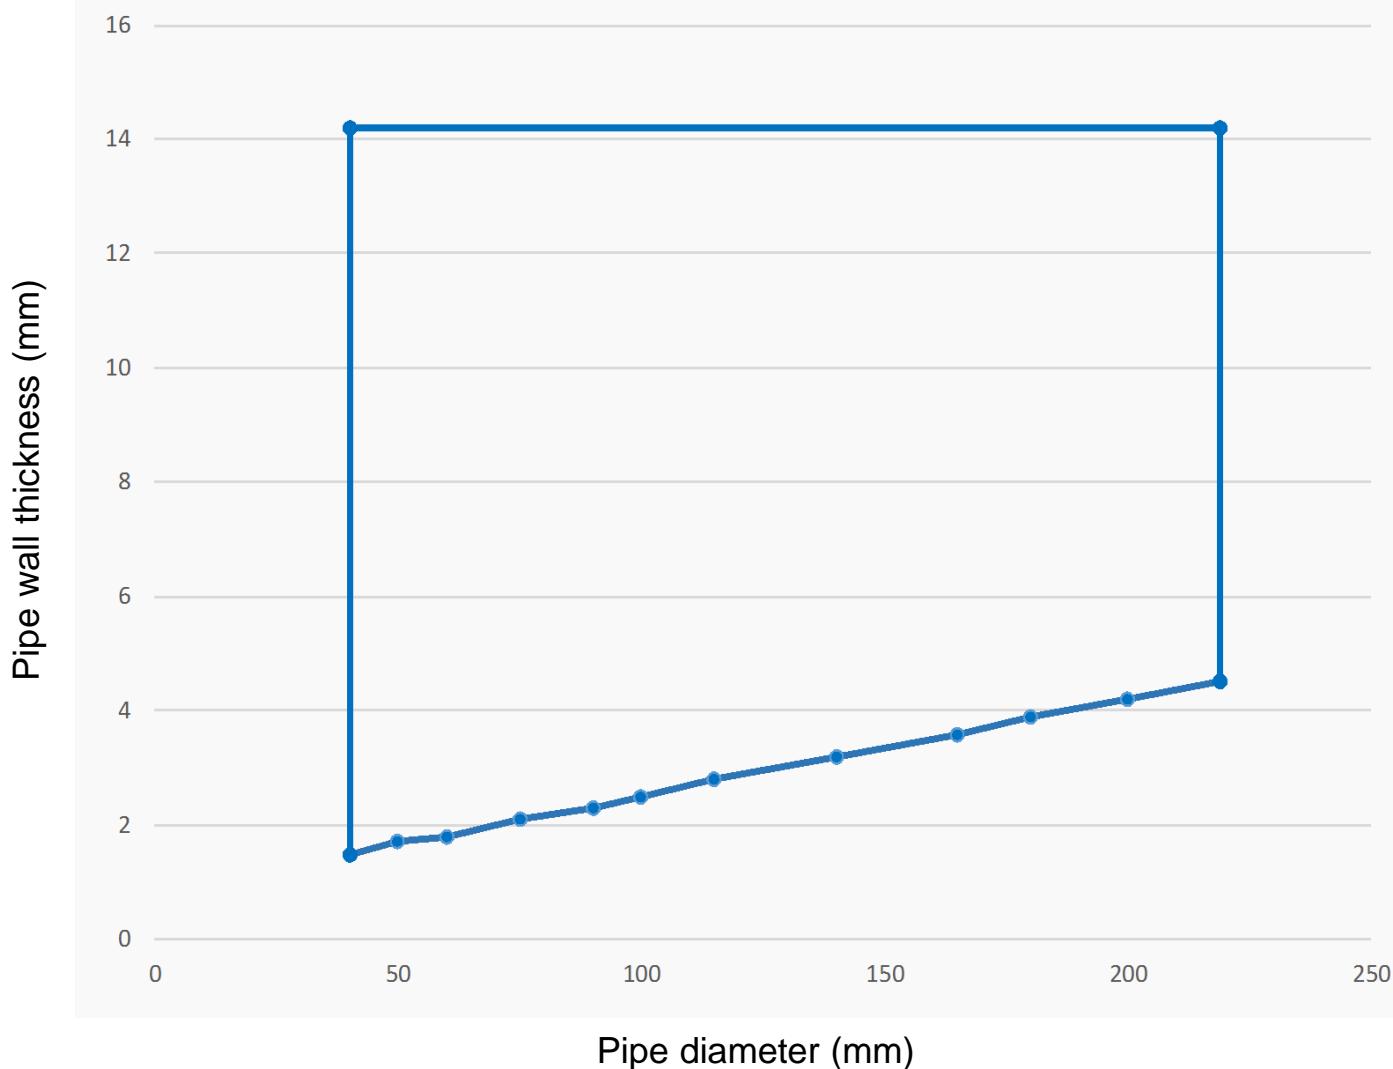

# Annex A - Resistance to fire classification - Mulcol® Multimortar

Fire test pipe penetration seal Mulcol® Multimortar Rigid floor construction according to I.2.2			
American projection	Scale : 1:5	Company : Mulcol International B.V.	RF-ST-MM1.2.20
	Unit of measure : mm	Department : Research & Development	
	Date : 6-4-2016	Draftsman : R.M.	A4

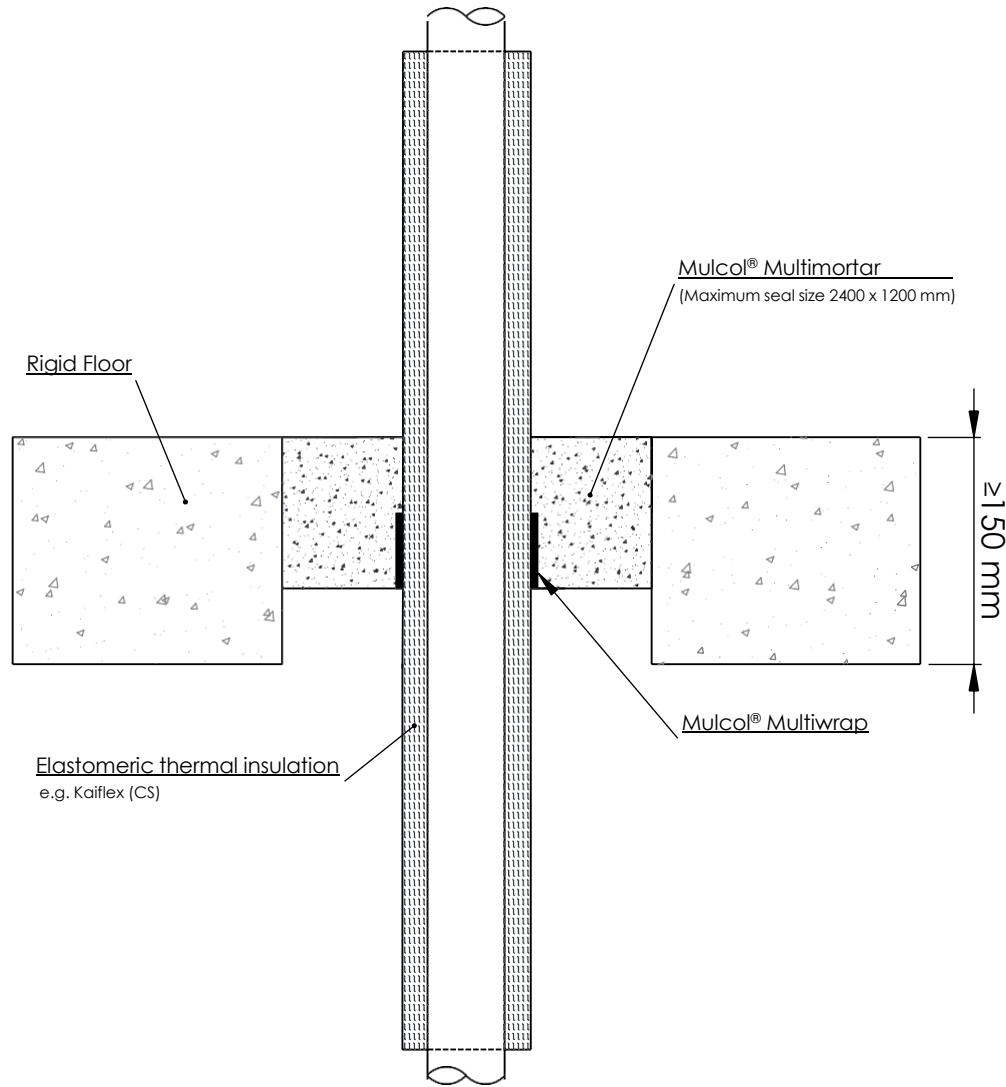

## A 3.7 Penetration seal with (stainless) steel pipes

Services	Classification	Position Mulcol® Multimortar	Insulation	Mulcol® Multiwrap	Position Services
Steel pipe Ø 40 mm / 0-14.2 mm wall th.	EI 180 C/U	Top side of the floor 100 mm thick	13 mm Kaiflex ST insulation	50 x 1.8 mm (1 layer) fitted at bottom of seal	Service fitted at any position within the aperture (min. separation 30 mm from seal edges and 30 mm from other services)
Steel pipe Ø 40 mm / 1.5-14.2 mm wall th.					
Steel pipe Ø 50 mm / 1.6-14.2 mm wall th.					
Steel pipe Ø 60 mm / 1.7-14.2 mm wall th.					
Steel pipe Ø 75 mm / 1.9-14.2 mm wall th.					
Steel pipe Ø 90 mm / 2-14.2 mm wall th.					
Steel pipe Ø 100 mm / 2.1-14.2 mm wall th.					
Steel pipe Ø 115 mm / 2.3-14.2 mm wall th.					
Steel pipe Ø 140 mm / 2.6-14.2 mm wall th.					
Steel pipe Ø 165 mm / 2.8-14.2 mm wall th.					

See graph on page 45 for intermediate sizes

# Annex A - Resistance to fire classification - Mulcol® Multimortar

Fire test pipe penetration seal


Mulcol® Multimortar

Rigid floor construction according to I.2.2

**MULCOL**

FIRE PROTECTION

American projection



Scale : 1:5

Unit of measure : mm

Date : 6-4-2016


Company : Mulcol International B.V.

RF-ST-MM1.2.20

Department : Research & Development

Draftsman : R.M.

A4

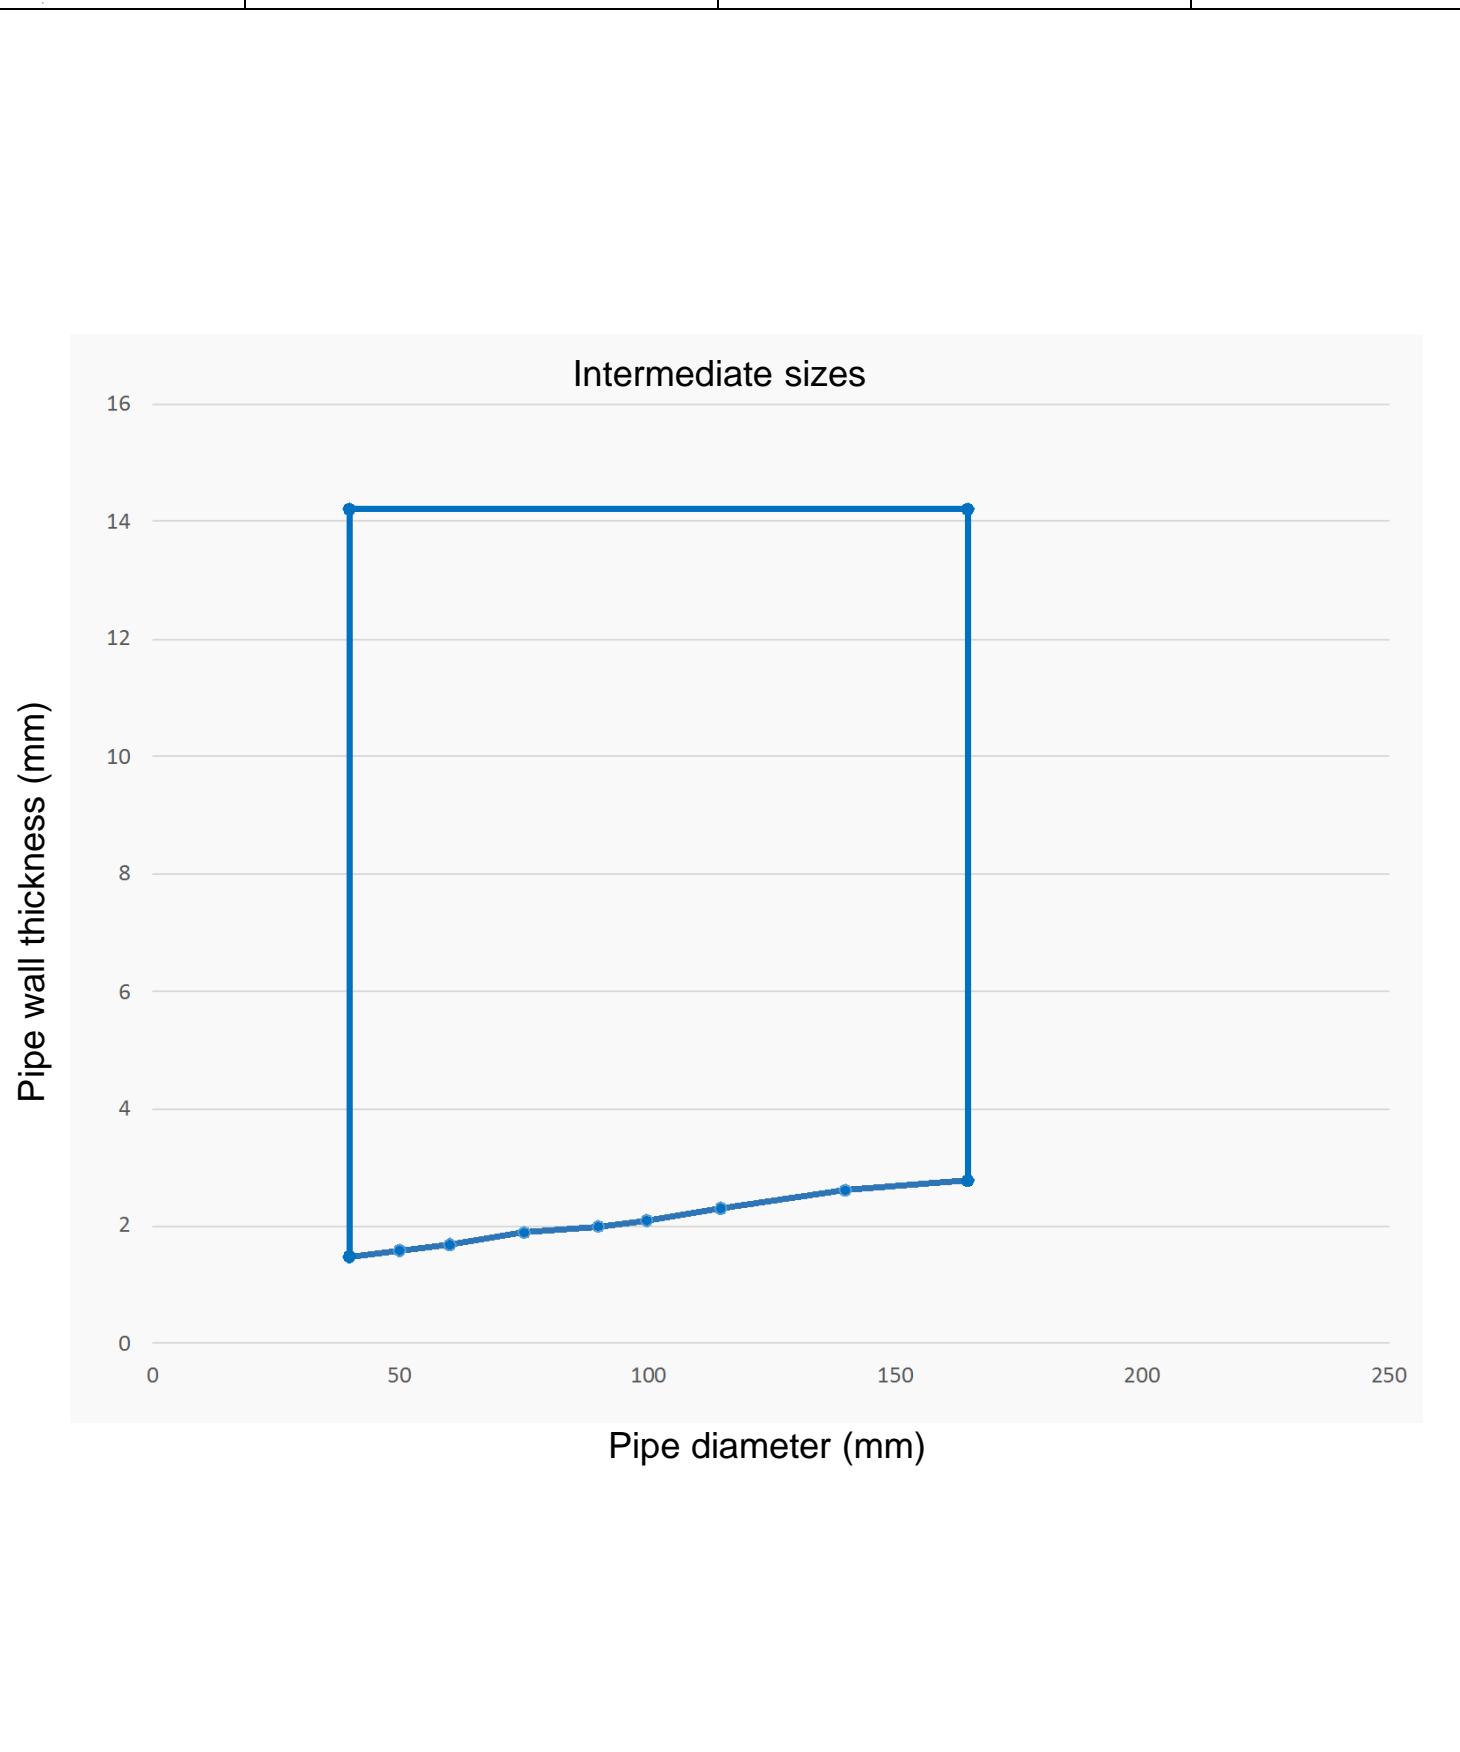

# Annex A - Resistance to fire classification - Mulcol® Multimortar


Fire test pipe penetration seal

Mulcol® Multimortar

Rigid floor construction according to I.2.2

**MULCOL**

**FIRE PROTECTION**



Scale : 1:5

Unit of measure : mm

Date : 8-2-2018

Company : Mulcol International B.V.


RF-ST-MM1.2.20

Department : Research & Development

A4

Draftsman : K.J.

Option 1

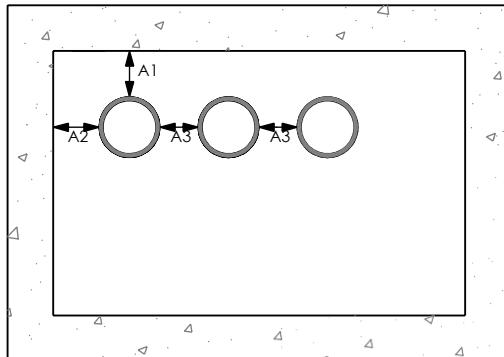


A1 : Pipe / top edge of seal separation min. 30 mm

A2 : Pipe / side edge of seal separation min. 30 mm

A3 : Pipe / pipe separation min. 30 mm


Option 2

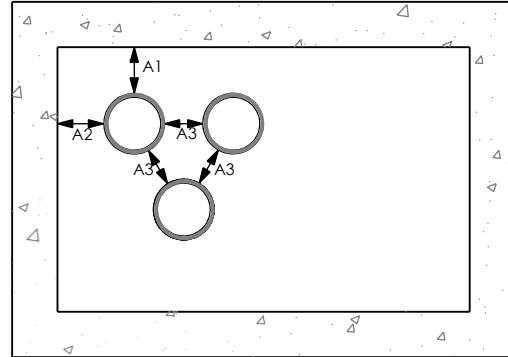

A1 : Pipe / top edge of seal separation min. 30 mm

A2 : Pipe / side edge of seal separation min. 30 mm

A3 : Pipe / pipe separation min. 30 mm

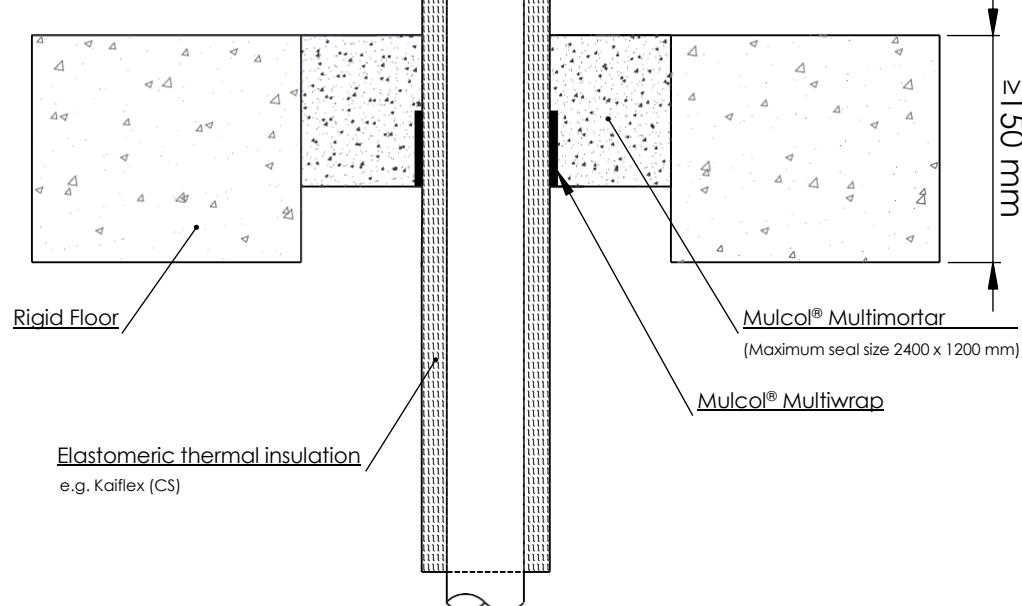

## A 3.7.1 Penetration seal with (stainless) steel pipes

Services	Classification	Position Mulcol® Multimortar	Insulation	Mulcol® Multiwrap	Position Services
Steel pipe Ø 40 mm / 1-14.2 mm wall th.	EI 240 C/U				
Steel pipe Ø 40 mm / 1-14.2 mm wall th.					
Steel pipe Ø 50 mm / 1.2-14.2 mm wall th.					
Steel pipe Ø 60 mm / 1.4-14.2 mm wall th.					
Steel pipe Ø 75 mm / 1.6-14.2 mm wall th.					
Steel pipe Ø 90 mm / 1.9-14.2 mm wall th.					
Steel pipe Ø 100 mm / 2.1-14.2 mm wall th.					
Steel pipe Ø 115 mm / 2.4-14.2 mm wall th.					
Steel pipe Ø 140 mm / 2.9-14.2 mm wall th.					
Steel pipe Ø 165 mm / 3.4-14.2 mm wall th.					
Steel pipe Ø 180 mm / 3.6-14.2 mm wall th.					
Steel pipe Ø 200 mm / 4.0-14.2 mm wall th.					
Steel pipe Ø 219 mm / 4.3-14.2 mm wall th.					
Steel pipe Ø 250 mm / 5.0-14.2 mm wall th.					
Steel pipe Ø 300 mm / 5.9-14.2 mm wall th.					
Steel pipe Ø 324 mm / 6.35-14.2 mm wall th.					
See graph on page 48 for intermediate sizes					

# Annex A - Resistance to fire classification - Mulcol® Multimortar


Fire test pipe penetration seal

Mulcol® Multimortar

Rigid floor construction according to I.2.2

**MULCOL**

**FIRE PROTECTION**



Scale : 1:5

Unit of measure : mm

Date : 8-2-2018

Company : Mulcol International B.V.


RF-ST-MM1.2.20

Department : Research & Development

A4

Draftsman : K.J.

Option 1

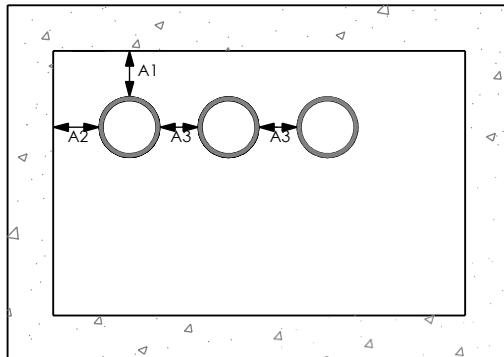


A1 : Pipe / top edge of seal separation min. 30 mm

A2 : Pipe / side edge of seal separation min. 30 mm

A3 : Pipe / pipe separation min. 30 mm


Option 2

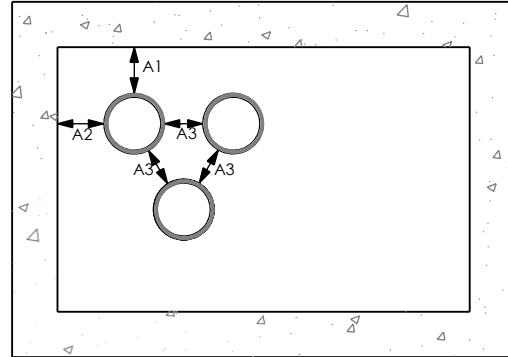

A1 : Pipe / top edge of seal separation min. 30 mm

A2 : Pipe / side edge of seal separation min. 30 mm

A3 : Pipe / pipe separation min. 30 mm

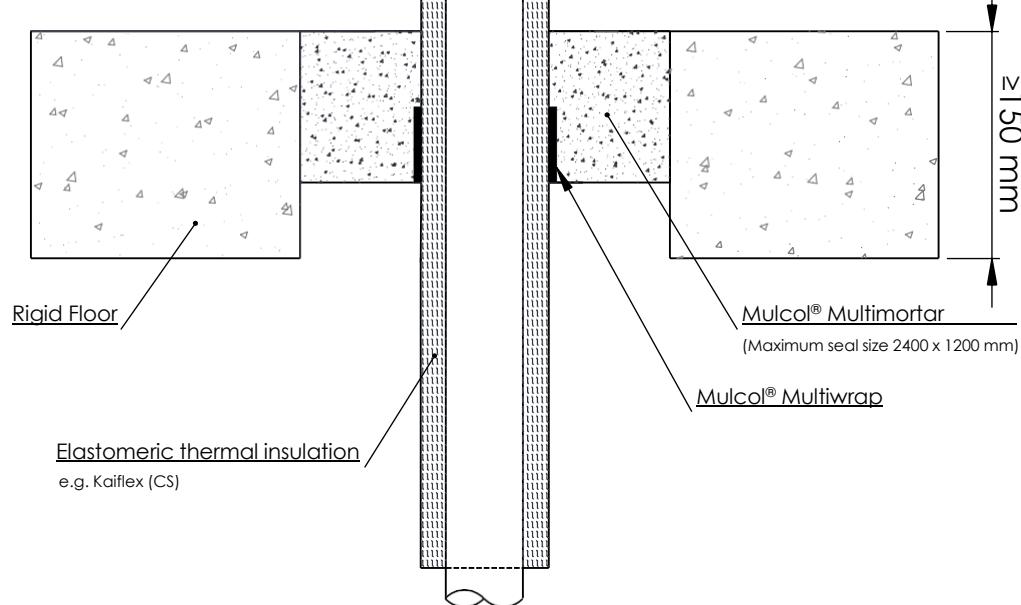

## A 3.7.2 Penetration seal with (stainless) steel pipes

Services	Classification	Position Mulcol® Multimortar	Insulation	Mulcol® Multiwrap	Position Services
Steel pipe Ø 40 mm / 1-14.2 mm wall th.	EI 120 C/U	Top side of the floor 100 mm thick	25-50 mm Kaiflex insulation	50 x 5.4 mm (3 layer) fitted at bottom of seal	Service fitted at any position within the aperture (min. separation 30 mm from seal edges and 30 mm from other services)
Steel pipe Ø 50 mm / 1.2-14.2 mm wall th.					
Steel pipe Ø 60 mm / 1.4-14.2 mm wall th.					
Steel pipe Ø 75 mm / 1.6-14.2 mm wall th.					
Steel pipe Ø 90 mm / 1.9-14.2 mm wall th.					
Steel pipe Ø 100 mm / 2.1-14.2 mm wall th.					
Steel pipe Ø 115 mm / 2.4-14.2 mm wall th.					
Steel pipe Ø 140 mm / 2.9-14.2 mm wall th.					
Steel pipe Ø 165 mm / 3.4-14.2 mm wall th.					
Steel pipe Ø 180 mm / 3.6-14.2 mm wall th.					
Steel pipe Ø 200 mm / 4.0-14.2 mm wall th.					
Steel pipe Ø 219 mm / 4.3-14.2 mm wall th.					
Steel pipe Ø 250 mm / 5.0-14.2 mm wall th.					
Steel pipe Ø 300 mm / 5.9-14.2 mm wall th.					
Steel pipe Ø 324 mm / 6.35-14.2 mm wall th.					

See graph on page 48 for intermediate sizes

# Annex A - Resistance to fire classification - Mulcol® Multimortar


Fire test pipe penetration seal

Mulcol® Multimortar

Rigid floor construction according to I.2.2

**MULCOL**

FIRE PROTECTION



Scale : 1:5

Unit of measure : mm

Date : 8-2-2016

Company : Mulcol International B.V.


RF-ST-MM1.2.20

Department : Research & Development

Draftsman : K.J.

A4

**Intermediate sizes**

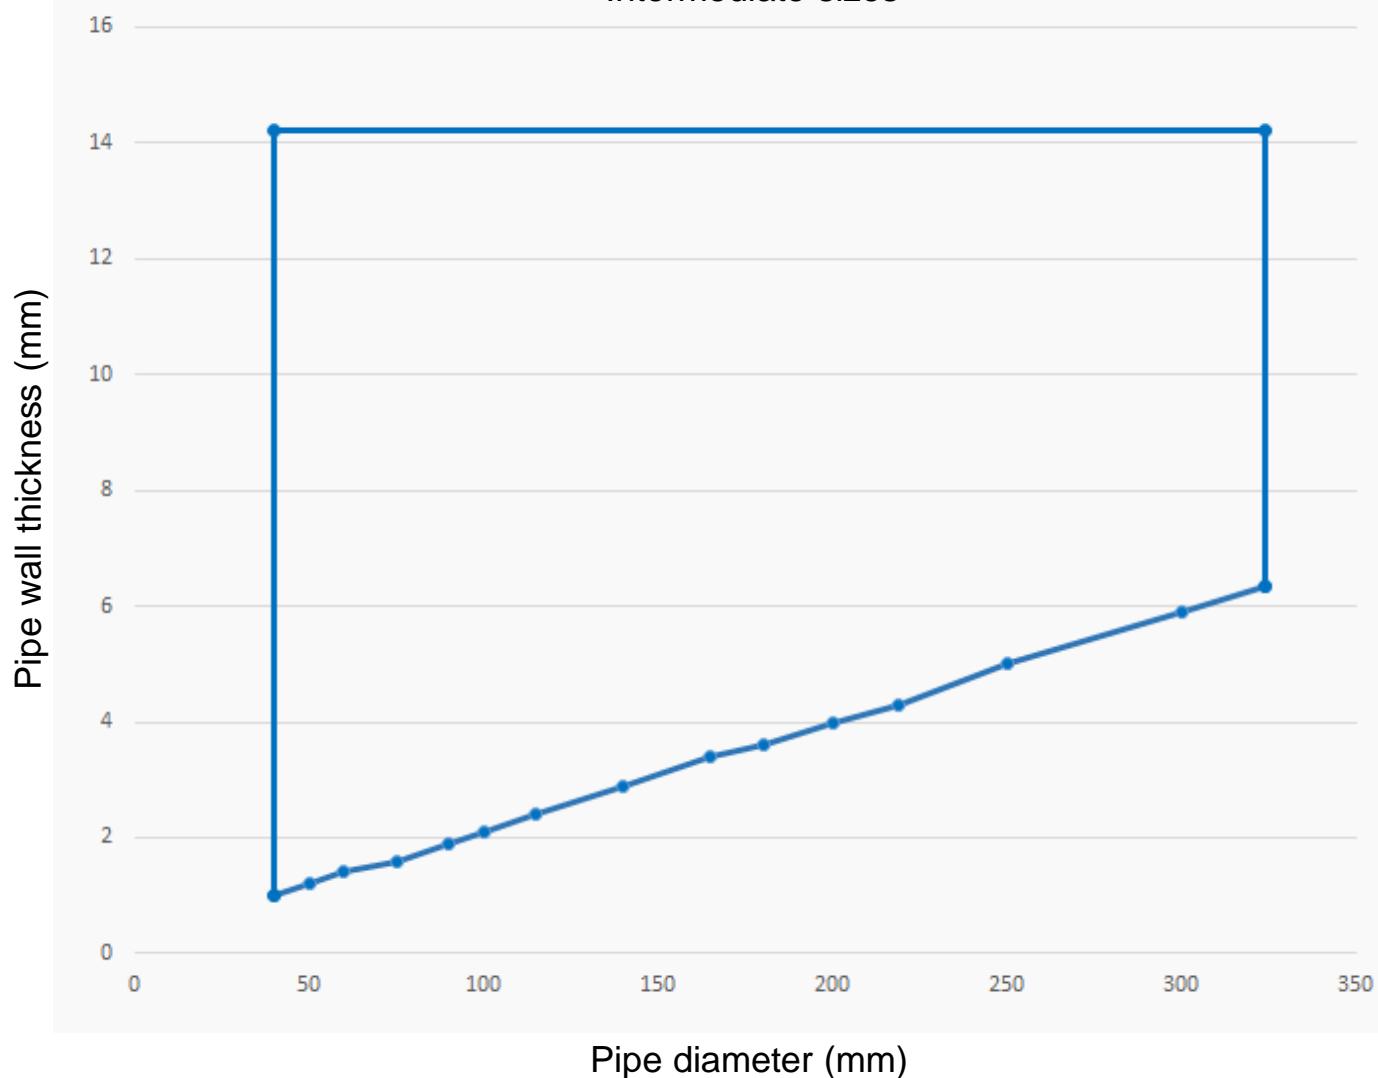

# Annex A - Resistance to fire classification - Mulcol® Multimortar


Fire test cable penetration seal

Mulcol® Multimortar

Rigid floor construction according to I.2.2

**MULCOL**

FIRE PROTECTION



Scale : 1:5

Unit of measure : mm

Date : 6-4-2016

Company : Mulcol International B.V.


RF-PP-MM1.5.10

Department : Research & Development

Draftsman : R.M.

A4

Option 1

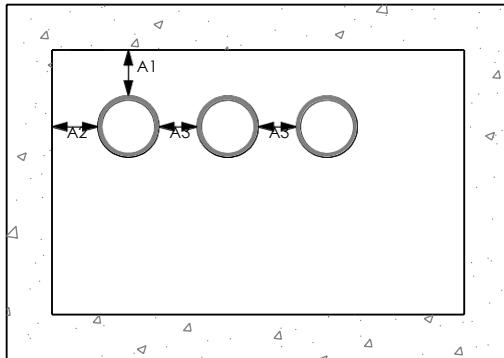


A1 : Pipe / top edge of seal separation min. 30 mm

A2 : Pipe / side edge of seal separation min. 30 mm

A3 : Pipe / pipe separation min. 30 mm


Option 2

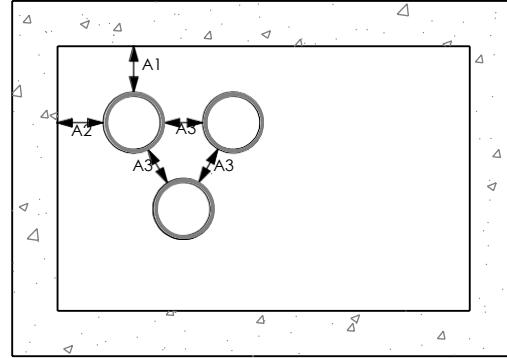


A1 : Pipe / top edge of seal separation min. 30 mm

A2 : Pipe / side edge of seal separation min. 30 mm

A3 : Pipe / pipe separation min. 30 mm

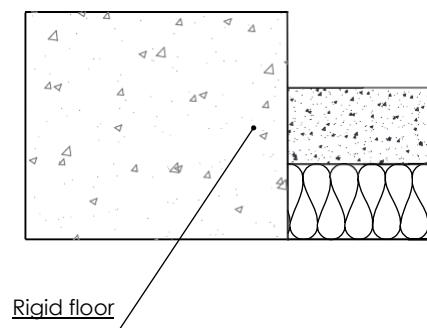

Rigid floor

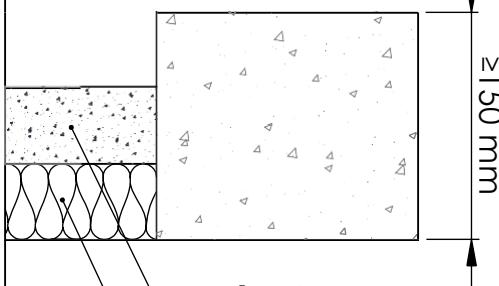

Mulcol® Multimortar

Stone wool backing

(See table A 3.8 for specifications depth)

## A 3.8 Single side penetration seal with combustible pipes

Services	Classification	Position Mulcol® Multimortar	Backing	Configuration	Maximum seal
<b>PVC-U pipe according to EN 1329-1, EN 1452 and EN 1453-1**, PVC-C according to EN 1566-1</b>					
Ø 16 mm / 1.6 - 3.4 mm wall th. up to Ø 40 mm / 1.9 - 3.0 mm wall th.	EI 120 U/C	To either side of the floor 50 mm thick	50 mm Stone wool insulation, 150 kg/m³	1 & 2 between all specified pipes	2400 x 1200 mm

# Annex A - Resistance to fire classification - Mulcol® Multimortar


Fire test pipe penetration seal

Mulcol® Multimortar

Rigid floor construction according to I.2.2

**MULCOL**

**FIRE PROTECTION**



Scale : 1:5

Unit of measure : mm

Date : 8-2-2018

Company : Mulcol International B.V.


RF-PP-MM1.2.10

Department : Research & Development

A4

Draftsman : K.J.

Option 1

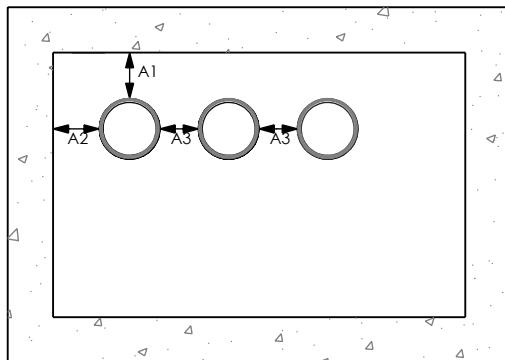


A1 : Pipe / top edge of seal separation min. 30 mm

A2 : Pipe / side edge of seal separation min. 30 mm

A3 : Pipe / pipe separation min. 30 mm


Option 2

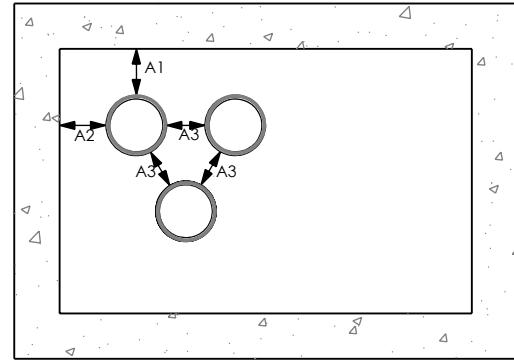

A1 : Pipe / top edge of seal separation min. 30 mm

A2 : Pipe / side edge of seal separation min. 30 mm

A3 : Pipe / pipe separation min. 30 mm

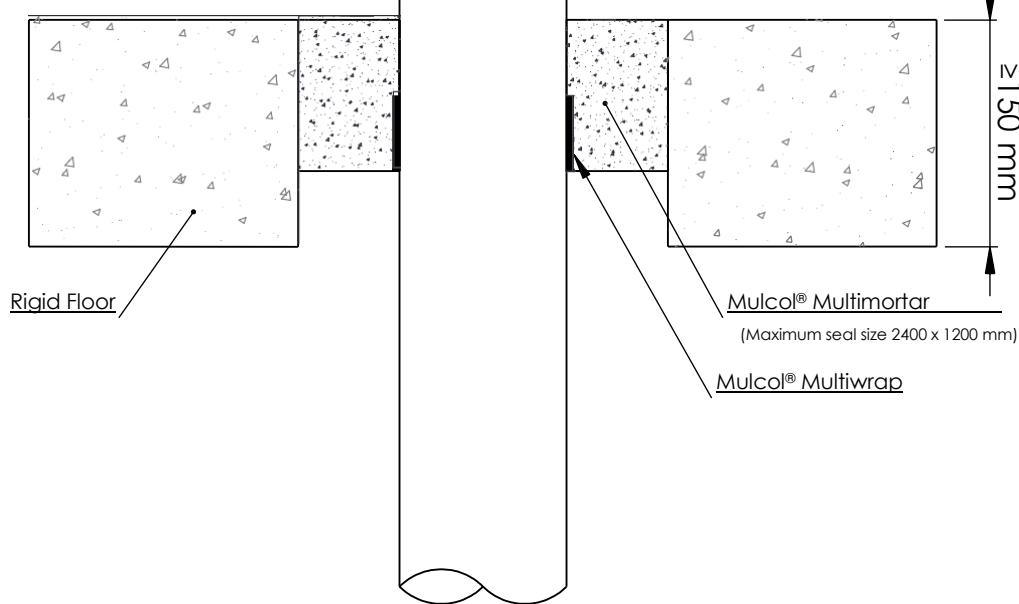

## A 3.9 Penetration seal with combustible pipes

Services	Classification	Position Mulcol® Multimortar	Maximum seal	Mulcol® Multiwrap (fitted at bottom of seal)	Position Services		
<b>PP pipe according to EN 1451-1</b>							
Up to $\varnothing$ 40 mm / 1.8-4.4 mm wall th.	EI 120 U/C	Either surface of the floor or anywhere in between	2400 x 1200 mm	None	Service fitted at any position within the aperture (min. separation 30 mm from seal edges and 30 mm from other services)		
Up to $\varnothing$ 40 mm / 1.8-5.5 mm wall th.	EI 120 U/U			50 x 1.8 mm (1 layer)			
Up to 110 mm / 2.7-6.3 mm wall th.	EI 240 U/C			50 x 3.6 mm (2 layers)			
Up to 125 mm / 3.4-11.4 mm wall th.				50 x 7.2 mm (4 layers)			
Up to $\varnothing$ 160 mm / 4.9-14.6 mm wall th.				50 x 10.8 mm (6 layers)			
Up to $\varnothing$ 110 mm / 3.4-6.3 mm wall th., containing telecom cables up to $\varnothing$ 14 mm (bundled up to $\varnothing$ 90 mm)	EI 60 U/C			50 x 3.6 mm (2 layers)			

# Annex A - Resistance to fire classification - Mulcol® Multimortar


Fire test pipe penetration seal

Mulcol® Multimortar

Rigid floor construction according to I.2.2

**MULCOL**

**FIRE PROTECTION**



Scale : 1:5

Unit of measure : mm

Date : 8-2-2018

Company : Mulcol International B.V.


RF-PP-MM1.2.10

Department : Research & Development

A4

Draftsman : K.J.

Option 1

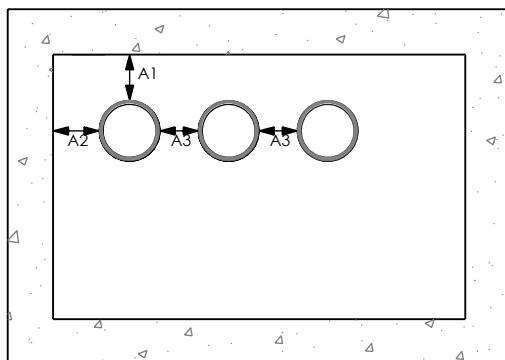


A1 : Pipe / top edge of seal separation min. 30 mm

A2 : Pipe / side edge of seal separation min. 30 mm

A3 : Pipe / pipe separation min. 30 mm


Option 2

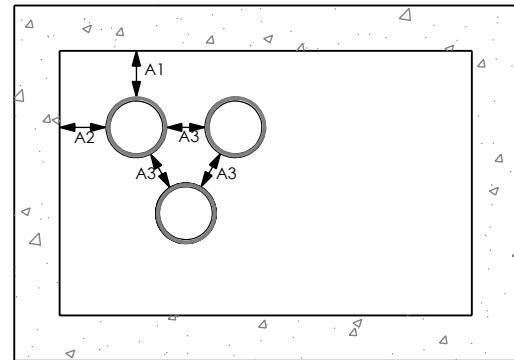

A1 : Pipe / top edge of seal separation min. 30 mm

A2 : Pipe / side edge of seal separation min. 30 mm

A3 : Pipe / pipe separation min. 30 mm

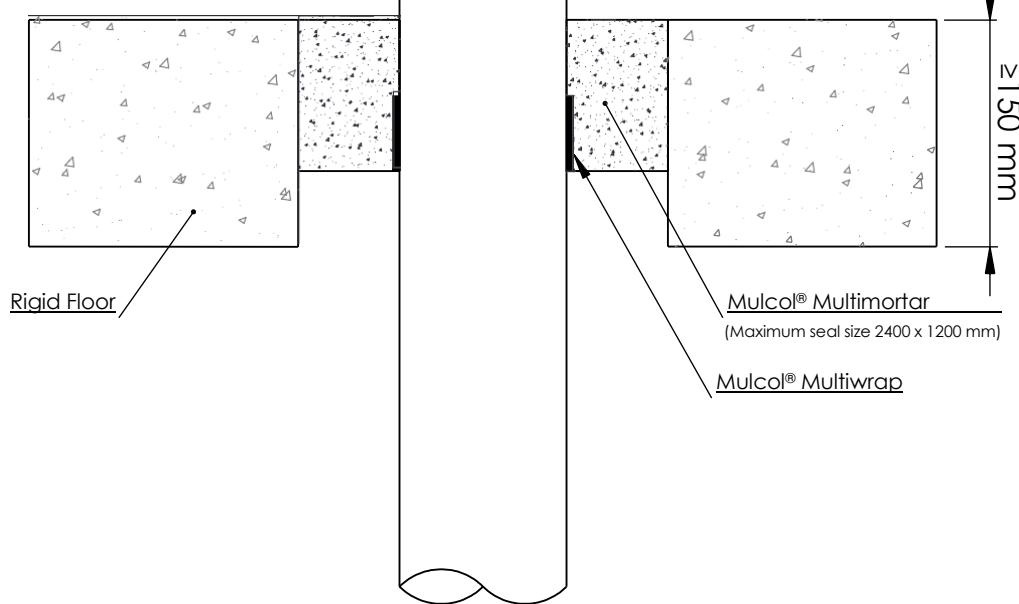

## A 3.9.1 Penetration seal with combustible pipes

Services	Classification	Position Mulcol® Multimortar	Maximum seal	Mulcol® Multiwrap (fitted at bottom of seal)	Position Services
<b>PE pipe according to EN 1519-1, EN 12201-2 and EN 12666-1, ABS according to EN 1455-1 and pipes made from SAN+PVC according to EN 1565-1</b>					
Up to $\varnothing$ 40 mm / 2.0-4.4 mm wall th.	EI 120 U/C	Either surface of the floor or anywhere in between	2400 x 1200 mm	None	Service fitted at any position within the aperture (min. separation 30 mm from seal edges and 30 mm from other services)
Up to $\varnothing$ 40 mm / 2.4-3.7 mm wall th.	EI 240 U/U			50 x 1.8 mm (1 layer)	
Up to 110 mm / 3.4-10.0 mm wall th.	EI 120 U/C			50 x 3.6 mm (2 layers)	
Up to 125 mm / 3.9-11.4 mm wall th.	EI 240 U/C			50 x 7.2 mm (4 layers)	
Up to $\varnothing$ 160 mm / 4.9-14.6 mm wall th.	EI 120 U/C			50 x 10.8 mm (6 layers)	
Up to $\varnothing$ 110 mm / 2.7-10.0 mm wall th., containing telecom cables up to $\varnothing$ 14 mm (bundled up to $\varnothing$ 90 mm)	E 120 U/C, EI 60 U/C			50 x 3.6 mm (2 layers)	

# Annex A - Resistance to fire classification - Mulcol® Multimortar


Fire test pipe penetration seal

Mulcol® Multimortar

Rigid floor construction according to I.2.2

**MULCOL**

**FIRE PROTECTION**



Scale : 1:5

Unit of measure : mm

Date : 8-2-2018

Company : Mulcol International B.V.


RF-PP-MM1.2.10

Department : Research & Development

A4

Draftsman : K.J.

Option 1

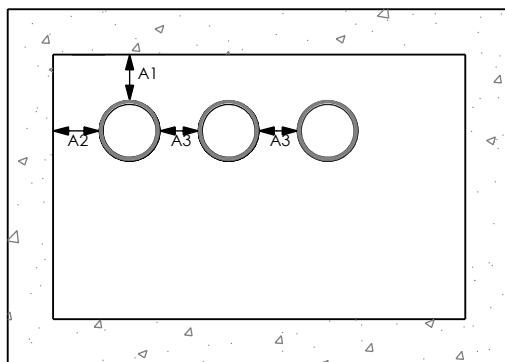


A1 : Pipe / top edge of seal separation min. 30 mm

A2 : Pipe / side edge of seal separation min. 30 mm

A3 : Pipe / pipe separation min. 30 mm


Option 2

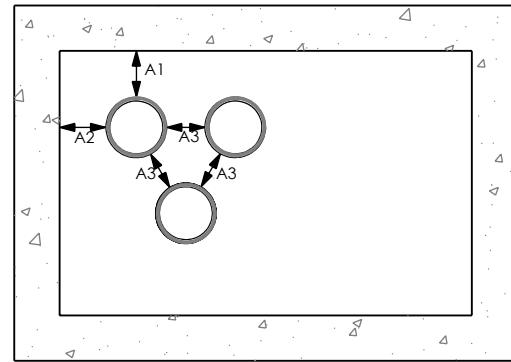

A1 : Pipe / top edge of seal separation min. 30 mm

A2 : Pipe / side edge of seal separation min. 30 mm

A3 : Pipe / pipe separation min. 30 mm

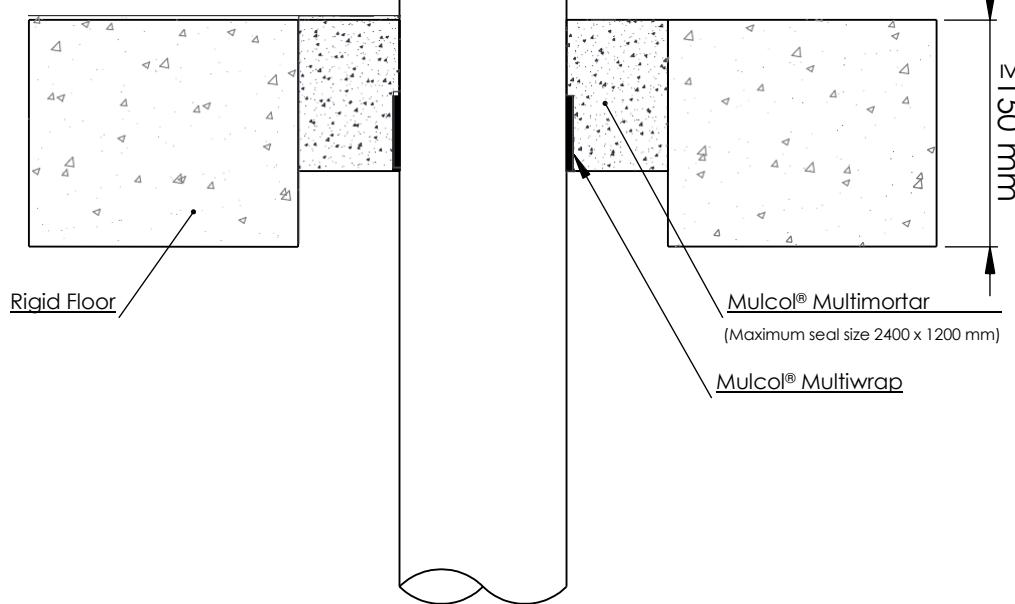

## A 3.9.2 Penetration seal with combustible pipes

Services	Classification	Position Mulcol® Multimortar	Maximum seal	Mulcol® Multiwrap (fitted at bottom of seal)	Position Services		
<b>PVC-U pipe according to EN 1329-1, EN 1452-1 and EN 1453-1, PVC-C according to EN 1566-1</b>							
Up to Ø 40 mm / 1.8-3.7 mm wall th.	E 180 U/U, EI 120 U/U	Either surface of the floor or anywhere in between	2400 x 1200 mm	50 x 1.8 mm (1 layer)	Service fitted at any position within the aperture (min. separation 30 mm from seal edges and 30 mm from other services)		
Up to 110 mm / 3.0-6.6 mm wall th.	EI 240 U/C			50 x 3.6 mm (2 layers)			
Up to Ø 125 mm / 3.5-7.4 mm wall th.	EI 120 U/C			50 x 7.2 mm (4 layers)			
Up to Ø 110 mm / 2.7-6.6 mm wall th., containing telecom cables up to Ø 14 mm (bundled up to Ø 90 mm)				50 x 3.6 mm (2 layers)			

# Annex A - Resistance to fire classification - Mulcol® Multimortar


Fire test cable penetration seal

Mulcol® Multimortar

Rigid floor construction according to I.2.2

**MULCOL**

**FIRE PROTECTION**



Scale : 1:5

Unit of measure : mm

Date : 6-4-2016


Company : Mulcol International B.V.

RF-EC-MM1.3.10

Department : Research & Development

A4

Draftsman : R.M.

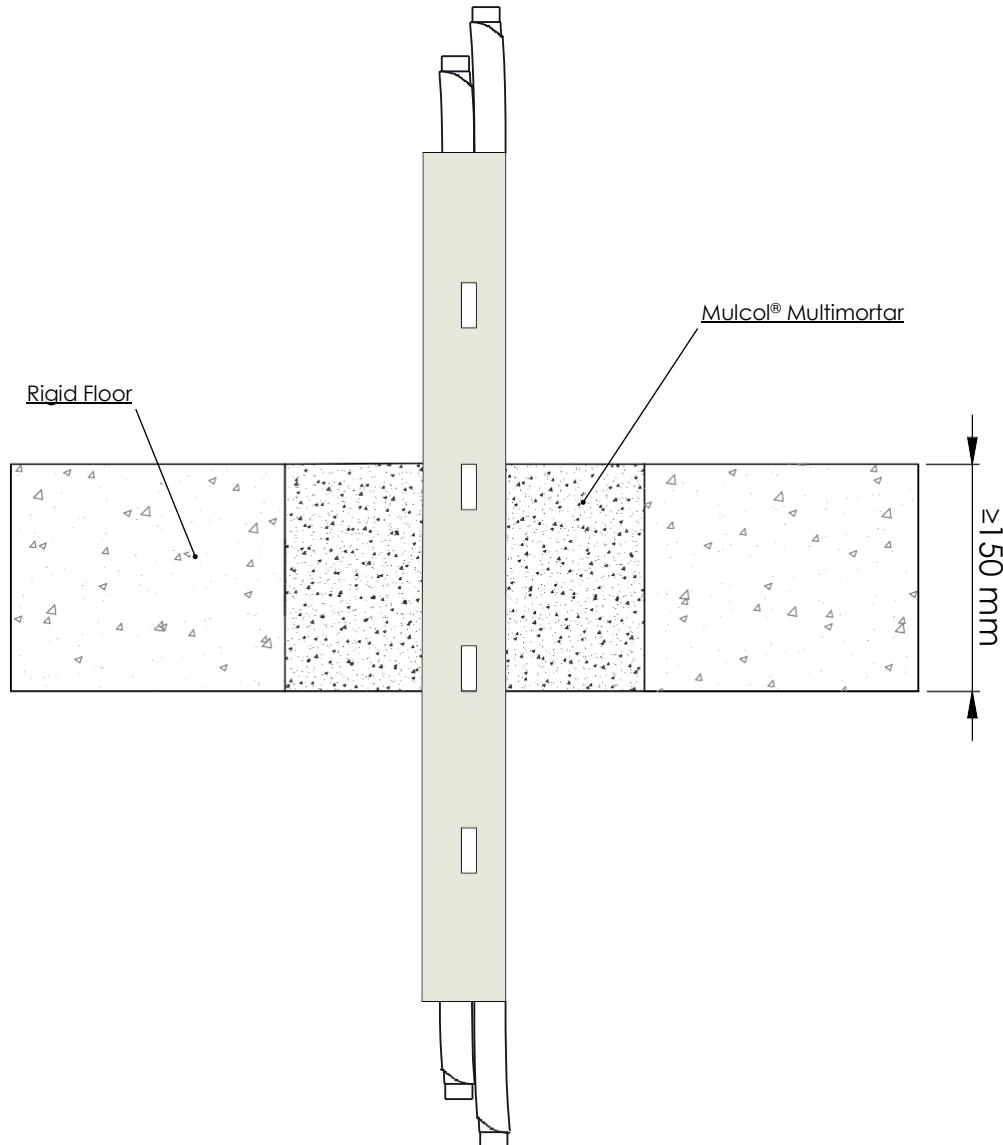

## A 3.10 Penetration seal with cables and trays

Services	Classification	Position Mulcol® Multimortar	Maximum seal	Position services
Blank seals	E 240, EI 180			
Electrical cables up to $\varnothing$ 21 mm (single or in a bundle)	E 240, EI 120			
Steel cable trays & ladders up to 500 mm wide		Entire floor thickness 150 mm	2400 x 1200 mm	Service fitted at any position within the aperture (min. separation 30 mm from seal edges and 30 mm from other services)
Electric cables $\varnothing$ 22-50 mm single or in a bundle	E 240, EI 90			
Electric cables $\varnothing$ 51-80 mm single or in a bundle	E 90, EI 60			
Telecommunication cables up to $\varnothing$ 21 mm (single or bundles up to $\varnothing$ 100mm)	EI 120			
Non-sheathed wires up to $\varnothing$ 24 mm				